FUEL REPORT

Sample Rating Trend

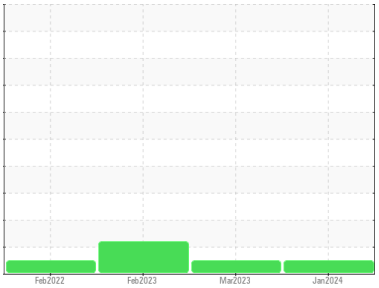

NORMAL

Machine Id
NYU ENERGY BUILDING
Component
Diesel Fuel
Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (25000 GAL)

DIAGNOSIS

Recommendation
All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion
All metal levels are normal indicating no corrosion in the system.

Contaminants
There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition
Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC06073447**	WC05810161	WC05761170
Sample Date		Client Info		**29 Jan 2024**	20 Mar 2023	07 Feb 2023
Machine Age	hrs	Client Info		**0**	0	0
Sample Status				**NORMAL**	NORMAL	ATTENTION

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839	**0.840**	0.841	0.841
Fuel Color	text	*Visual Screen	Yllow	**Red**	Red	Red
ASTM Color	scalar	*ASTM D1500		**L4.0**	L5.0	L4.0
Visc @ 40°C	cSt	ASTM D445	3.0	**2.44**	2.53	2.57

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	**0**	0	0
Sulfur (UVF)	ppm	ASTM D5453		**6**	7	7

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	**161**	165	166
5% Distillation Point	°C	ASTM D86		**187**	188	190
10% Distill Point	°C	ASTM D86	201	**197**	199	201
15% Distillation Point	°C	ASTM D86		**208**	210	211
20% Distill Point	°C	ASTM D86	216	**217**	217	220
30% Distill Point	°C	ASTM D86	230	**233**	233	236
40% Distill Point	°C	ASTM D86	243	**249**	250	252
50% Distill Point	°C	ASTM D86	255	**264**	266	267
60% Distill Point	°C	ASTM D86	267	**279**	281	283
70% Distill Point	°C	ASTM D86	280	**295**	298	298
80% Distill Point	°C	ASTM D86	295	**311**	314	314
85% Distillation Point	°C	ASTM D86		**320**	323	322
90% Distill Point	°C	ASTM D86	310	**329**	332	331
95% Distillation Point	°C	ASTM D86		**344**	344	343
Final Boiling Point	°C	ASTM D86	341	**352**	350	350
Distillation Residue	%	ASTM D86	3.0	**1.4**	1.4	1.4
Distillation Loss	%	ASTM D86	3.0	**0.7**	1.0	0.8

IGNITION QUALITY	method	limit/base	current	history1	history2
API Gravity	ASTM D7777	37.7	**37.0**	36.8	36.8
Cetane Index	ASTM D4737	<40.0	**48.8**	48.8	49.2

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	**0**	0	0
Sodium	ppm	ASTM D5185m	<0.1	**0**	0	0
Potassium	ppm	ASTM D5185m	<0.1	**0**	<1	0
Water	%	ASTM D6304	<0.05	**0.006**	0.010	0.004
ppm Water	ppm	ASTM D6304	<500	**68**	109.0	45.7
% Gasoline	%	*In-House	<0.50	**0.0**	0.0	0.0
% Biodiesel	%	*In-House	<20.0	**3.6**	7.2	7.0

FUEL REPORT

Fuel Distillation Curve

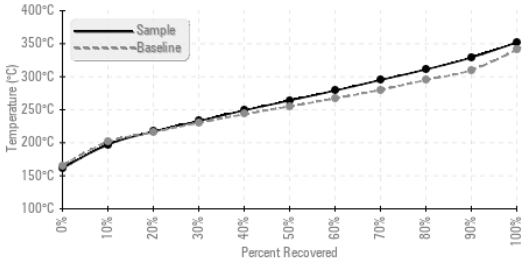

Particle Count

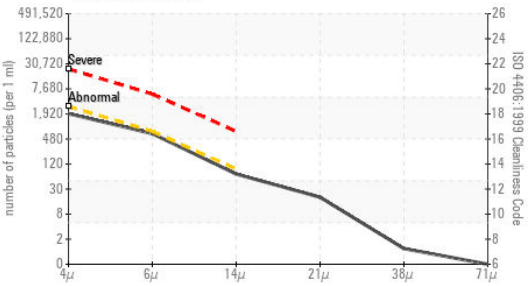

Water (KF)

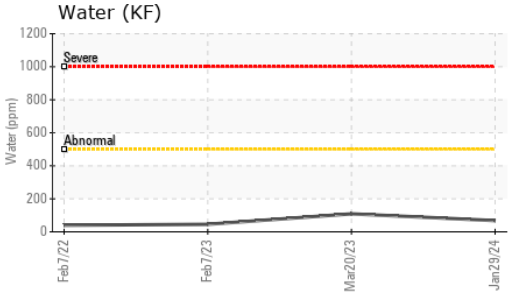

Viscosity @ 40°C

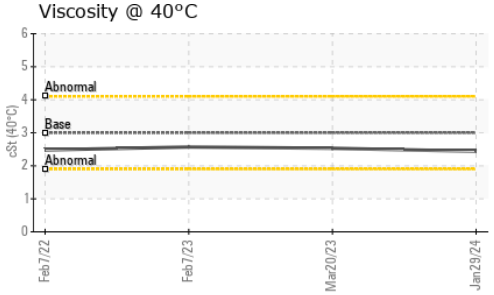

Particle Trend

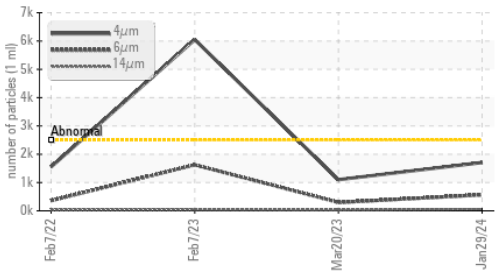

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	**1707**	1100	▲ 6050
Particles >6µm	ASTM D7647	>640	**566**	295	▲ 1625
Particles >14µm	ASTM D7647	>80	**61**	27	42
Particles >21µm	ASTM D7647	>20	**17**	8	7
Particles >38µm	ASTM D7647	>4	**1**	0	1
Particles >71µm	ASTM D7647	>3	**0**	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	**18/16/13**	17/15/12	▲ 20/18/13

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	**0**	0	0
Nickel	ppm	ASTM D5185m	<0.1	**0**	0	<1
Lead	ppm	ASTM D5185m	<0.1	**0**	0	0
Vanadium	ppm	ASTM D5185m	<0.1	**0**	0	0
Iron	ppm	ASTM D5185m	<0.1	**0**	0	0
Calcium	ppm	ASTM D5185m	<0.1	**0**	0	0
Magnesium	ppm	ASTM D5185m	<0.1	**0**	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	**0**	5	0
Zinc	ppm	ASTM D5185m	<0.1	**0**	0	0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			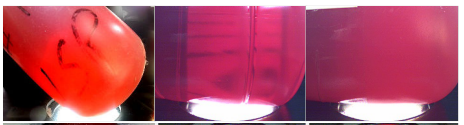		
Bottom			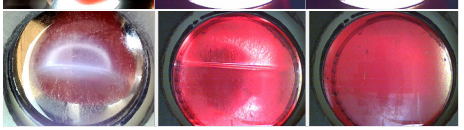		

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06073447 **Recieved** : 29 Jan 2024
Lab Number : 06073447 **Diagnosed** : 06 Feb 2024
Unique Number : 10850124 **Diagnostician** : Doug Bogart
Test Package : DF-1 (Additional Tests: Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ISP FUEL SYSTEMS
9 CHRIS COURT, SUITE F
DAYTON, NJ
US 08810
Contact: AJ THOMPSON
aj@ispfuelsystems.com
T:
F: