




FUEL REPORT

Sample Rating Trend

NORMAL

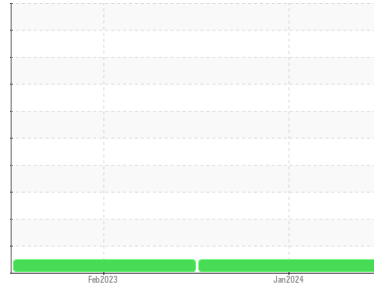

Machine Id
NYU GREENBERG HALL

Component
Diesel Fuel
Fluid
{not provided} (250 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a moderate amount of particulates present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC06073448	WC05761166	---
Sample Date	Client Info			29 Jan 2024	07 Feb 2023	---
Machine Age	hrs	Client Info		0	0	---
Sample Status				NORMAL	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		0.840	0.842	---
Fuel Color	text	*Visual Screen		Red	Red	---
ASTM Color	scalar	*ASTM D1500		L4.0	L4.0	---
Visc @ 40°C	cSt	ASTM D445		2.34	2.53	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	0	---
Sulfur (UVF)	ppm	ASTM D5453		6	8	---






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		158	164	---
5% Distillation Point	°C	ASTM D86		185	190	---
10% Distill Point	°C	ASTM D86		196	202	---
15% Distillation Point	°C	ASTM D86		208	212	---
20% Distill Point	°C	ASTM D86		217	220	---
30% Distill Point	°C	ASTM D86		233	237	---
40% Distill Point	°C	ASTM D86		249	253	---
50% Distill Point	°C	ASTM D86		264	268	---
60% Distill Point	°C	ASTM D86		279	283	---
70% Distill Point	°C	ASTM D86		294	298	---
80% Distill Point	°C	ASTM D86		311	314	---
85% Distillation Point	°C	ASTM D86		319	322	---
90% Distill Point	°C	ASTM D86		329	330	---
95% Distillation Point	°C	ASTM D86		343	342	---
Final Boiling Point	°C	ASTM D86		352	350	---
Distillation Residue	%	ASTM D86		1.4	1.4	---
Distillation Loss	%	ASTM D86		0.7	0.8	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		37.0	36.6	---
Cetane Index		ASTM D4737	<40.0	48.8	49.2	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	0	---
Sodium	ppm	ASTM D5185m	<0.1	0	0	---
Potassium	ppm	ASTM D5185m	<0.1	0	0	---
Water	%	ASTM D6304	<0.05	0.006	0.004	---
ppm Water	ppm	ASTM D6304	<500	63	48.1	---
% Gasoline	%	*In-House	<0.50	0.0	0.0	---
% Biodiesel	%	*In-House	<20.0	3.8	7.1	---



FUEL REPORT

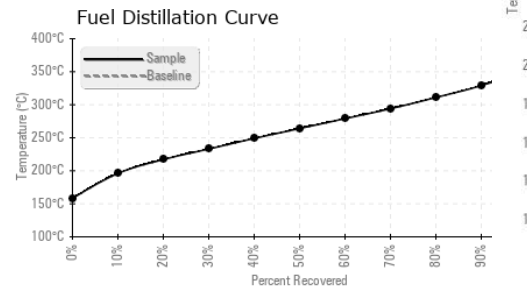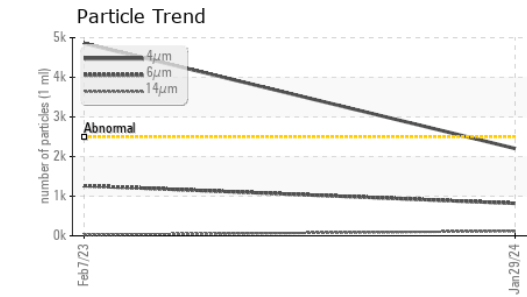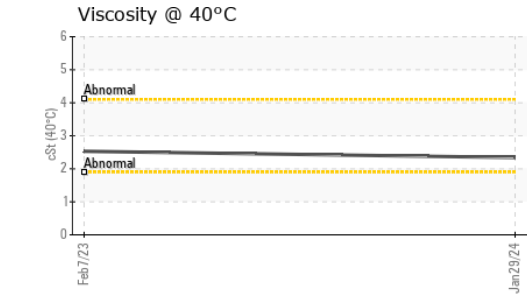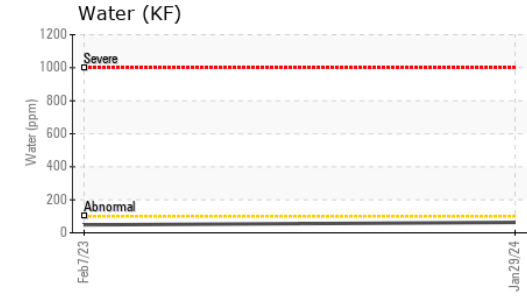
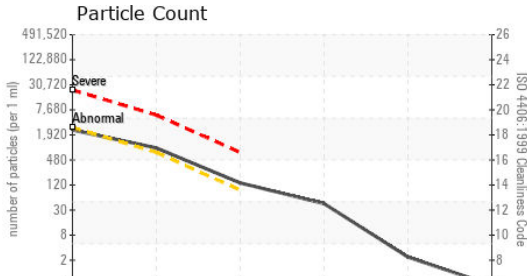


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	2204	4858	---
Particles >6µm	ASTM D7647	>640	819	1264	---
Particles >14µm	ASTM D7647	>80	119	25	---
Particles >21µm	ASTM D7647	>20	38	3	---
Particles >38µm	ASTM D7647	>4	2	0	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	18/17/14	19/17/12	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	0	---
Nickel	ppm	ASTM D5185m <0.1	0	<1	---
Lead	ppm	ASTM D5185m <0.1	0	0	---
Vanadium	ppm	ASTM D5185m <0.1	0	0	---
Iron	ppm	ASTM D5185m <0.1	0	0	---
Calcium	ppm	ASTM D5185m <0.1	0	0	---
Magnesium	ppm	ASTM D5185m <0.1	0	0	---
Phosphorus	ppm	ASTM D5185m <0.1	0	<1	---
Zinc	ppm	ASTM D5185m <0.1	0	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

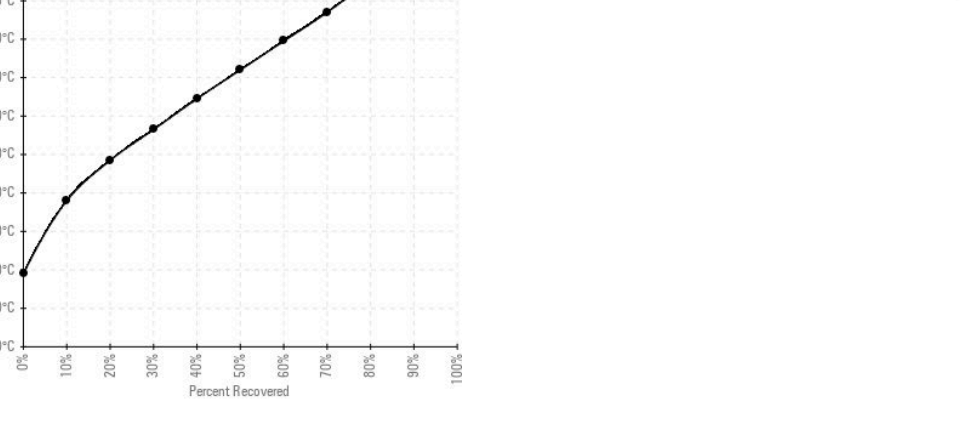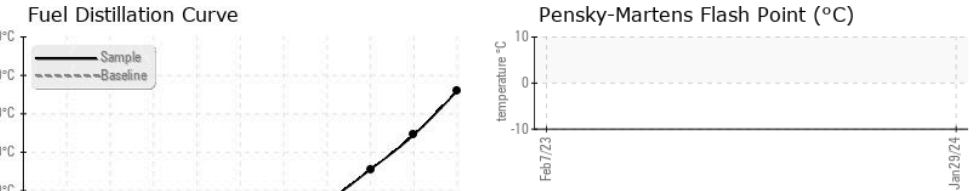

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06073448 **Received** : 30 Jan 2024
Lab Number : **06073448** **Diagnosed** : 06 Feb 2024
Unique Number : 10850125 **Diagnostician** : Doug Bogart
Test Package : DF-1 (Additional Tests: Screen)

ISP FUEL SYSTEMS
 9 CHRIS COURT, SUITE F
 DAYTON, NJ
 US 08810
 Contact: AJ THOMPSON
 aj@ispfuelsystems.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)