

## **FUEL REPORT**

Sample Rating Trend

### NORMAL

## NYU SKIR BALL ULSD 3K Component

**Diesel Fuel** Fluic {not provided} (3000 GAL)

#### DIAGNOSIS

#### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

#### Corrosion

All metal levels are normal indicating no corrosion in the system.

#### Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

#### **Fuel Condition**

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

				Jan2024		
SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC06073456		
Sample Date		Client Info		29 Jan 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP		method	limit/base	ourront	history1	history2
			mmvbase	current 0.840	, in the second s	
Specific Gravity	4	*ASTM D1298 *Visual Screen				
Fuel Color ASTM Color	text	*ASTM D1500		Red		
	scalar			L4.0		
Visc @ 40°C	cSt	ASTM D445		2.39		
SULFUR CONTER	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0		
Sulfur (UVF)	ppm	ASTM D5453		7		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		165		
5% Distillation Point	°C	ASTM D86		187		
10% Distill Point	°C	ASTM D86		197		
15% Distillation Point	°C	ASTM D86		206		
20% Distill Point	°C	ASTM D86		214		
30% Distill Point	°C	ASTM D86		231		
40% Distill Point	°C	ASTM D86		247		
50% Distill Point	°C	ASTM D86		265		
60% Distill Point	°C	ASTM D86		283		
70% Distill Point	°C	ASTM D86		300		
80% Distill Point	°C	ASTM D86		317		
85% Distillation Point	°C	ASTM D86		325		
90% Distill Point	°C	ASTM D86		334		
95% Distillation Point	°C	ASTM D86		346		
Final Boiling Point	°C	ASTM D86		353		
Distillation Residue	%	ASTM D86		1.4		
Distillation Loss	%	ASTM D86		1.0		
IGNITION QUALI	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777		37.0		
Cetane Index		ASTM D4737	<40.0	48.9		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	0		
Potassium	ppm	ASTM D5185m	<0.1	0		
Water	%	ASTM D6304		0.007		
ppm Water	ppm	ASTM D6304	<500	76		
% Gasoline	%	*In-House	< 0.50	0.0		
% Biodiesel	%	*In-House	<20.0	8.9		



Î

number of particles (per 1

Water

20

(40°C) ŝ

400°

350° <del>ි</del> 300°C

250°0

້ ສີ 200°I


150°

10

7 68

1.92 48

# FUEL REPORT

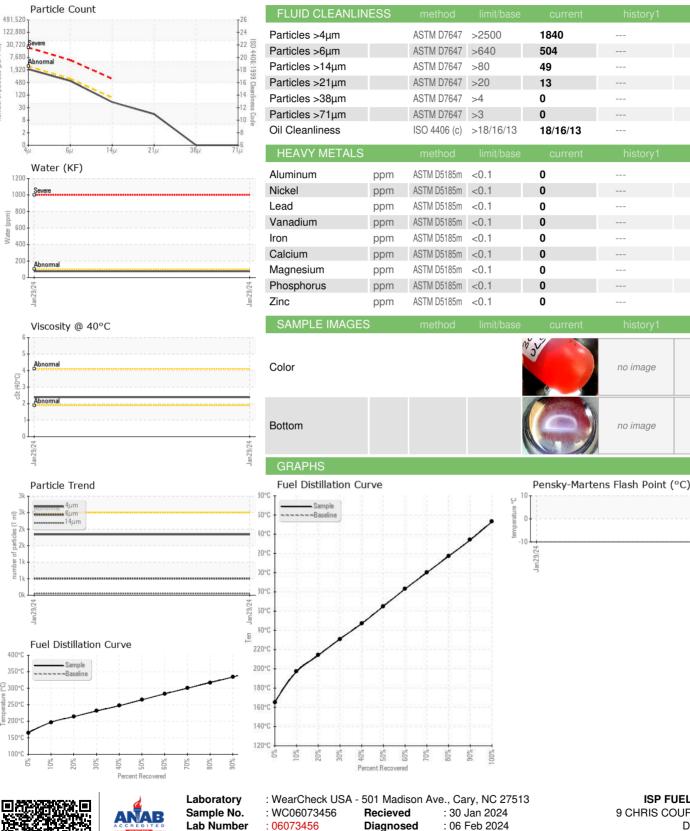

**ISP FUEL SYSTEMS** 9 CHRIS COURT, SUITE F DAYTON, NJ US 08810 Contact: AJ THOMPSON aj@ispfuelsystems.com T: F:

Certificate L2367

Unique Number

: 10850133

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Test Package : DF-1 (Additional Tests: Screen)

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnostician : Doug Bogart

Contact/Location: AJ THOMPSON - ISPDAY

no image

no image

an29/24