




COOLANT REPORT

Sample Rating Trend

NORMAL

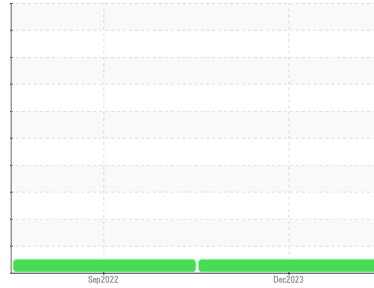

Area
[W131152]
 Machine Id
GENERAC TRANSORE SITE 5
 Component
Coolant
 Fluid
HYBRID (HOAT) COOLANT (--- GAL)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC06073476	WCM1396193	---
Sample Date	Client Info		12 Dec 2023	07 Sep 2022	---
Machine Age	hrs	Client Info	0	153	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			NORMAL	NORMAL	---

PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298		1.068	1.068	---
pH	Scale 0-14 ASTM D1287		7.53	7.58	---
Nitrites	ppm AP-053:2009		1052	1240	---
Reserve Alkalinity	Scale 0-20 *ASTM D1121		---	---	---
Percentage Glycol	% ASTM D3321		50.2	50.6	---
Freezing Point	°F ASTM D3321		-35	-35	---
Total Dissolved Solids			444.0	431.0	---
Carboxylate			n/a	n/a	---








VISUAL

	method	limit/base	current	history1	history2
Coolant Color	*Visual		Yellow	Yellow	---
Coolant Appearance	*Visual	Clear	normal	normal	---

Color					no image
Bottom					no image



COOLANT REPORT

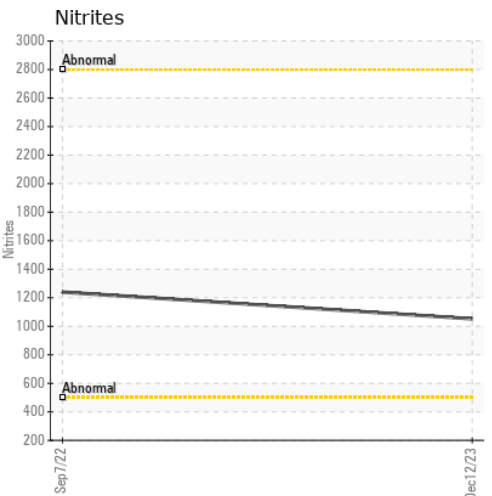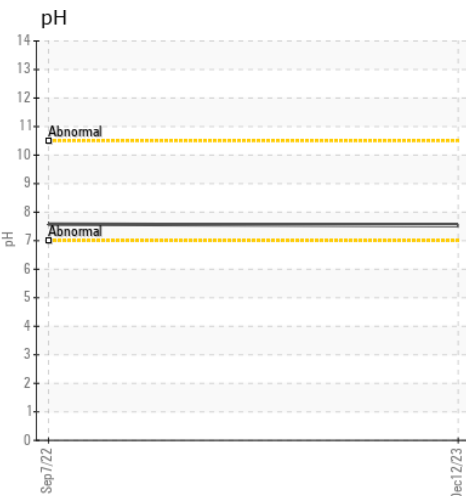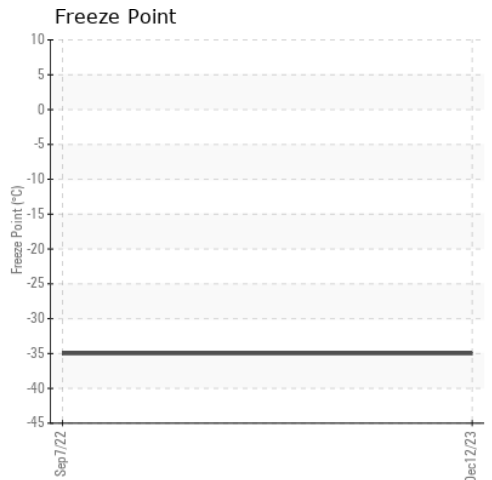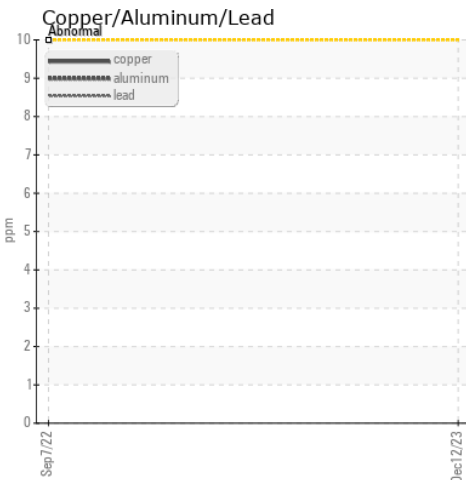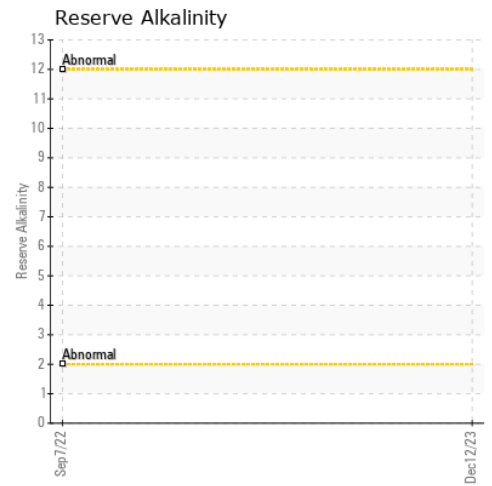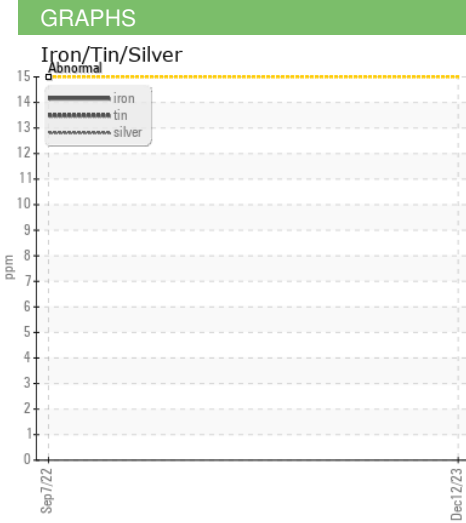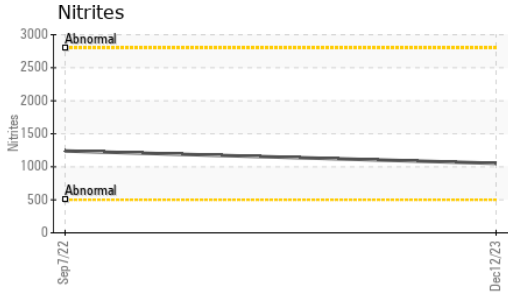

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06073476 **Received** : 30 Jan 2024
Lab Number : 06073476 **Diagnosed** : 31 Jan 2024
Unique Number : 10850153 **Diagnostician** : Jonathan Hester
Test Package : COOL- (Additional Tests: COOL)

NATIONAL POWER CORP
 4541 PRESLYN DR
 RALEIGH, NC
 US 27616
 Contact: BRANDON RICE
 brandon.rice@natpow.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (919)790-9714