




# OIL ANALYSIS REPORT

Sample Rating Trend

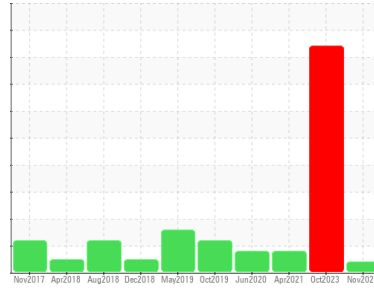

VIS DEBRIS



Machine Id  
**KAESER CSD 100ST 5712151 (S/N 1074)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- QTS)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### ▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC06073869</b>	KC108279	KC90115
Sample Date	Client Info		<b>13 Nov 2023</b>	28 Oct 2023	28 Apr 2021
Machine Age	hrs	Client Info	<b>27263</b>	26086	23789
Oil Age	hrs	Client Info	<b>0</b>	2500	4000
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Changed
Sample Status			<b>ABNORMAL</b>	SEVERE	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>8</b>	26	2
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>4</b>	▲ 10	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>3</b>	2	2
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m 500	<b>249</b>	315	89
Zinc	ppm	ASTM D5185m	<b>158</b>	218	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Water	%	ASTM D6304 >0.05	<b>0.003</b>	0.007	0.004
ppm Water	ppm	ASTM D6304 >500	<b>35</b>	73	46.1




## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>---</b>	90053	2000
Particles >6µm	ASTM D7647 >1300		<b>---</b>	🔴 26862	905
Particles >14µm	ASTM D7647 >80		<b>---</b>	🔴 1038	▲ 107
Particles >21µm	ASTM D7647 >20		<b>---</b>	🔴 225	▲ 25
Particles >38µm	ASTM D7647 >4		<b>---</b>	▲ 9	2
Particles >71µm	ASTM D7647 >3		<b>---</b>	1	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		<b>---</b>	🔴 24/22/17	▲ 17/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.84</b>	1.02	0.562


# OIL ANALYSIS REPORT

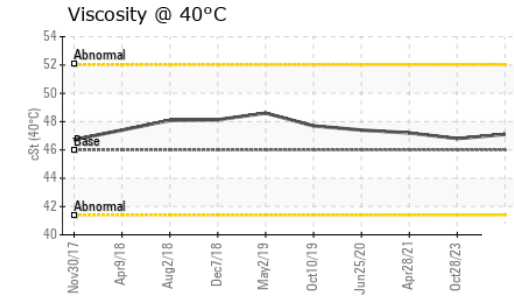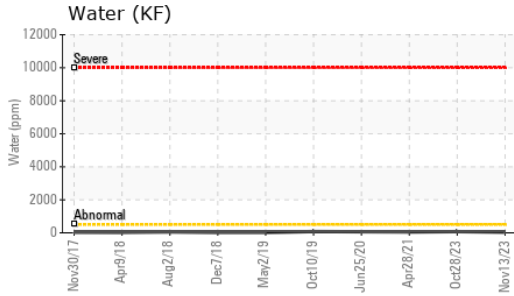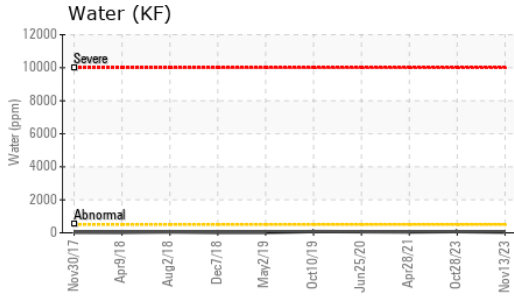





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	▲ MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.1	46.8	47.2

**SAMPLE IMAGES**

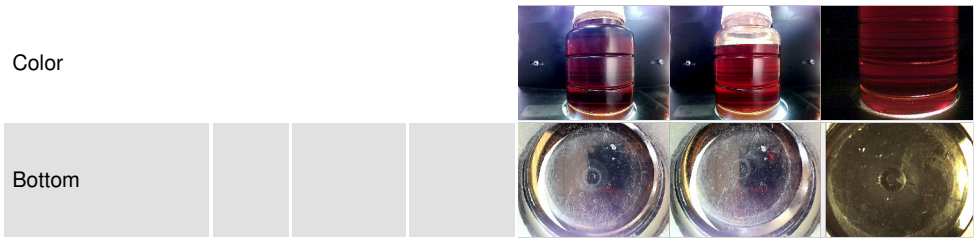

**GRAPHS**

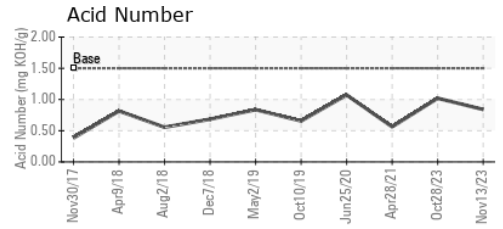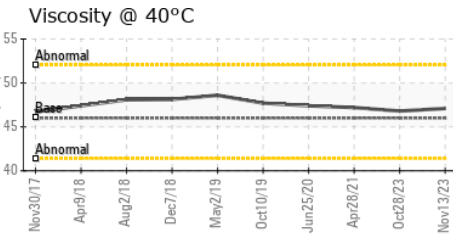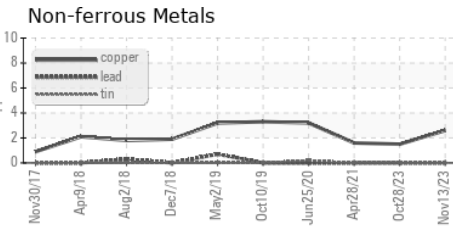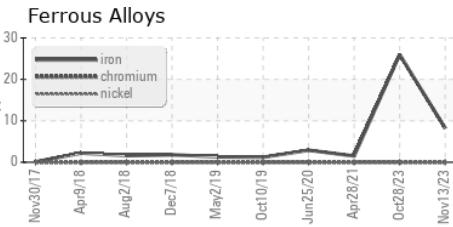

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06073869 **Recieved** : 30 Jan 2024  
**Lab Number** : 06073869 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10855960 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**MASTERS GALLERY FOODS**  
 411 HWY PP  
 PLYMOUTH, WI  
 US 53073  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: