




OIL ANALYSIS REPORT

Sample Rating Trend

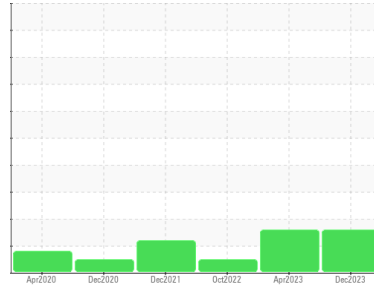

Machine Id
KAESER 6673829

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA011284	KC111655	KC107571
Sample Date	Client Info	29 Dec 2023	28 Apr 2023	14 Oct 2022
Machine Age	hrs	19249	15545	12378
Oil Age	hrs	0	3168	3100
Oil Changed	Client Info	N/A	Changed	Changed
Sample Status		ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	0	<1	<1
Chromium	ppm ASTM D5185m >10	0	0	0
Nickel	ppm ASTM D5185m >3	0	<1	0
Titanium	ppm ASTM D5185m >3	0	0	0
Silver	ppm ASTM D5185m >2	0	0	0
Aluminum	ppm ASTM D5185m >10	0	<1	0
Lead	ppm ASTM D5185m >10	0	0	0
Copper	ppm ASTM D5185m >50	11	5	10
Tin	ppm ASTM D5185m >10	0	<1	0
Antimony	ppm ASTM D5185m	---	---	---
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 0	0	0	0
Barium	ppm ASTM D5185m 90	0	33	0
Molybdenum	ppm ASTM D5185m 0	0	0	0
Manganese	ppm ASTM D5185m	0	<1	0
Magnesium	ppm ASTM D5185m 100	10	51	32
Calcium	ppm ASTM D5185m 0	0	2	<1
Phosphorus	ppm ASTM D5185m 0	0	2	5
Zinc	ppm ASTM D5185m 0	8	5	20
Sulfur	ppm ASTM D5185m 23500	16192	22829	18069

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	4	4	6
Sodium	ppm ASTM D5185m	8	29	22
Potassium	ppm ASTM D5185m >20	0	4	4
Water	% ASTM D6304 >0.05	0.010	0.019	0.021
ppm Water	ppm ASTM D6304 >500	107	192.5	212.8






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	17281	8934	2799
Particles >6µm	ASTM D7647 >1300	▲ 4721	▲ 2977	960
Particles >14µm	ASTM D7647 >80	▲ 152	▲ 168	66
Particles >21µm	ASTM D7647 >20	▲ 27	▲ 22	17
Particles >38µm	ASTM D7647 >4	0	1	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/19/14	▲ 20/19/15	19/17/13

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 1.0	0.33	0.31	0.23


OIL ANALYSIS REPORT

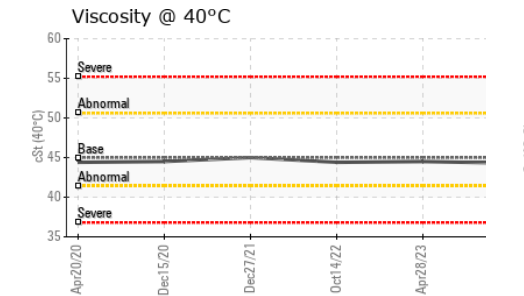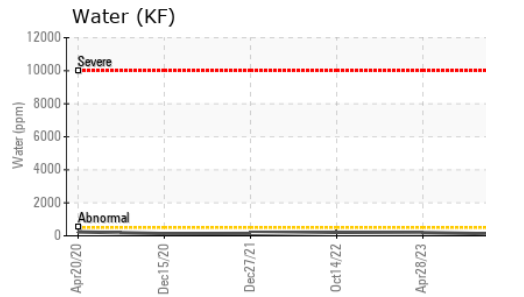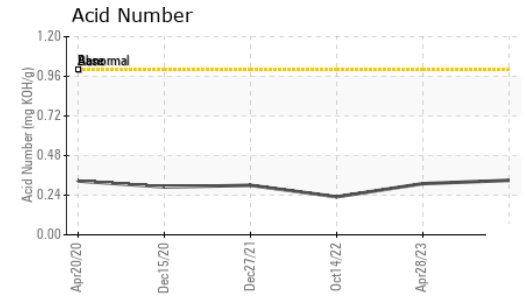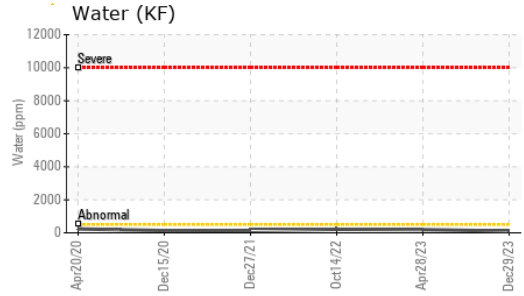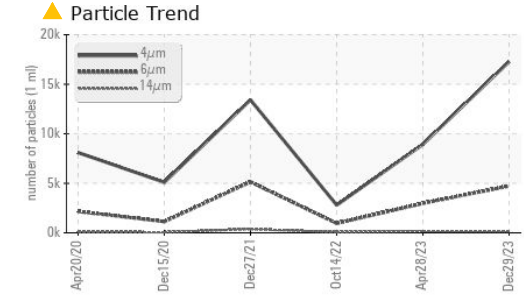





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.3	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

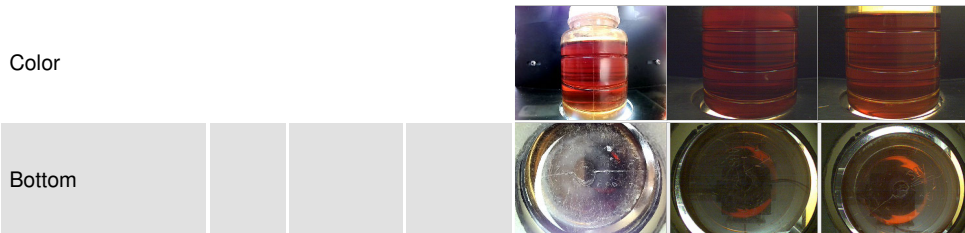

GRAPHS

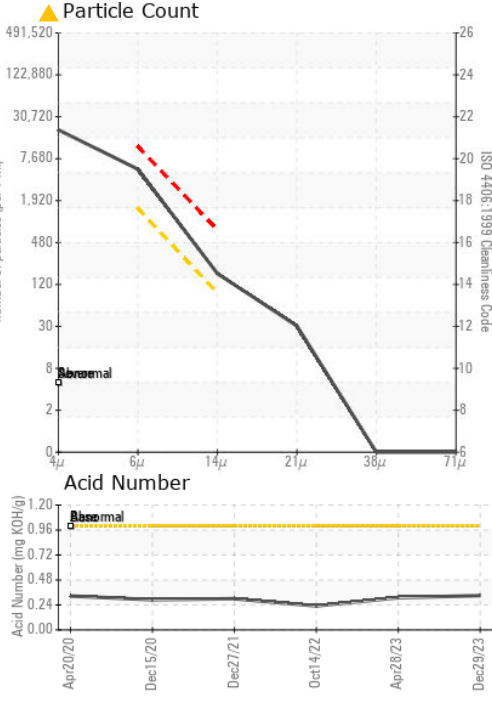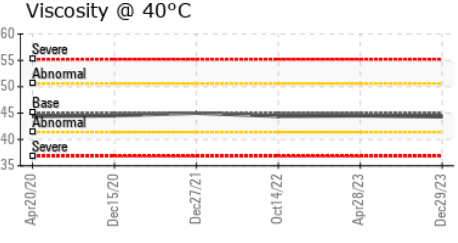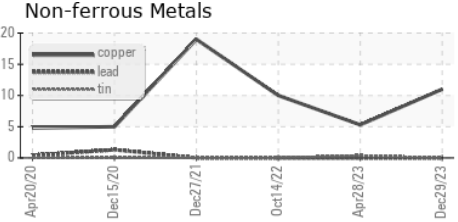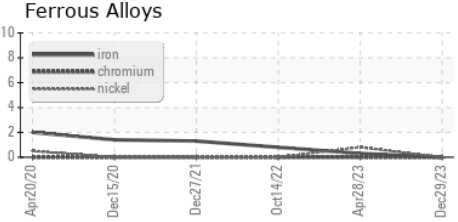

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011284 **Received** : 30 Jan 2024
Lab Number : 06073909 **Diagnosed** : 31 Jan 2024
Unique Number : 10856000 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

BAY AREA GRANITE & MARBLE LLC
 145 GOLF COURSE DR
 WRIGHTSTOWN, WI
 US 54180
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)