

OIL ANALYSIS REPORT

Sample Rating Trend



KAESER 7181381

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2020	Jan2022	Jan 2023 Ja	2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA011969	KCP55522	KCP43952
Sample Date		Client Info		18 Jan 2024	06 Jan 2023	06 Jan 2022
Machine Age	hrs	Client Info		14433	10983	7508
Oil Age	hrs	Client Info		0	4200	3000
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	16	25	31
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	0	0	<1
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	0	3
Zinc	ppm	ASTM D5185m	0	0	8	8
Sulfur	ppm	ASTM D5185m	23500	16720	22354	16205
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		0	0	1
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.05	0.006	0.025	0.004
ppm Water	ppm	ASTM D6304	>500	70	259.5	42.4
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		59945	16932	17857
Particles >6µm		ASTM D7647	>1300	<u> </u>	4 019	<u>▲</u> 5195
Particles >14µm		ASTM D7647	>80	<u>▲</u> 576	<u>135</u>	<u> </u>
Particles >21µm		ASTM D7647	>20	<u> </u>	△ 38	△ 23
Particles >38μm		ASTM D7647	>4	3	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	23/21/16	<u>\$\text{\Delta}\$ 21/19/14</u>	<u>^</u> 20/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	та КОЦ/а	VSTM D804E	1.0	0.27	0.30	0.33

0.33



OIL ANALYSIS REPORT

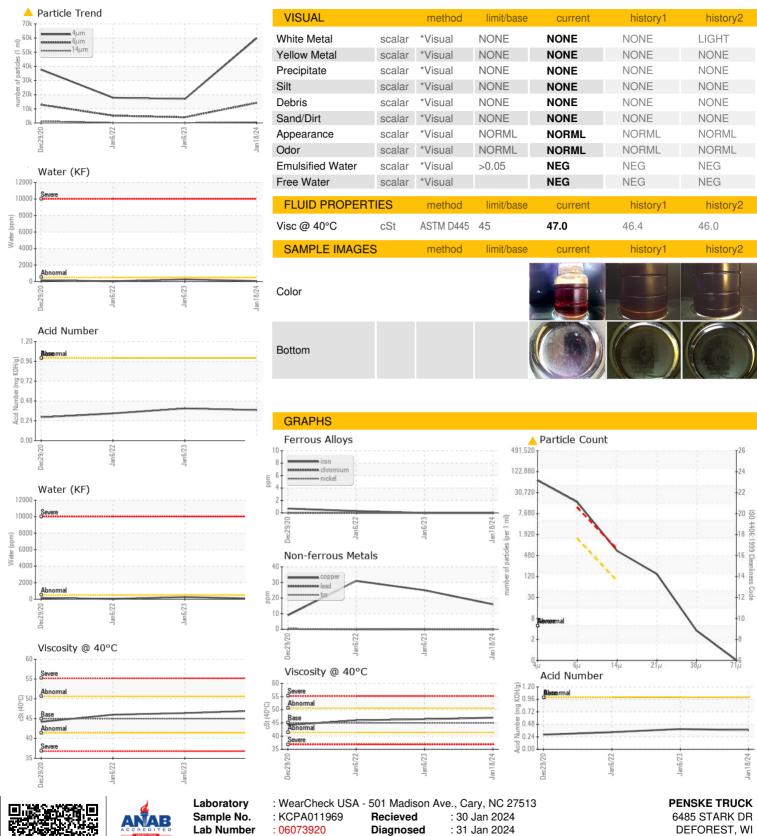





Certificate L2367

Unique Number

Test Package

: 10856011

Diagnostician : Don Baldridge : IND 2 (Additional Tests: KF, PrtCount)

Contact: RICHARD AMMANN RICHARD.AMMANN@PENSKE.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) US 53598

T: F: