




# OIL ANALYSIS REPORT

Sample Rating Trend

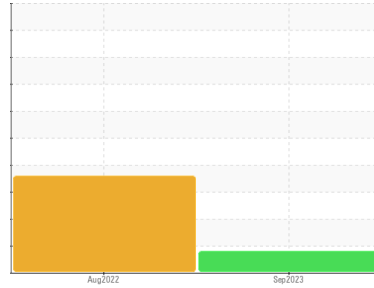

**WEAR**



Machine Id  
**KAESER AS 20 5679874 (S/N 1152)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- QTS)**

**DIAGNOSIS**

**Recommendation**

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

**Wear**

The aluminum level has decreased, but is still abnormal. All other component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCP40060D</b>	KCP48297	---
Sample Date	Client Info			<b>13 Sep 2023</b>	21 Aug 2022	---
Machine Age	hrs	Client Info		<b>23014</b>	21477	---
Oil Age	hrs	Client Info		<b>0</b>	300	---
Oil Changed	Client Info			<b>Changed</b>	Changed	---
Sample Status				<b>ABNORMAL</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>16</b>	▲ 56	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	▲ <b>16</b>	▲ 23	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>2</b>	3	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	---
Calcium	ppm	ASTM D5185m		<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	500	<b>427</b>	506	---
Zinc	ppm	ASTM D5185m		<b>472</b>	236	---
Sulfur	ppm	ASTM D5185m		<b>1589</b>	2183	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Sodium	ppm	ASTM D5185m		<b>2</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Water	%	ASTM D6304	>0.05	<b>0.006</b>	0.012	---
ppm Water	ppm	ASTM D6304	>500	<b>62</b>	120.1	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1394</b>	12354	---
Particles >6µm		ASTM D7647	>1300	<b>398</b>	▲ 2540	---
Particles >14µm		ASTM D7647	>80	<b>28</b>	▲ 273	---
Particles >21µm		ASTM D7647	>20	<b>7</b>	▲ 80	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	▲ 12	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/16/12</b>	▲ 21/19/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	<b>1.05</b>	1.11	---


# OIL ANALYSIS REPORT

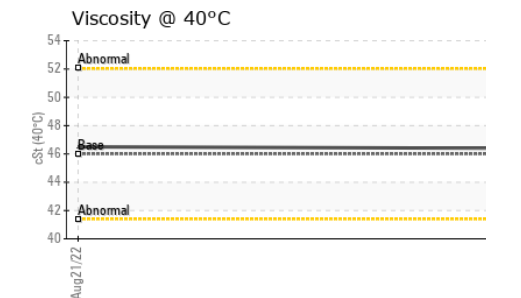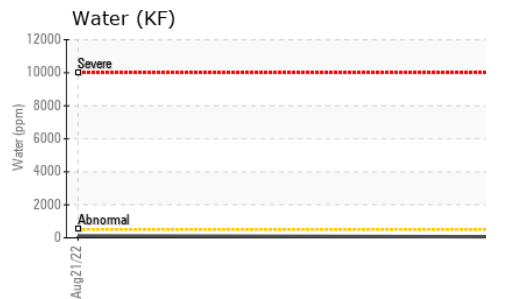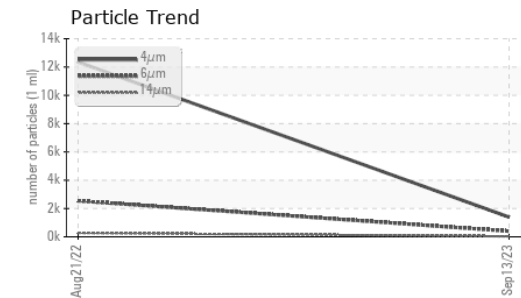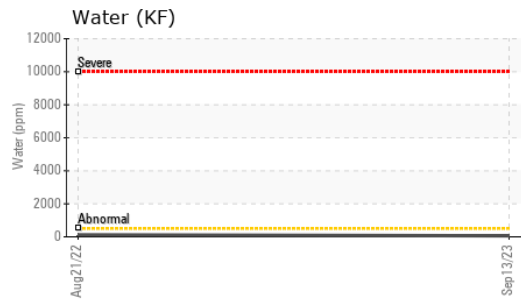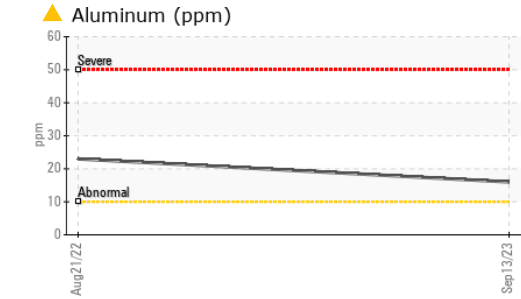





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.4	46.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

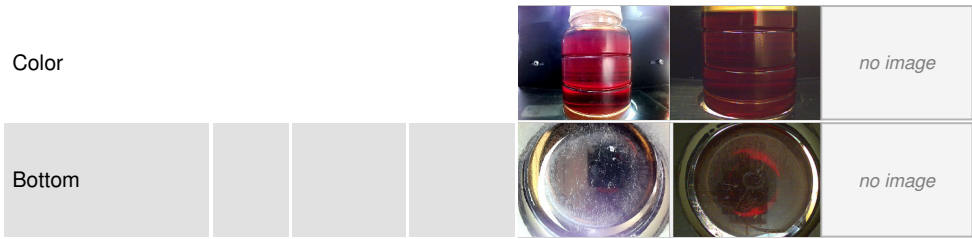

## GRAPHS

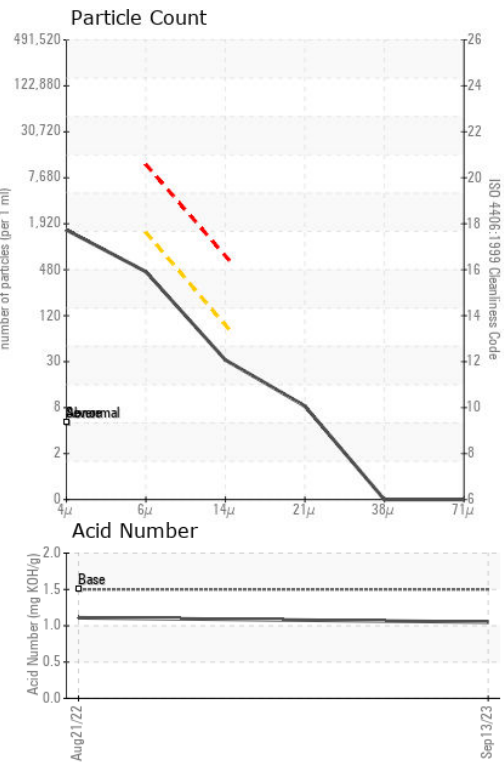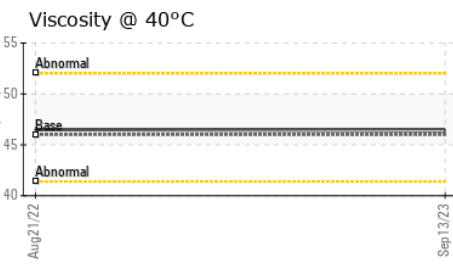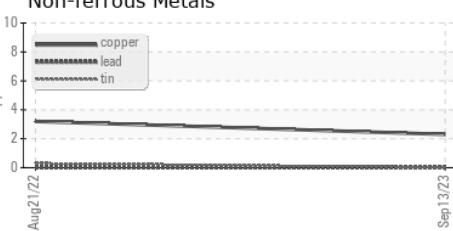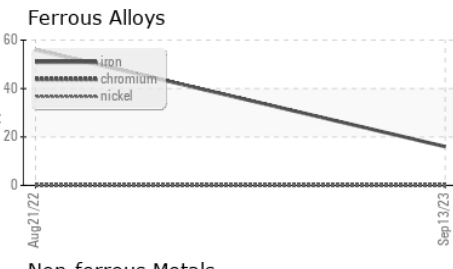

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP40060D **Recieved** : 30 Jan 2024  
**Lab Number** : 06073923 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10856014 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**RIVER OAKS ORCHARDS**  
 9839 HUTCHINSON RD  
 MANTECA, CA  
 US 95337  
 Contact: BRAD  
 BRAD@RIVEROAKORCHARDS.COM  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)