

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



KAESER 7935462

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jan 2023	Nov2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06073930	KC96103	
Sample Date		Client Info		01 Nov 2023	31 Jan 2023	
Machine Age	hrs	Client Info		4135	2760	
Oil Age	hrs	Client Info		0	1352	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	16	14	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	0	2	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		0	6	
Zinc	ppm	ASTM D5185m		0	13	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	
Sodium	ppm	ASTM D5185m		0	<1	
Potassium	ppm	ASTM D5185m	>20	0	0	
Water	%	ASTM D6304		0.009	0.005	
ppm Water	ppm	ASTM D6304	>500	100	58.9	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1243	2936	
Particles >6µm		ASTM D7647	>1300	616	1169	
Particles >14μm		ASTM D7647	>80	59	53	
Particles >21µm		ASTM D7647	>20	7	6	
Particles >38μm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/13	19/17/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 0.4


0.26

0.30



OIL ANALYSIS REPORT

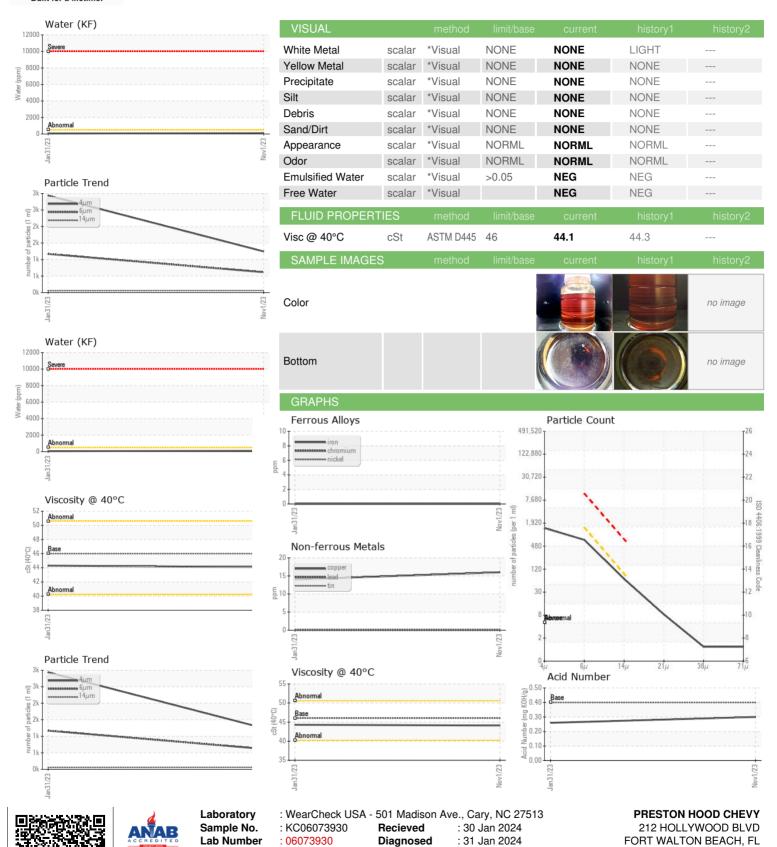



Certificate L2367

Unique Number

Test Package

: 10856021

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

: Don Baldridge

Diagnostician

US 32548

T: F:

Contact: Service Manager