




# OIL ANALYSIS REPORT

Sample Rating Trend

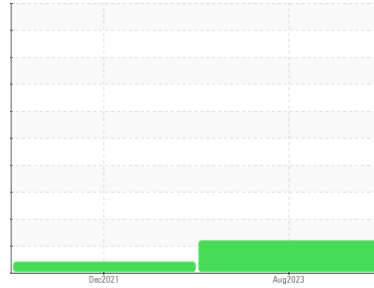

ISO



Machine Id  
**KAESER 7430736**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate amount of particulates present in the oil. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA006017</b>	KCP43202	---
Sample Date	Client Info			<b>29 Aug 2023</b>	21 Dec 2021	---
Machine Age	hrs	Client Info		<b>1097</b>	184	---
Oil Age	hrs	Client Info		<b>0</b>	184	---
Oil Changed	Client Info			<b>N/A</b>	Changed	---
Sample Status				<b>ATTENTION</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Antimony	ppm	ASTM D5185m		<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	<1	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	54	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	100	<b>53</b>	91	---
Calcium	ppm	ASTM D5185m	0	<b>0</b>	3	---
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	4	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	23500	<b>17602</b>	17904	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	1	---
Sodium	ppm	ASTM D5185m		<b>7</b>	9	---
Potassium	ppm	ASTM D5185m	>20	<b>14</b>	13	---
Water	%	ASTM D6304	>0.05	<b>0.020</b>	0.017	---
ppm Water	ppm	ASTM D6304	>500	<b>204</b>	177.7	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>8570</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 2108</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>▲ 126</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>26</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>2</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 20/18/14</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.39</b>	0.35	---


# OIL ANALYSIS REPORT

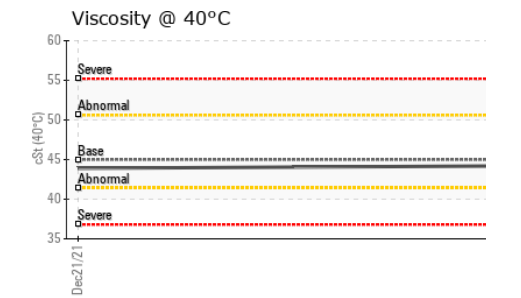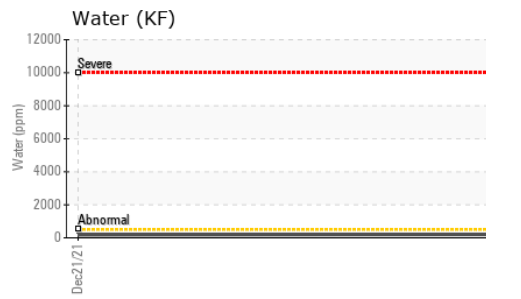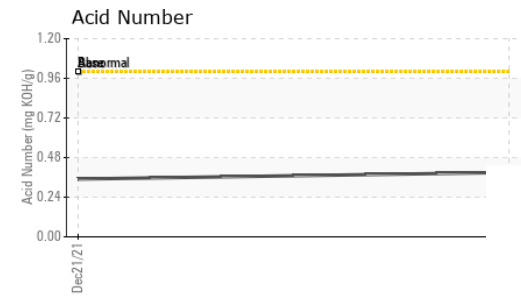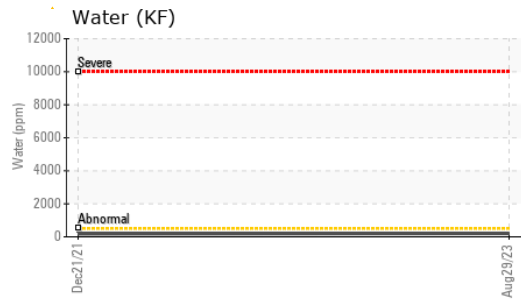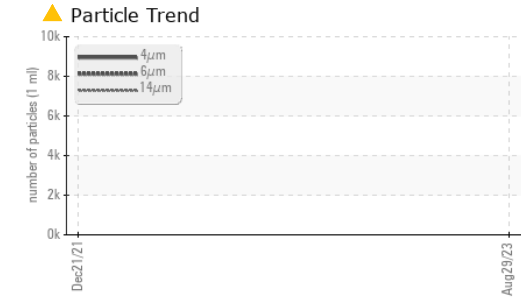





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.2	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

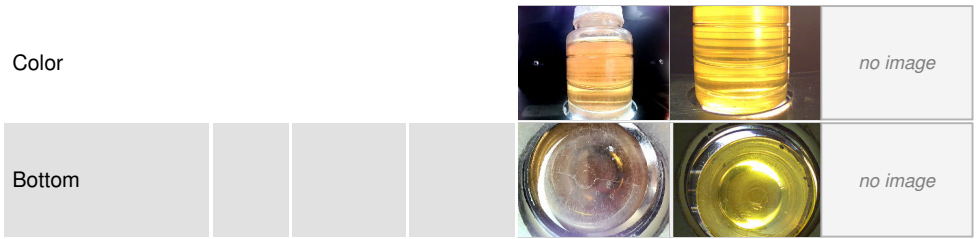

## GRAPHS

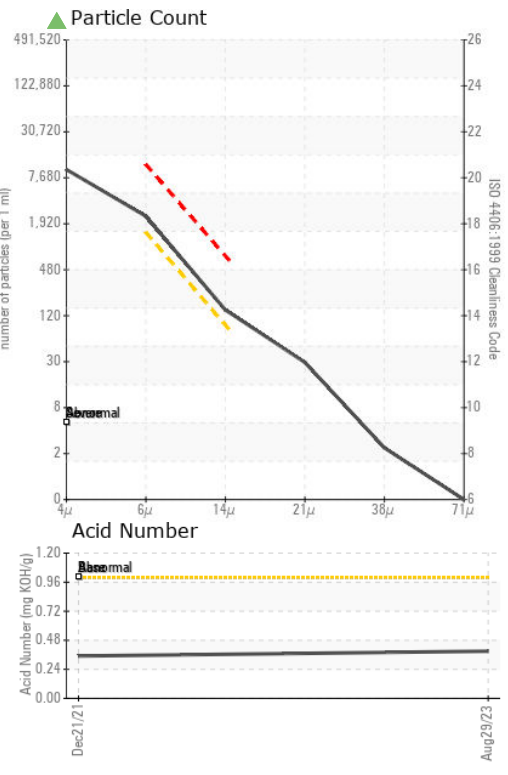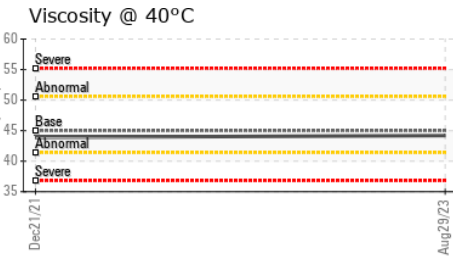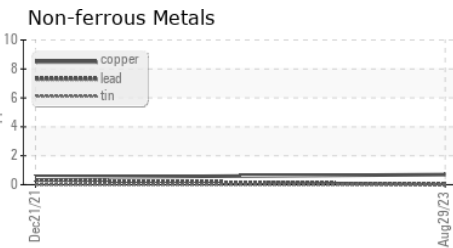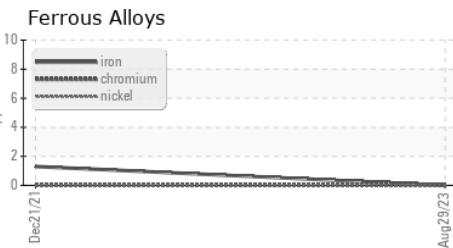

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA006017 **Received** : 30 Jan 2024  
**Lab Number** : 06073941 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10856032 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**ARAMARK**  
 201 E CASPIAN AVE  
 CASPIAN, MI  
 US 49915  
 Contact: THOMAS ALLEN  
 THOMAS.ALLEN@ARAMARK.COM  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)