


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

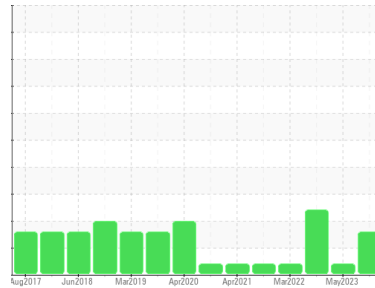

Machine Id  
**KAESER ASD-40 5570877 (S/N 1249)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is a moderate amount of particulates present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC122303</b>	KC101459	KC107545
Sample Date	Client Info			<b>08 Jan 2024</b>	24 May 2023	13 Oct 2022
Machine Age	hrs	Client Info		<b>38694</b>	35781	31481
Oil Age	hrs	Client Info		<b>0</b>	0	6000
Oil Changed	Client Info			<b>N/A</b>	Not Changd	Changed
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>9</b>	6	10
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	35	0
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	2
Zinc	ppm	ASTM D5185m		<b>3</b>	14	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>4</b>	9	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	3	1
Water	%	ASTM D6304	>0.05	<b>0.007</b>	0.009	0.003
ppm Water	ppm	ASTM D6304	>500	<b>76</b>	90.7	34.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>3912</b>	---	20544
Particles >6µm		ASTM D7647	>1300	<b>▲ 1584</b>	---	▲ 10035
Particles >14µm		ASTM D7647	>80	<b>▲ 147</b>	---	▲ 2057
Particles >21µm		ASTM D7647	>20	<b>▲ 33</b>	---	▲ 661
Particles >38µm		ASTM D7647	>4	<b>1</b>	---	▲ 59
Particles >71µm		ASTM D7647	>3	<b>1</b>	---	▲ 3
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>▲ 18/14</b>	---	▲ 21/18

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.32</b>	0.34	0.39

# OIL ANALYSIS REPORT

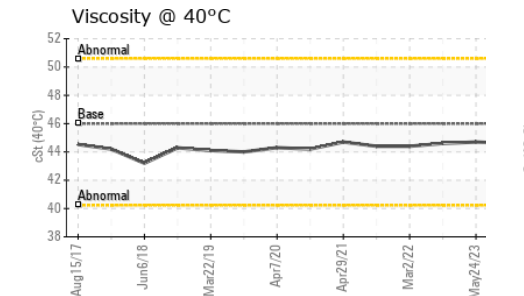
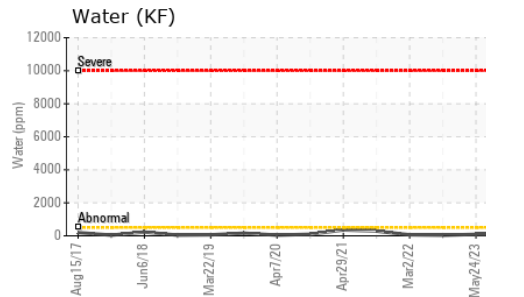
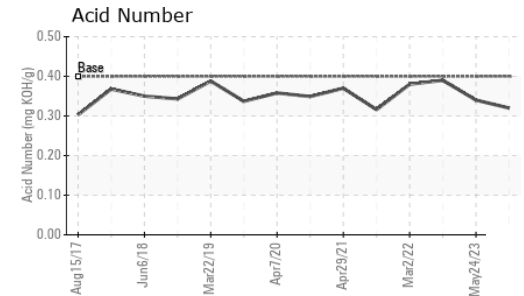
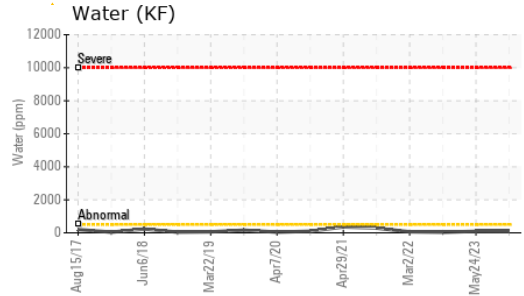
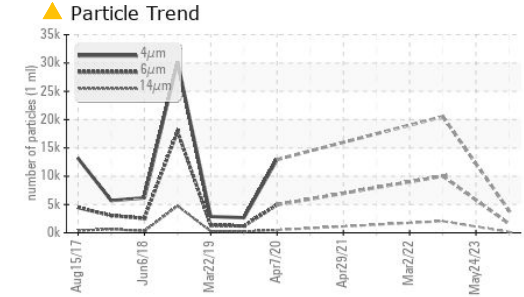


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.6	44.7	44.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

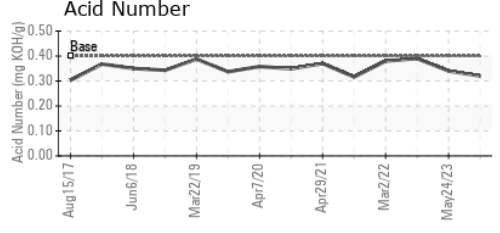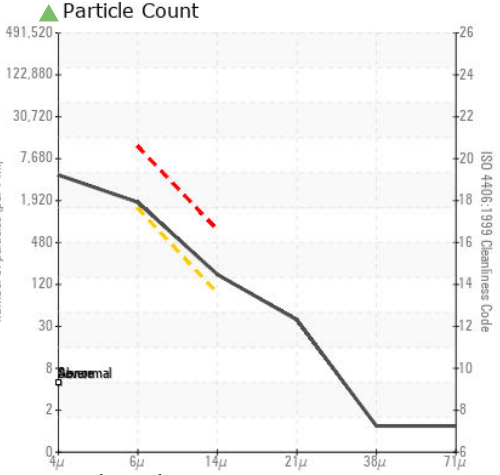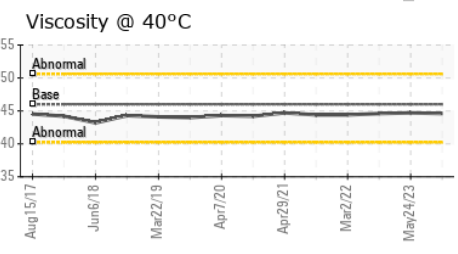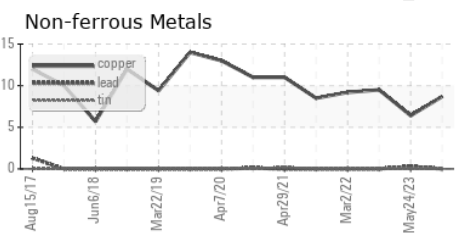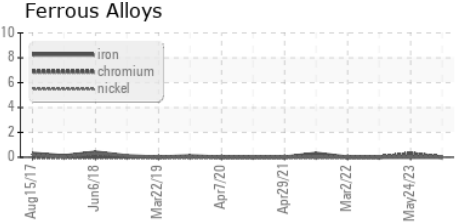

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC122303 **Received** : 30 Jan 2024  
**Lab Number** : 06073959 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10856050 **Diagnostician** : Angela Borella  
**Test Package** : IND 2

**WILSON FOREST PRODUCTS**  
 1216 JEFFERSON RD  
 JEFFERSON, PA  
 US 15344  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: