




OIL ANALYSIS REPORT

Sample Rating Trend

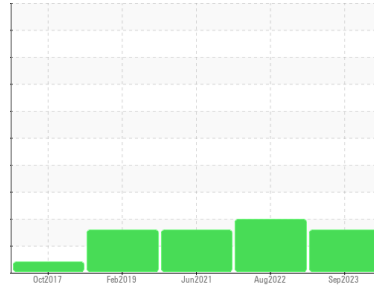

ISO



Machine Id
KAESER SK19 1420907 (S/N 01814514)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA007828	KCP49754	KCP33963
Sample Date	Client Info	26 Sep 2023	01 Aug 2022	16 Jun 2021
Machine Age	hrs	28540	27199	26339
Oil Age	hrs	0	1000	3000
Oil Changed	Client Info	N/A	Changed	Changed
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	2
Chromium	ppm	ASTM D5185m >10	0	<1	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	<1	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	0	<1	<1
Lead	ppm	ASTM D5185m >10	<1	2	4
Copper	ppm	ASTM D5185m >50	<1	<1	2
Tin	ppm	ASTM D5185m >10	0	<1	<1
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	<1
Barium	ppm	ASTM D5185m 90	0	6	0
Molybdenum	ppm	ASTM D5185m 0	0	<1	0
Manganese	ppm	ASTM D5185m	<1	1	1
Magnesium	ppm	ASTM D5185m 100	62	70	49
Calcium	ppm	ASTM D5185m 0	0	8	2
Phosphorus	ppm	ASTM D5185m 0	0	4	0
Zinc	ppm	ASTM D5185m 0	3	19	29
Sulfur	ppm	ASTM D5185m 23500	19434	22331	20295

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	2	5
Sodium	ppm	ASTM D5185m	15	18	25
Potassium	ppm	ASTM D5185m >20	1	2	3
Water	%	ASTM D6304 >0.05	0.019	0.014	0.035
ppm Water	ppm	ASTM D6304 >500	193	148.2	353.6






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	24782	143058	144644
Particles >6µm	ASTM D7647 >1300	7809	40073	57463
Particles >14µm	ASTM D7647 >80	326	1479	4154
Particles >21µm	ASTM D7647 >20	43	285	713
Particles >38µm	ASTM D7647 >4	2	6	35
Particles >71µm	ASTM D7647 >3	0	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	22/20/16	24/23/18	23/19

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.35	0.36	0.328

OIL ANALYSIS REPORT

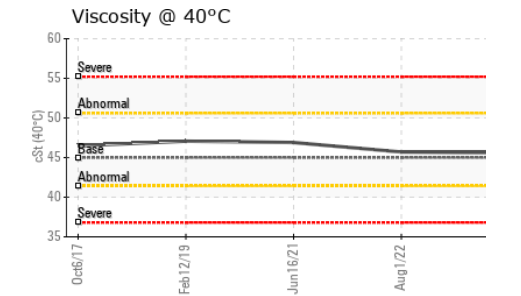
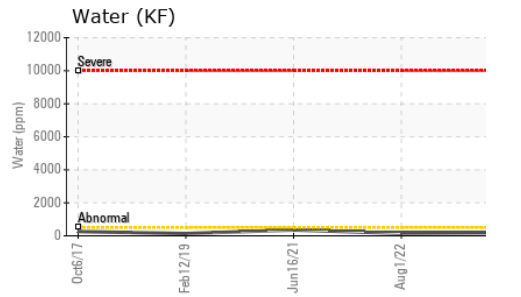
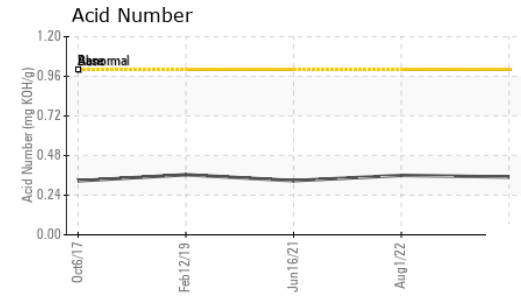
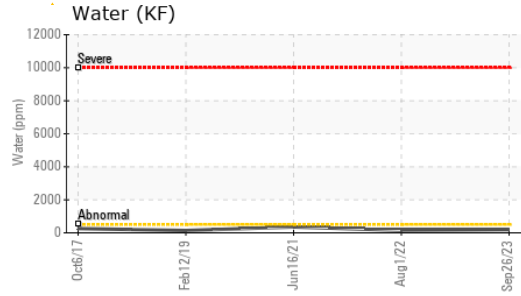
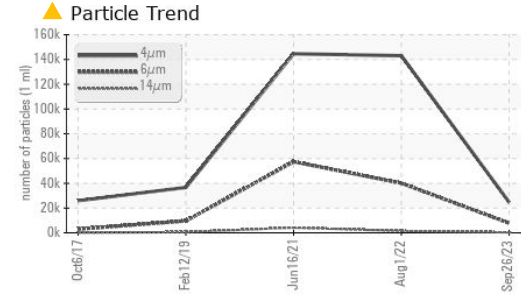


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	45.6	45.7	46.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

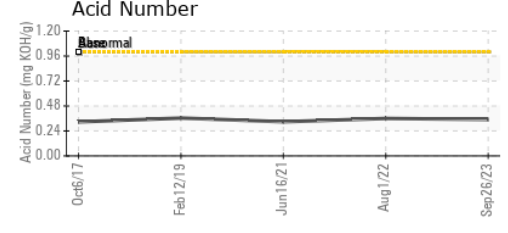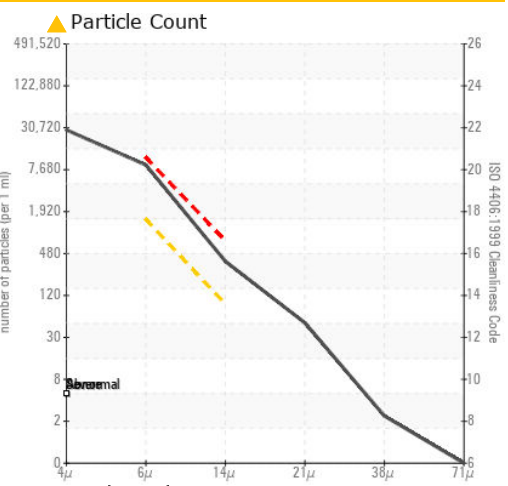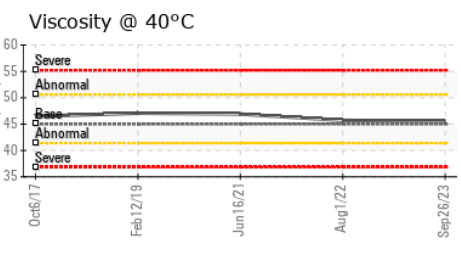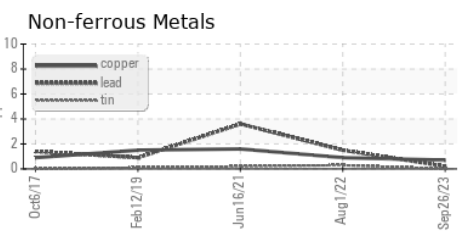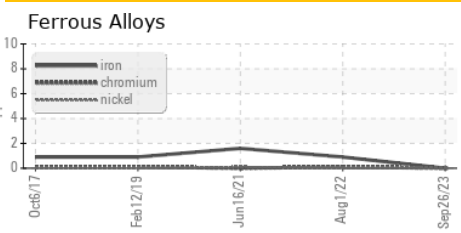

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007828 **Received** : 30 Jan 2024
Lab Number : 06073965 **Diagnosed** : 31 Jan 2024
Unique Number : 10856056 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

JACK WATERS AND SONS CORP
 6600 MIDLAND CT
 ALLENTON, WI
 US 53002
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: