




# OIL ANALYSIS REPORT

Sample Rating Trend

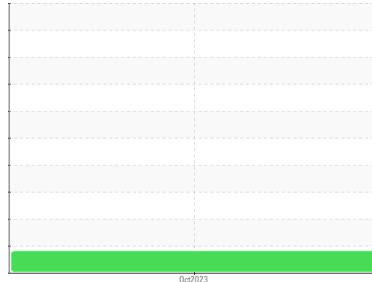

ISO



Machine Id  
**8455211 (S/N 1811)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA007640</b>	---	---
Sample Date	Client Info	<b>10 Oct 2023</b>	---	---
Machine Age	hrs Client Info	<b>7263</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ATTENTION</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	<b>0</b>	---	---
Chromium ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel ppm	ASTM D5185m >3	<b>0</b>	---	---
Titanium ppm	ASTM D5185m >3	<b>0</b>	---	---
Silver ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum ppm	ASTM D5185m >10	<b>0</b>	---	---
Lead ppm	ASTM D5185m >10	<b>0</b>	---	---
Copper ppm	ASTM D5185m >50	<b>4</b>	---	---
Tin ppm	ASTM D5185m >10	<b>0</b>	---	---
Vanadium ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m 0	<b>0</b>	---	---
Barium ppm	ASTM D5185m 90	<b>32</b>	---	---
Molybdenum ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium ppm	ASTM D5185m 100	<b>57</b>	---	---
Calcium ppm	ASTM D5185m 0	<b>0</b>	---	---
Phosphorus ppm	ASTM D5185m 0	<b>0</b>	---	---
Zinc ppm	ASTM D5185m 0	<b>7</b>	---	---
Sulfur ppm	ASTM D5185m 23500	<b>19004</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Sodium ppm	ASTM D5185m	<b>16</b>	---	---
Potassium ppm	ASTM D5185m >20	<b>23</b>	---	---
Water %	ASTM D6304 >0.05	<b>0.019</b>	---	---
ppm Water	ASTM D6304 >500	<b>194</b>	---	---

## FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>9465</b>	---	---
Particles >6µm	ASTM D7647 >1300	<b>▲ 2114</b>	---	---
Particles >14µm	ASTM D7647 >80	<b>72</b>	---	---
Particles >21µm	ASTM D7647 >20	<b>7</b>	---	---
Particles >38µm	ASTM D7647 >4	<b>0</b>	---	---
Particles >71µm	ASTM D7647 >3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 20/18/13</b>	---	---

## FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.0	<b>0.31</b>	---	---

# OIL ANALYSIS REPORT


## ▲ Particle Trend

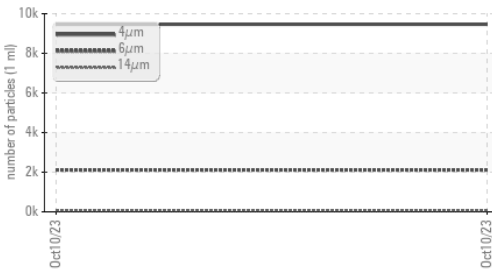


## Water (KF)

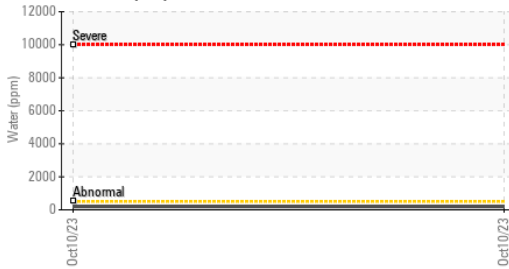


## Acid Number

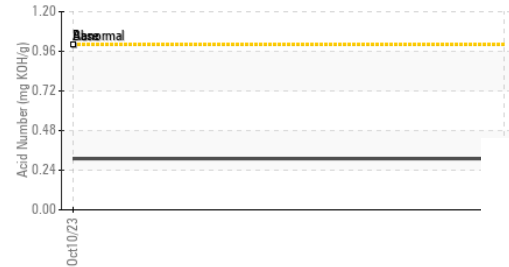

## Water (KF)

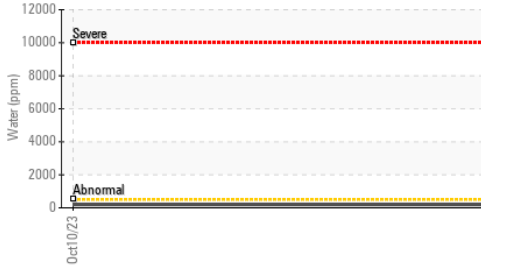

## Viscosity @ 40°C

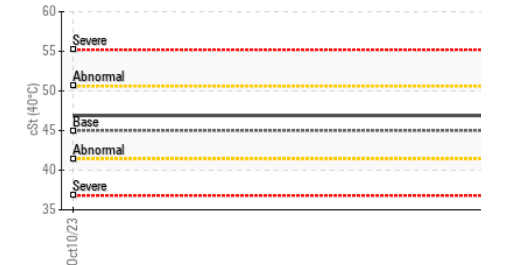

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	<b>46.9</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color		no image	no image
Bottom		no image	no image

## GRAPHS

### Ferrous Alloys

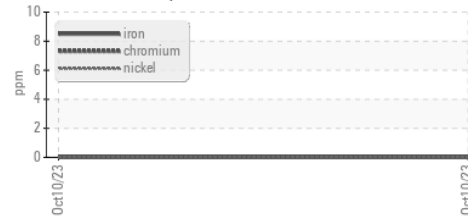


### Non-ferrous Metals

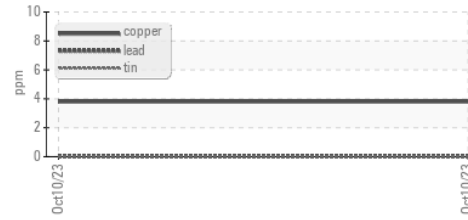

### Viscosity @ 40°C



### ▲ Particle Count

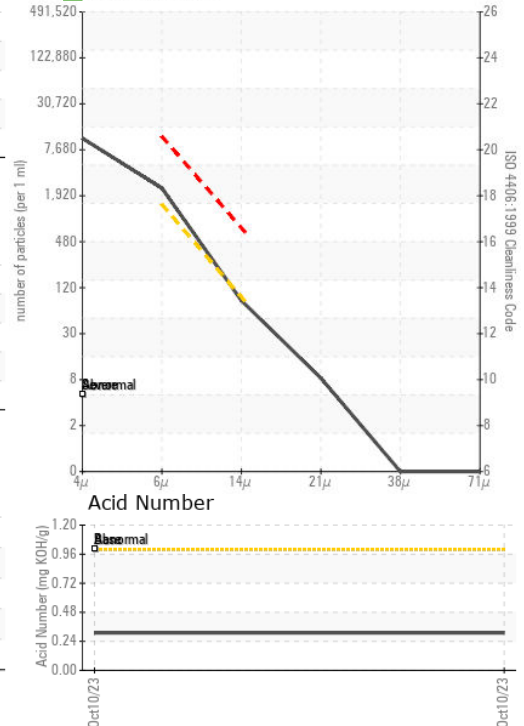

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA007640 **Received** : 30 Jan 2024  
**Lab Number** : 06073983 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10856074 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**ANSUL CHEMICAL**  
 2700 INDUSTRIAL PKWY S  
 MARINETTE, WI  
 US 54143  
 Contact: PRESTON PETMAN  
 PRESTON.PETMAN@FLITEWAY.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: