

OIL ANALYSIS REPORT

Sample Rating Trend



7545919 (S/N 1048)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGN	10 - 10
DIAGIN	

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jan 2023	Jan2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA010397	KCP53125	
Sample Date		Client Info		19 Jan 2024	04 Jan 2023	
Machine Age	hrs	Client Info		4319	1687	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	SEVERE	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	4	2	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	15	41	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	0	0	
Zinc	ppm	ASTM D5185m	0	39	0	
Sulfur	ppm	ASTM D5185m	23500	18857	21414	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	1	
Sodium	ppm	ASTM D5185m		8	5	
Potassium	ppm	ASTM D5185m	>20	5	2	
Water	%	ASTM D6304	>0.05	0.011	△ 0.380	
ppm Water	ppm	ASTM D6304	>500	116	▲ 3800	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1698		
Particles >6µm		ASTM D7647	>1300	621		
Particles >14μm		ASTM D7647	>80	54		
Particles >21μm		ASTM D7647	>20	11		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (ANI)	ma /011/-	ACTM DOOG	1.0	0.27	0.00	

0.37

0.38


Contact/Location: DAVID MEZA - ENVSTO

Acid Number (AN)

mg KOH/g ASTM D8045 1.0



OIL ANALYSIS REPORT

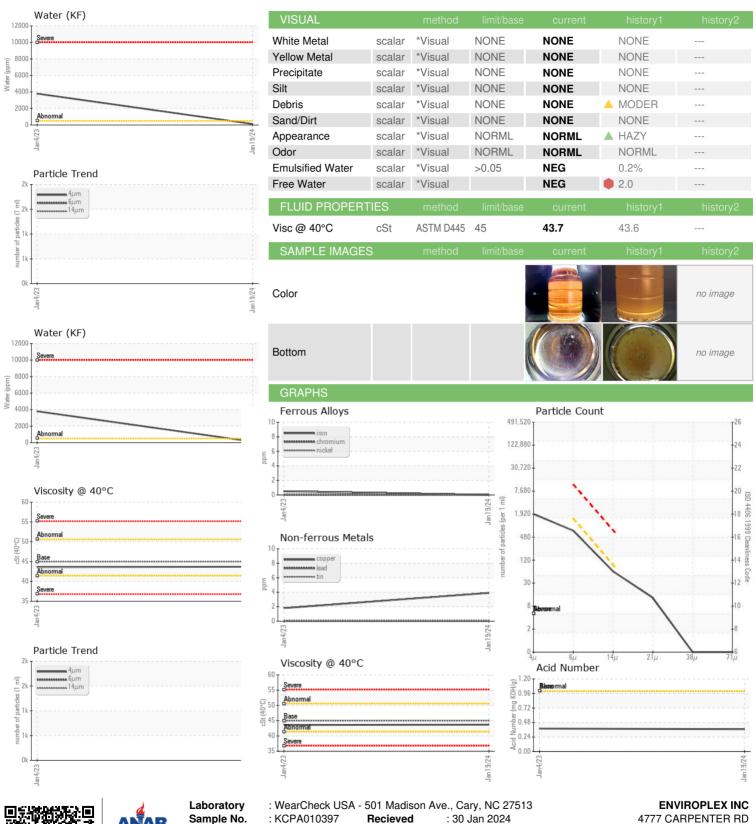



Certificate L2367

Report Id: ENVSTO [WUSCAR] 06073994 (Generated: 02/01/2024 15:36:40) Rev: 1

Sample No. Lab Number **Unique Number**

: 06073994

: KCPA010397 : 10856085

Recieved Diagnosed

: 31 Jan 2024

Diagnostician : Doug Bogart Test Package : IND 2 (Additional Tests: KF, PrtCount)

Contact: DAVID MEZA DAVID.MEZA@ENVIROPLEX.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: DAVID MEZA - ENVSTO

STOCKTON, CA

US 95215

T: F: