




# OIL ANALYSIS REPORT

Sample Rating Trend

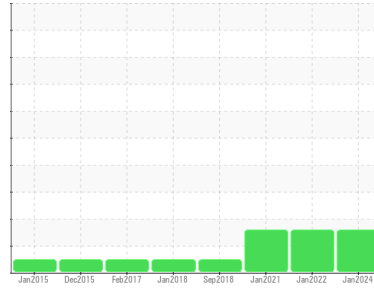

DIRT



Machine Id  
**TRANE FBI ACADEMY ERF 2 (S/N L07H04124)**

Component  
**Refrigeration Compressor**  
Fluid  
**TRANE 0022 (9 GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### ▲ Contamination

Elemental level of silicon (Si) above normal.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0814425</b>	WC0525391	WC0384440
Sample Date	Client Info		<b>15 Jan 2024</b>	18 Jan 2022	07 Jan 2021
Machine Age	hrs	Client Info	<b>23642</b>	20801	19461
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>1</b>	1	<1
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >3	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	4
Copper	ppm	ASTM D5185m >8	<b>1</b>	<1	<1
Tin	ppm	ASTM D5185m >4	<b>3</b>	2	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	0	2
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	<1
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	<1	4
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>▲ 25</b>	▲ 27	▲ 21
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	0
Water	%	ASTM D6304 >0.005	<b>0.004</b>	0.001	0.002
ppm Water	ppm	ASTM D6304 >50	<b>49</b>	1.1	15.7


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.056</b>	0.012	0.016




# OIL ANALYSIS REPORT


▲ Silicon (ppm)

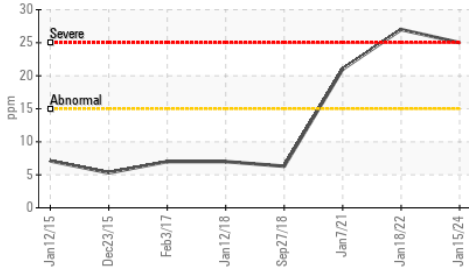


Water (KF)

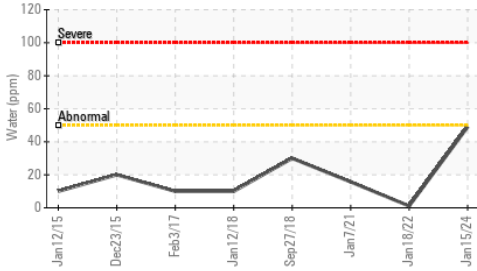

Water (KF)

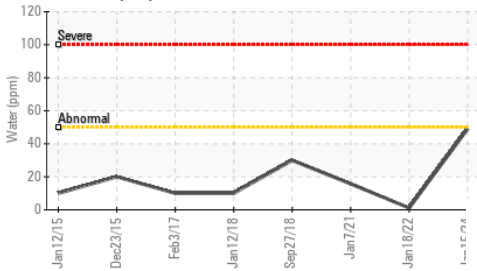


Viscosity @ 40°C

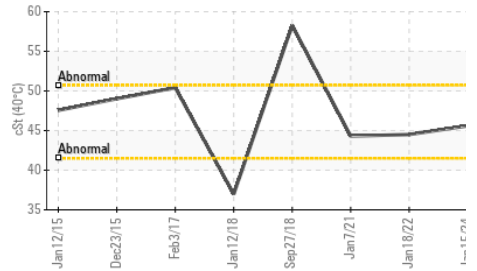





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.005	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.6	44.5	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

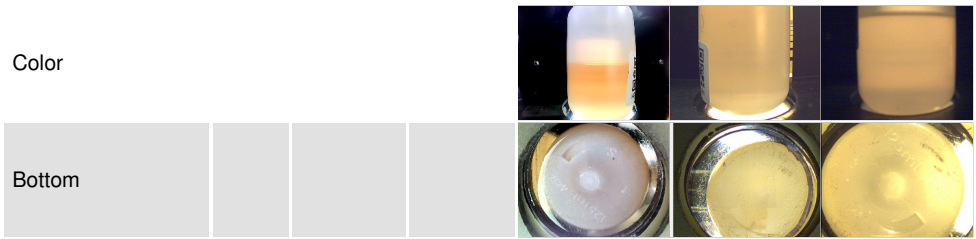

## GRAPHS

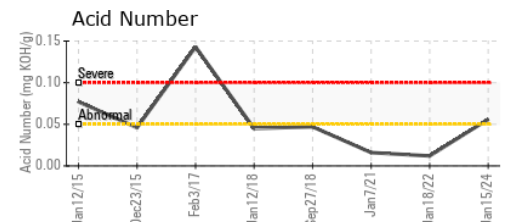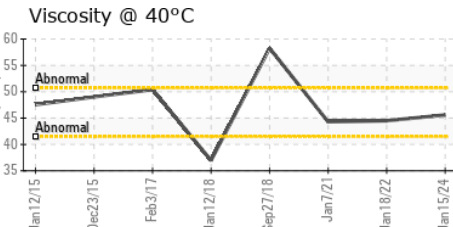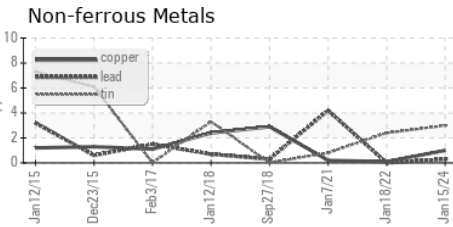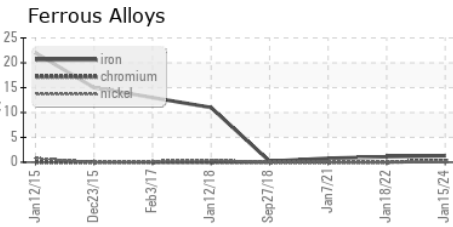

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0814425 **Received** : 30 Jan 2024  
**Lab Number** : 06074121 **Tested** : 31 Jan 2024  
**Unique Number** : 10856212 **Diagnosed** : 31 Jan 2024 - Jonathan Hester  
**Test Package** : IND 2

**DAIKIN APPLIED**  
 5021 HOWERTON WAY SUITE P  
 BOWIE, MD  
 US 20715  
 Contact: ANDREW TURLINGTON  
 andrew.turlington@daikinapplied.com  
 T: (301)735-1440  
 F: (301)735-1838

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)