




FUEL REPORT

Sample Rating Trend

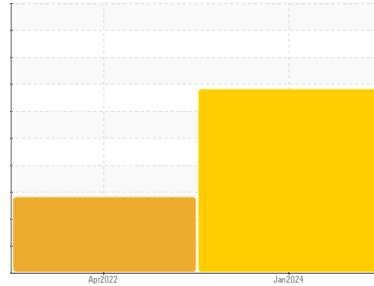

WATER



Machine Id
ELECTR-WINTER-AST 3

Component
Diesel Fuel
Fluid
DIESEL FUEL No. 2 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you follow the water drain-off procedure for this component, and use off-line filtration to improve the cleanliness of the system fluid. We recommend you service and check the fuel filters for mucous-like deposits. Check with fuel supplier for biocides available to destroy the microorganisms in the fuel system. We recommend an early resample to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Corrosion

The iron level is abnormal.

Contaminants

Appearance indicates probable bacterial contamination existed. Excessive free water present. High concentration of visible dirt/debris present in the fuel. There is no bacteria or fungus (yeast and/or mold) present in the sample.

Fuel Condition

The fuel is no longer serviceable due to the presence of contaminants. Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0869461	WC0681823	---
Sample Date	Client Info			24 Jan 2024	18 Apr 2022	---
Machine Age	hrs	Client Info		0	0	---
Sample Status				SEVERE	ABNORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		0.839	0.839	---
Fuel Color	text	*Visual Screen		Red	Red	---
ASTM Color	scalar	*ASTM D1500		L5.0	L4.5	---
Visc @ 40°C	cSt	ASTM D445	4.1	2.46	2.48	---
Pensky-Martens Flash Point	°C	*PMCC Calculated		58	62	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	0	---
Sulfur (UVF)	ppm	ASTM D5453		8	6	---

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		162	165	---
5% Distillation Point	°C	ASTM D86		188	189	---
10% Distill Point	°C	ASTM D86		199	200	---
15% Distillation Point	°C	ASTM D86		209	209	---
20% Distill Point	°C	ASTM D86		217	217	---
30% Distill Point	°C	ASTM D86		231	232	---
40% Distill Point	°C	ASTM D86		246	246	---
50% Distill Point	°C	ASTM D86		260	261	---
60% Distill Point	°C	ASTM D86		275	276	---
70% Distill Point	°C	ASTM D86		289	292	---
80% Distill Point	°C	ASTM D86		305	309	---
85% Distillation Point	°C	ASTM D86		314	318	---
90% Distill Point	°C	ASTM D86		325	329	---
95% Distillation Point	°C	ASTM D86		341	344	---
Final Boiling Point	°C	ASTM D86		351	353	---
Distillation Residue	%	ASTM D86		1.4	1.4	---
Distillation Loss	%	ASTM D86		0.4	0.8	---


IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		37.2	37.2	---
Cetane Index		ASTM D4737	<40.0	48.8	49.0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	0	---
Sodium	ppm	ASTM D5185m	<0.1	<1	<1	---
Potassium	ppm	ASTM D5185m	<0.1	0	0	---
Water	%	ASTM D6304	<0.05	0.009	0.004	---
ppm Water	ppm	ASTM D6304	<500	98	48.3	---
% Gasoline	%	*In-House	<0.50	0.0	0.0	---
% Biodiesel	%	*In-House	<20.0	0.0	2.7	---




FUEL REPORT


▲ Ferrous Alloys

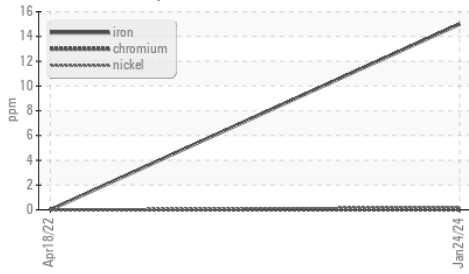

Fuel Distillation Curve

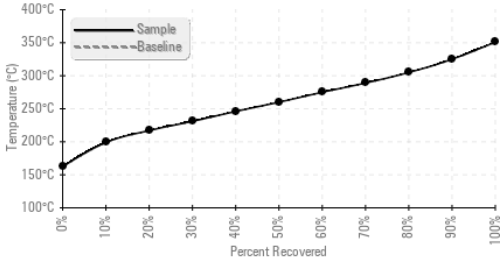

Water (KF)

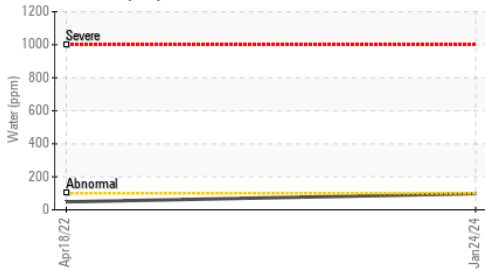

Viscosity @ 40°C



FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	---	▲ 6699	---
Particles >6µm	ASTM D7647	>640	---	▲ 2016	---
Particles >14µm	ASTM D7647	>80	---	▲ 166	---
Particles >21µm	ASTM D7647	>20	---	▲ 27	---
Particles >38µm	ASTM D7647	>4	---	2	---
Particles >71µm	ASTM D7647	>3	---	0	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	---	▲ 20/18/15	---

MICROBIAL	method	limit/base	current	history1	history2
Bacteria	CFU/ml WC-Method	>=100000	0	---	---
Yeast	CFU/ml WC-Method	>=100000	0	---	---
Mold	Colonies WC-Method	MODER	---	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm ASTM D5185m	<0.1	<1	<1	---
Nickel	ppm ASTM D5185m	<0.1	<1	0	---
Lead	ppm ASTM D5185m	<0.1	0	0	---
Vanadium	ppm ASTM D5185m	<0.1	0	0	---
Iron	ppm ASTM D5185m	<0.1	▲ 15	0	---
Calcium	ppm ASTM D5185m	<0.1	<1	0	---
Magnesium	ppm ASTM D5185m	<0.1	<1	0	---
Phosphorus	ppm ASTM D5185m	<0.1	0	0	---
Zinc	ppm ASTM D5185m	<0.1	0	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

no image

no image



Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0869461 **Recieved** : 30 Jan 2024
Lab Number : 06074272 **Diagnosed** : 06 Feb 2024
Unique Number : 10856363 **Diagnostician** : Doug Bogart
Test Package : DF-2 (Additional Tests: BACTERIA, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

VITAL FUEL SYSTEMS
 1076 CLASSIC RD
 APEX, NC
 US 27539

Contact: JOHN MORREALE
 jmorreale@vitalfuelsystems.com

T: (919)629-8180
 F: (919)303-7399