



Machine Id  
**SULLAIR 80017 - QUIKERET**

Component  
**Compressor**  
Fluid  
**QC ULTRA PLUS (--- GAL)**



## DIAGNOSIS

**Recommendation**  
The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
All component wear rates are normal.

**Contamination**  
There is a high amount of particulates present in the oil.

**Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>TO50001863</b>	---	---
Sample Date	Client Info		<b>05 Jan 2024</b>	---	---
Machine Age	hrs	Client Info	<b>28631</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>Not Chngd</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>3</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>38</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>2</b>	---	---
Calcium	ppm	ASTM D5185m	<b>7</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>263</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>52</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	---	---
Sodium	ppm	ASTM D5185m	<b>46</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	---	---
Water	%	ASTM D6304 >0.1	<b>0.063</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>631</b>	---	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 81373</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>▲ 33882</b>	---	---
Particles >14µm	ASTM D7647	>320	<b>▲ 3415</b>	---	---
Particles >21µm	ASTM D7647	>80	<b>▲ 586</b>	---	---
Particles >38µm	ASTM D7647	>20	<b>4</b>	---	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 24/22/19</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.23</b>	---	---

# OIL ANALYSIS REPORT

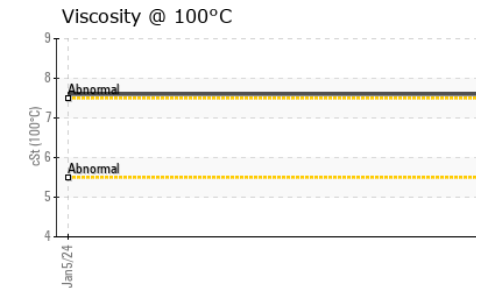
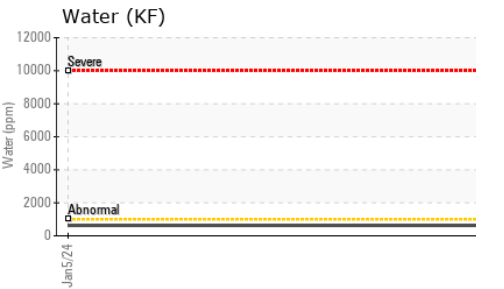
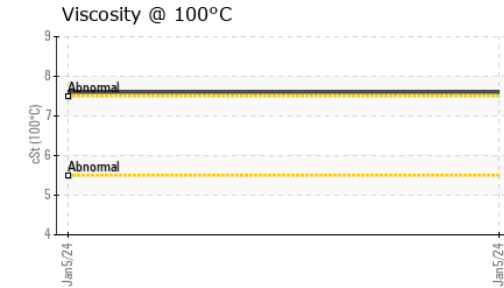
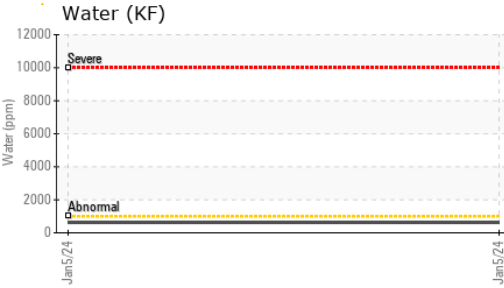
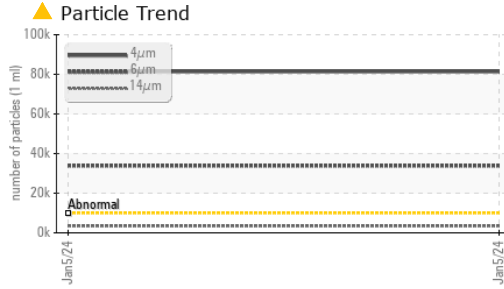


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	51.3	---	---
Visc @ 100°C	cSt	ASTM D445	7.6	---	---
Viscosity Index (VI)	Scale	ASTM D2270	111	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

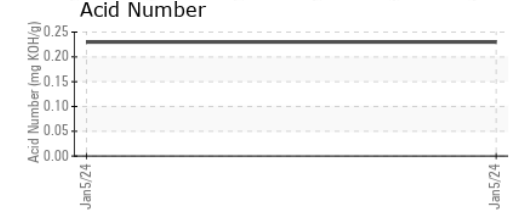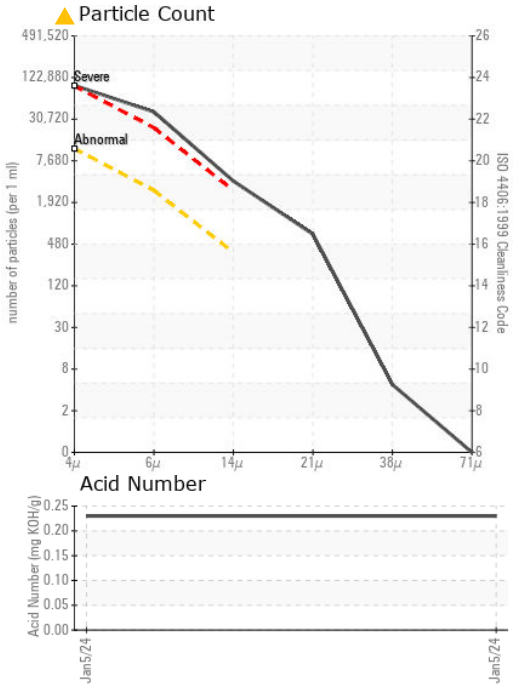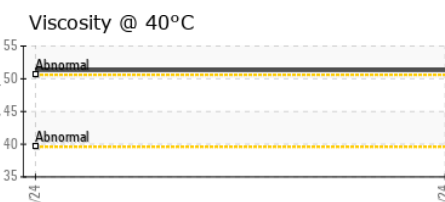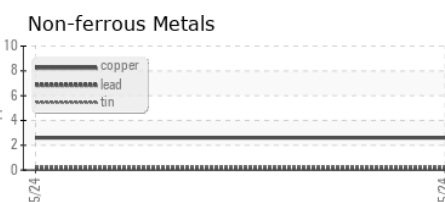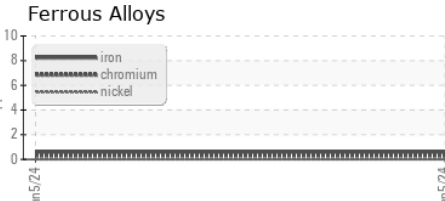

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO50001863 **Recieved** : 30 Jan 2024  
**Lab Number** : 06074689 **Diagnosed** : 01 Feb 2024  
**Unique Number** : 10856780 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )

**QUALITY COMPRESSOR**  
 4428 CR 616  
 ALVARADO, TX  
 US 76009  
 Contact: SEAN  
 SEAN@QCOMPRESSOR.COM  
 T: (817)822-1333  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)