

OIL ANALYSIS REPORT

KAESER SM 10 8377943 (S/N 1079)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Sample Rating Trend ISO

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC111422		
Sample Date		Client Info		03 Jan 2024		
Machine Age	hrs	Client Info		3849		
Oil Age	hrs	Client Info		2309		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	28		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	1		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		3		
CONTAMINANTS	,	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	0	0		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.009		
ppm Water	ppm	ASTM D6304	>500	96		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		35359		
Particles >6µm		ASTM D7647	>1300	16970		
Particles >14µm		ASTM D7647	>80	3371		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	<u>^</u> 71		
Particles >71µm		ASTM D7647	>3	<u> </u>		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/19</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.27		



OIL ANALYSIS REPORT

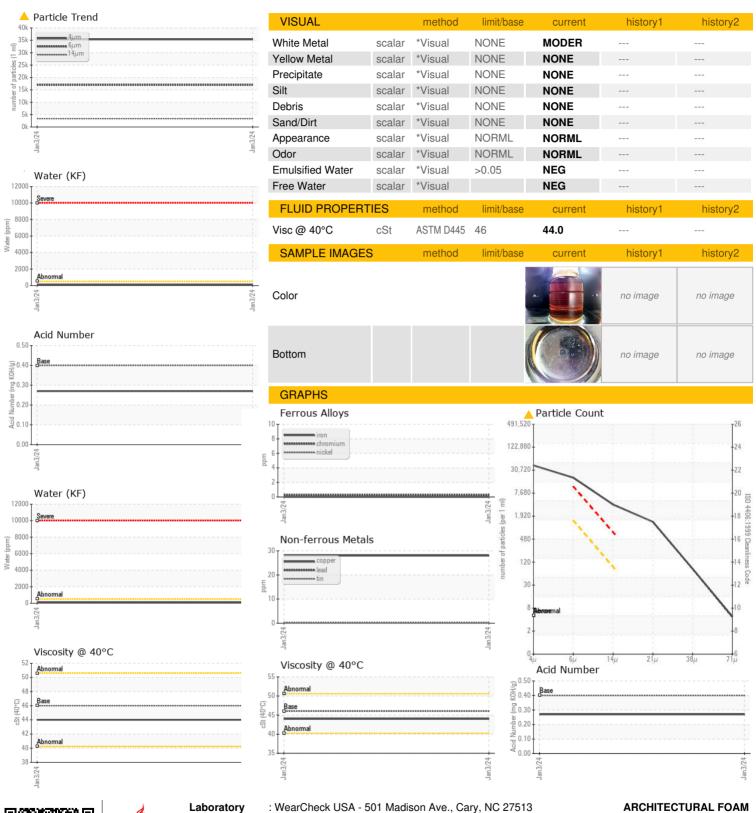



ANAB ACCREDITED TESTING LABORATORY

Certificate L2367

Laboratory Sample No. Lab Number Unique Number

Test Package

: WearCheck : KC111422 : 06074740 : 10856831

Programme Progra

eved : 30 Jan 2024 nosed : 31 Jan 2024 nostician : Doug Bogart

2024 ogart

POMPANO BEACH, FL US 33064

680 NE 42ND ST

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: