

OIL ANALYSIS REPORT

Sample Rating Trend

ISO



8450699 (S/N 1911) Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2024		
SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC105835		
Sample Date		Client Info		10 Jan 2024		
Machine Age	hrs	Client Info		853		
Oil Age	hrs	Client Info		854		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	12		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
	ppm	ASTM D5185m	90	35		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		0		
	ppm	ASTM D5185m		6		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		4		
Potassium	ppm	ASTM D5185m	>20	18		
Water	%	ASTM D6304	>0.05	0.020		
	ppm	ASTM D6304	>500	205		
FLUID CLEANLINE	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		24190		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14μm		ASTM D7647	>80	1166		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38μm		ASTM D7647	>4	3		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/17</u>		
FLUID DEGRADAT	TION	method	limit/base	current	history1	history2
A sid Nivershau (AAI)	I/OII/-	ACTM DOG45	0.4	0.05		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.25



OIL ANALYSIS REPORT

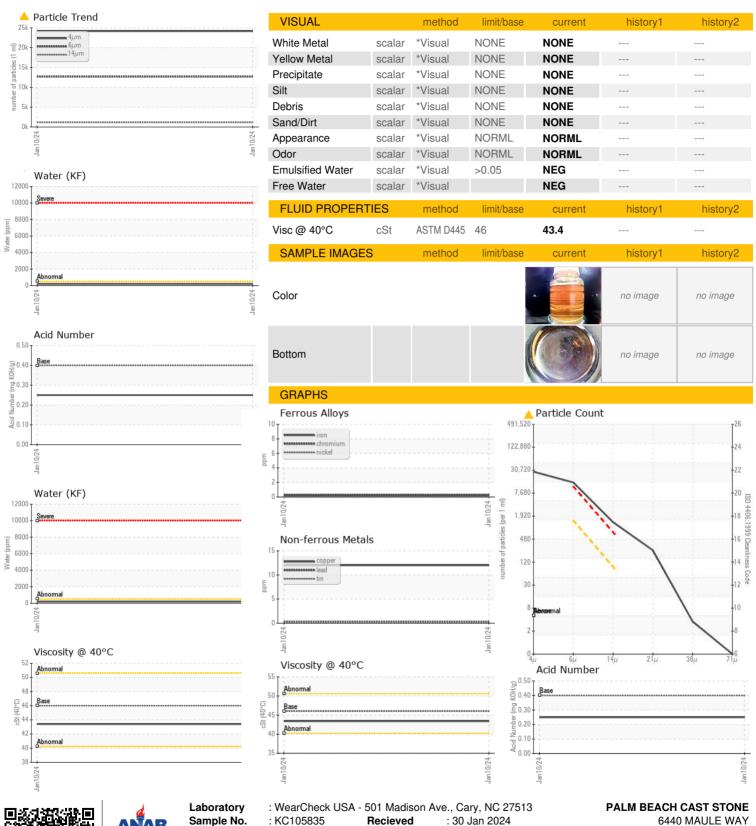



Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

. 06074741

: KC105835 : 10856832 : IND 2

: 30 Jan 2024 Recieved Diagnosed : 31 Jan 2024 Diagnostician

: Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

WEST PALM BEACH, FL

US 33405

F: