


OIL ANALYSIS REPORT

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

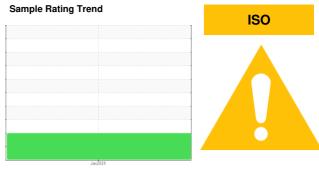

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2024		
SAMPLE INFORT	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC105735		
Sample Date		Client Info		12 Jan 2024		
Machine Age	hrs	Client Info		2746		
Oil Age	hrs	Client Info		2746		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
_ead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	7		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	50		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	10		
Water	%	ASTM D6304	>0.05	0.019		
opm Water	ppm	ASTM D6304	>500	193		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		78876		
Particles >6µm		ASTM D7647	>1300	<u>46449</u>		
Particles >14µm		ASTM D7647	>80	5217		
Particles >21µm		ASTM D7647	>20	<u>4</u> 942		
Particles >38µm		ASTM D7647	>4	<u> </u>		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	23/23/20		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.33		



OIL ANALYSIS REPORT

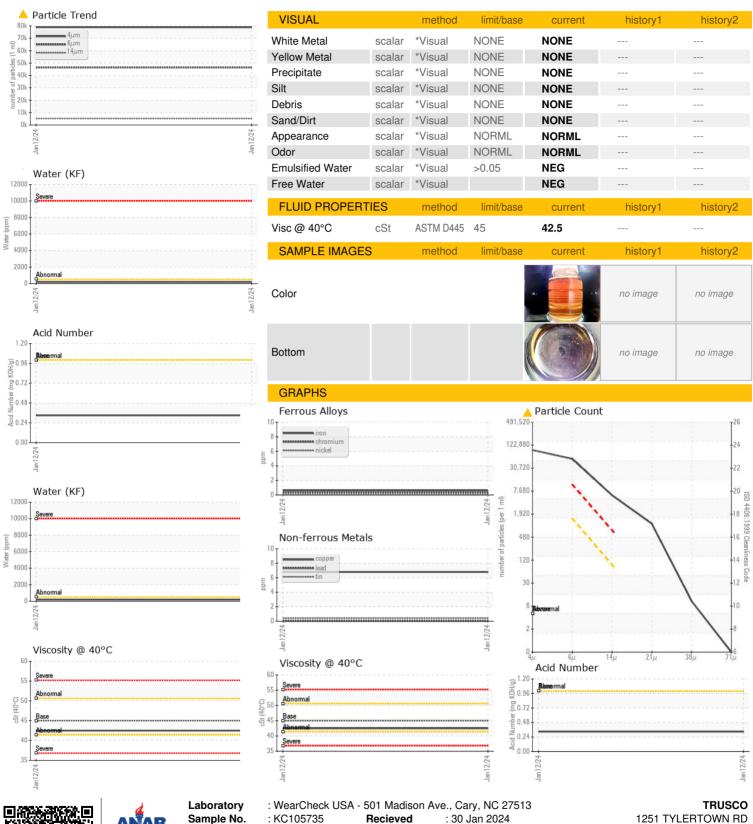



Certificate L2367

Sample No. Lab Number Unique Number

Test Package

: 06074743

: KC105735 : 10856834 : IND 2

Diagnosed Diagnostician

: 31 Jan 2024 : Doug Bogart

CLARKSVILLE, TN US 37040 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: