




# OIL ANALYSIS REPORT

Sample Rating Trend

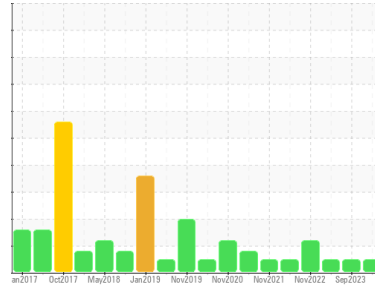

Machine Id  
**KAESER SK 15T 5670791 (S/N 1705)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA008901</b>	KCPA006370	KCPA003056
Sample Date	Client Info			<b>10 Jan 2024</b>	20 Sep 2023	23 May 2023
Machine Age	hrs	Client Info		<b>34251</b>	32883	31063
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>8</b>	5	8
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>6</b>	13	2
Calcium	ppm	ASTM D5185m	2	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	1	<1
Zinc	ppm	ASTM D5185m		<b>17</b>	41	9
Sulfur	ppm	ASTM D5185m		<b>19273</b>	15912	20136

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	6	0
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	<1
Water	%	ASTM D6304	>0.05	<b>0.007</b>	0.009	0.005
ppm Water	ppm	ASTM D6304	>500	<b>77</b>	95.0	55.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5141</b>	3550	1736
Particles >6µm		ASTM D7647	>1300	<b>1154</b>	850	596
Particles >14µm		ASTM D7647	>80	<b>73</b>	60	40
Particles >21µm		ASTM D7647	>20	<b>18</b>	13	6
Particles >38µm		ASTM D7647	>4	<b>1</b>	1	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/17/13</b>	19/17/13	18/16/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.31</b>	0.33	0.33


# OIL ANALYSIS REPORT

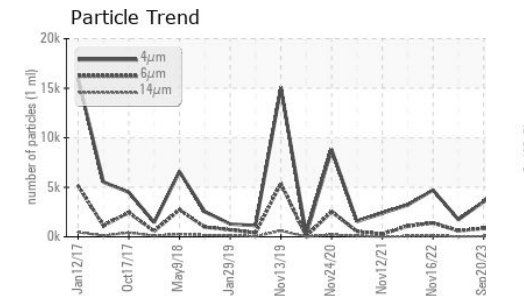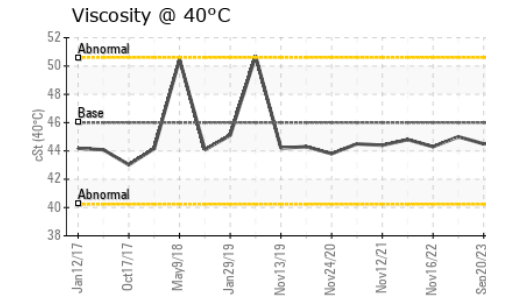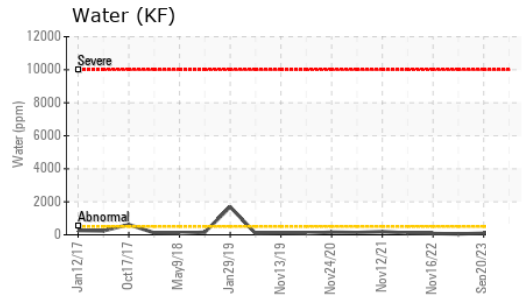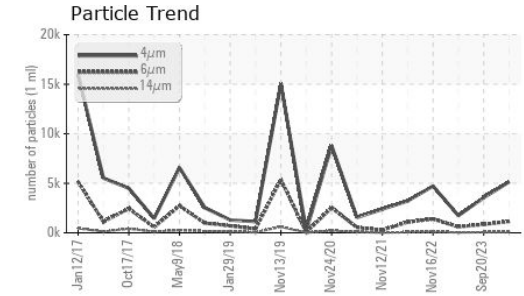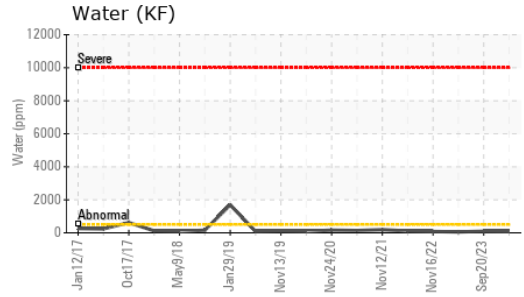






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.6	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

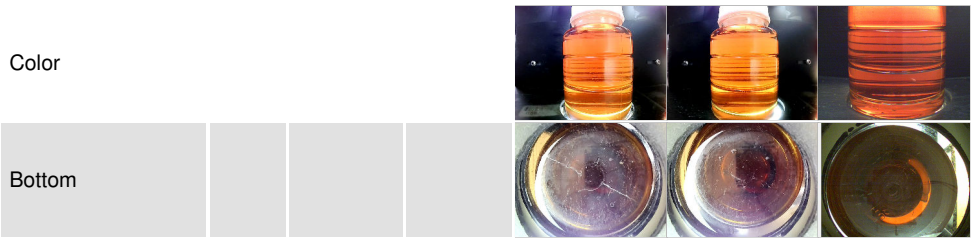

## GRAPHS

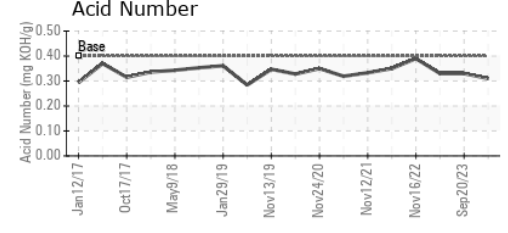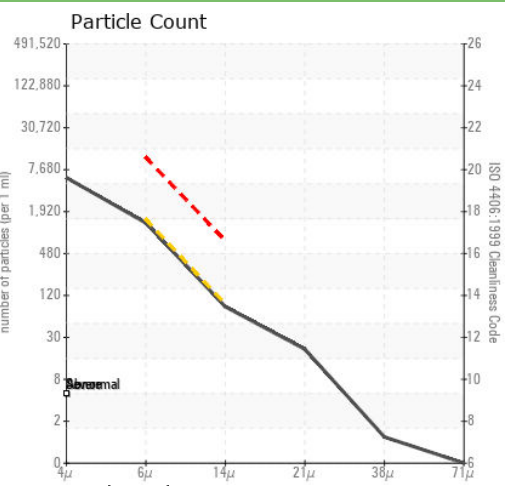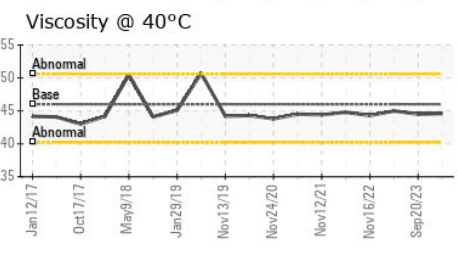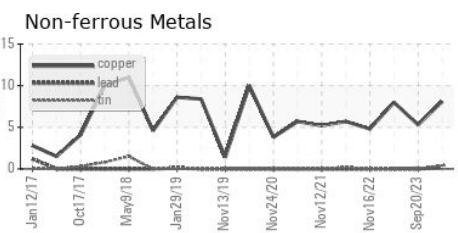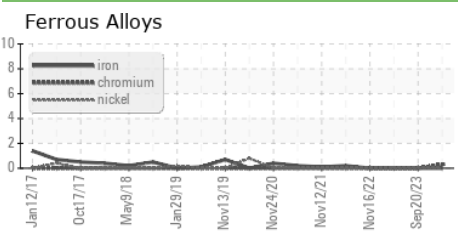

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA008901 **Received** : 30 Jan 2024  
**Lab Number** : 06074751 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10856842 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**OXMOOR COLLISION**  
 11505 ELECTRON DR  
 LOUISVILLE, KY  
 US 40299  
 Contact: J. MIDDLETON

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)