




OIL ANALYSIS REPORT

Sample Rating Trend

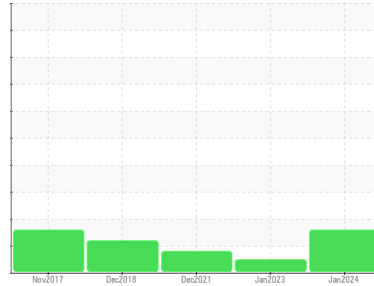

ISO



Machine Id
KAESER SM 15 5268834 (S/N 1418)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA009225	KCP52178	KCP43322
Sample Date	Client Info			10 Jan 2024	17 Jan 2023	09 Dec 2021
Machine Age	hrs	Client Info		11432	10200	8740
Oil Age	hrs	Client Info		0	1460	1214
Oil Changed	Client Info			N/A	Changed	Not Changd
Sample Status				ABNORMAL	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	2	1	5
Lead	ppm	ASTM D5185m	>10	<1	<1	<1
Copper	ppm	ASTM D5185m	>50	2	2	<1
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	25	27	53
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	84	92	92
Calcium	ppm	ASTM D5185m	0	3	3	4
Phosphorus	ppm	ASTM D5185m	0	0	9	10
Zinc	ppm	ASTM D5185m	0	0	7	0
Sulfur	ppm	ASTM D5185m	23500	20894	21108	20141

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	2
Sodium	ppm	ASTM D5185m		13	20	13
Potassium	ppm	ASTM D5185m	>20	4	2	1
Water	%	ASTM D6304	>0.05	0.016	0.013	0.024
ppm Water	ppm	ASTM D6304	>500	166	132.2	247.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8110	2131	4265
Particles >6µm		ASTM D7647	>1300	▲ 2085	800	1109
Particles >14µm		ASTM D7647	>80	▲ 193	69	▲ 88
Particles >21µm		ASTM D7647	>20	▲ 40	21	▲ 21
Particles >38µm		ASTM D7647	>4	1	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/15	18/17/13	▲ 17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.31	0.33	0.339


OIL ANALYSIS REPORT

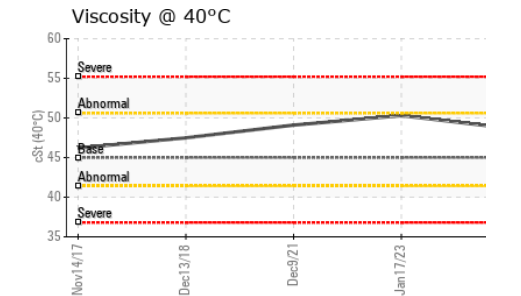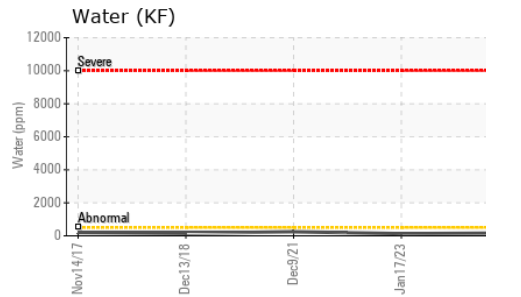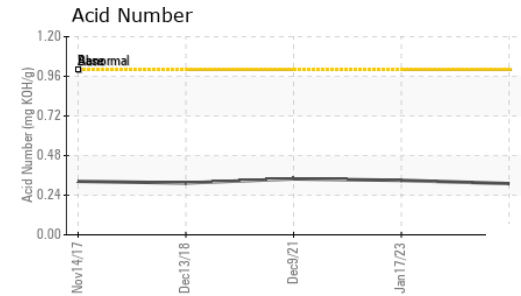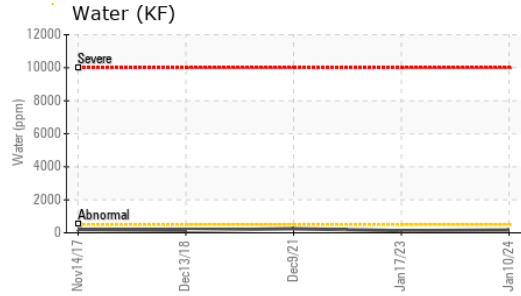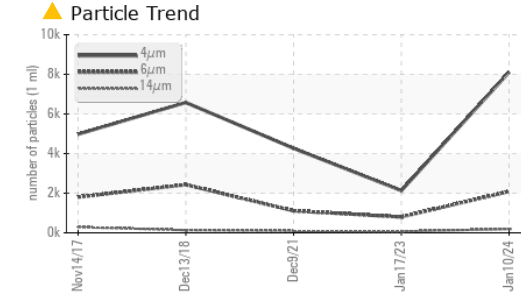





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.7	50.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

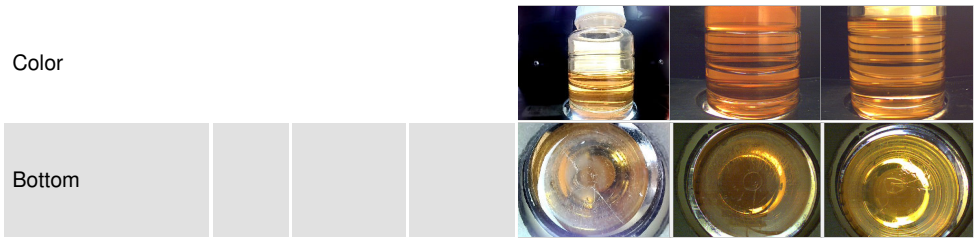

GRAPHS

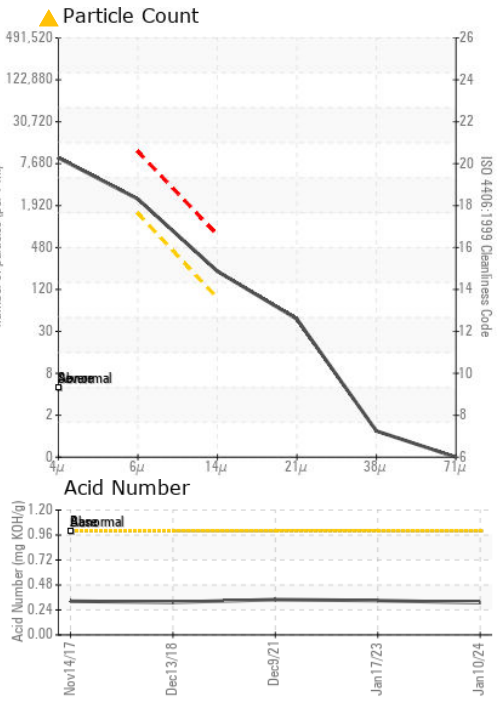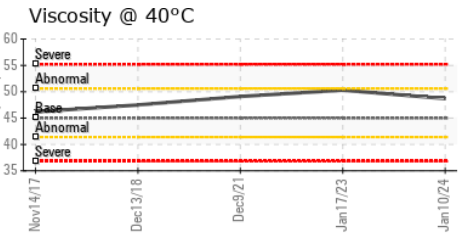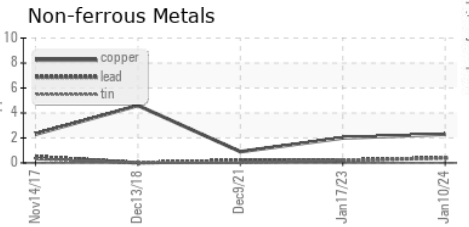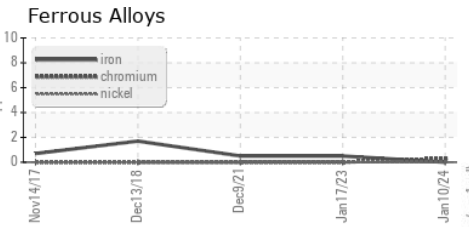

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA009225 **Received** : 30 Jan 2024
Lab Number : 06074757 **Diagnosed** : 31 Jan 2024
Unique Number : 10856848 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

TARRY MEDICAL PRODUCTS
 25 SHELTER ROCK LN
 DANBURY, CT
 US 06810
 Contact: JOHN VENA
 john.vena@tarrymfg.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)