KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

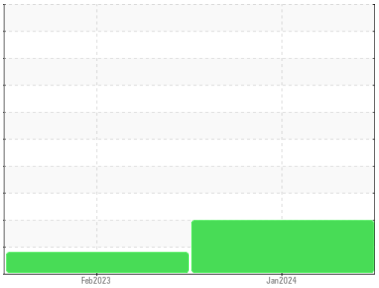

WATER

Machine Id
8085364 (S/N 1058)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles and water present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

Light concentration of visible dirt/debris present in the oil. There is a moderate concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KC122741**	KC97345	---
Sample Date		Client Info		**24 Jan 2024**	03 Feb 2023	---
Machine Age	hrs	Client Info		**4533**	2186	---
Oil Age	hrs	Client Info		**0**	2186	---
Oil Changed		Client Info		**N/A**	Changed	---
Sample Status				**ABNORMAL**	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**<1**	<1	---
Chromium	ppm	ASTM D5185m	>10	**<1**	0	---
Nickel	ppm	ASTM D5185m	>3	**0**	0	---
Titanium	ppm	ASTM D5185m	>3	**<1**	0	---
Silver	ppm	ASTM D5185m	>2	**0**	0	---
Aluminum	ppm	ASTM D5185m	>10	**2**	0	---
Lead	ppm	ASTM D5185m	>10	**<1**	<1	---
Copper	ppm	ASTM D5185m	>50	**2**	1	---
Tin	ppm	ASTM D5185m	>10	**<1**	0	---
Vanadium	ppm	ASTM D5185m		**0**	0	---
Cadmium	ppm	ASTM D5185m		**0**	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	---
Barium	ppm	ASTM D5185m	90	**0**	0	---
Molybdenum	ppm	ASTM D5185m		**<1**	0	---
Manganese	ppm	ASTM D5185m		**0**	<1	---
Magnesium	ppm	ASTM D5185m	90	**34**	59	---
Calcium	ppm	ASTM D5185m	2	**1**	<1	---
Phosphorus	ppm	ASTM D5185m		**0**	5	---
Zinc	ppm	ASTM D5185m		**2**	10	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	0	---
Sodium	ppm	ASTM D5185m		**3**	11	---
Potassium	ppm	ASTM D5185m	>20	**6**	17	---
Water	%	ASTM D6304	>0.05	▲ **0.423**	0.020	---
ppm Water	ppm	ASTM D6304	>500	▲ **4230**	205.1	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**---**	4492	---
Particles >6µm		ASTM D7647	>1300	**---**	▲ 1370	---
Particles >14µm		ASTM D7647	>80	**---**	77	---
Particles >21µm		ASTM D7647	>20	**---**	13	---
Particles >38µm		ASTM D7647	>4	**---**	0	---
Particles >71µm		ASTM D7647	>3	**---**	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	**---**	▲ 19/18/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.34**	0.35	---

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Water (KF)

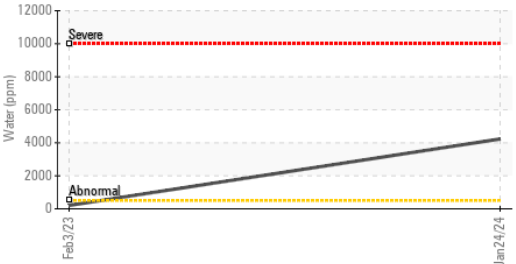

Acid Number

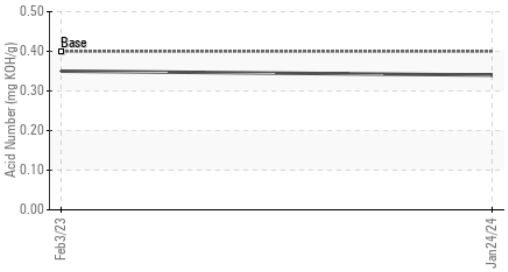

Viscosity @ 40°C

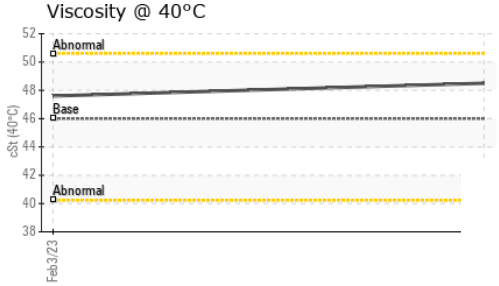

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**MODER**	NONE	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	---
Silt	scalar	*Visual	NONE	**NONE**	NONE	---
Debris	scalar	*Visual	NONE	▲ **LIGHT**	VLITE	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	---
Appearance	scalar	*Visual	NORML	**NORML**	NORML	---
Odor	scalar	*Visual	NORML	**NORML**	NORML	---
Emulsified Water	scalar	*Visual	>0.05	**0.2%**	NEG	---
Free Water	scalar	*Visual		**NEG**	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	**48.5**	47.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					*no image*
Bottom					*no image*

GRAPHS

Ferrous Alloys

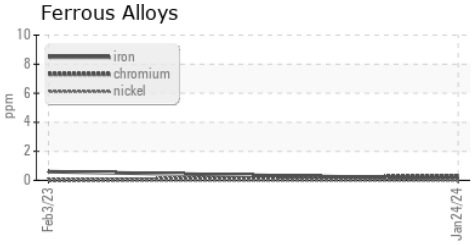

Non-ferrous Metals

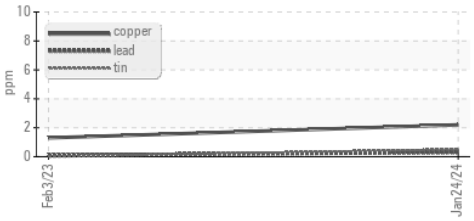

Viscosity @ 40°C

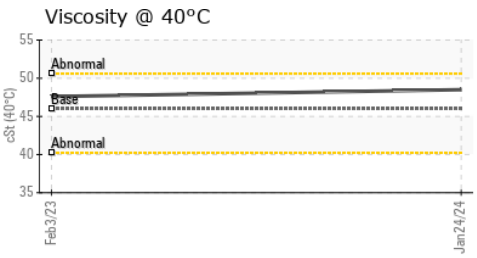

Acid Number

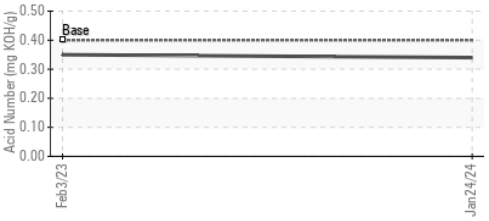

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC122741 **Recieved** : 30 Jan 2024
Lab Number : 06074770 **Diagnosed** : 31 Jan 2024
Unique Number : 10856861 **Diagnostician** : Doug Bogart
Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

COMMUNICATION & POWER
368 DECIBEL RD
STATE COLLEGE, PA
US 16801
Contact: Service Manager
T:
F: