

# **OIL ANALYSIS REPORT**

Γ )

Sample Rating Trend

ISO



# 8707111 (S/N 1393)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jan2024			
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06074773		
Sample Date		Client Info		09 Jan 2024		
Machine Age	hrs	Client Info		2516		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	5		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	6		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	61		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS	i	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		12		
Potassium	ppm	ASTM D5185m	>20	9		
Water	%	ASTM D6304	>0.05	0.024		
ppm Water	ppm	ASTM D6304	>500	243		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		8463		
Particles >6µm		ASTM D7647	>1300	<u>▲</u> 3275		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u></u> ▲ 31		
Particles >38μm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>20/19/15</u>		

limit/base

current

0.29

method

mg KOH/g ASTM D8045 0.4

**FLUID DEGRADATION** 


Acid Number (AN)

history1

history2



## **OIL ANALYSIS REPORT**

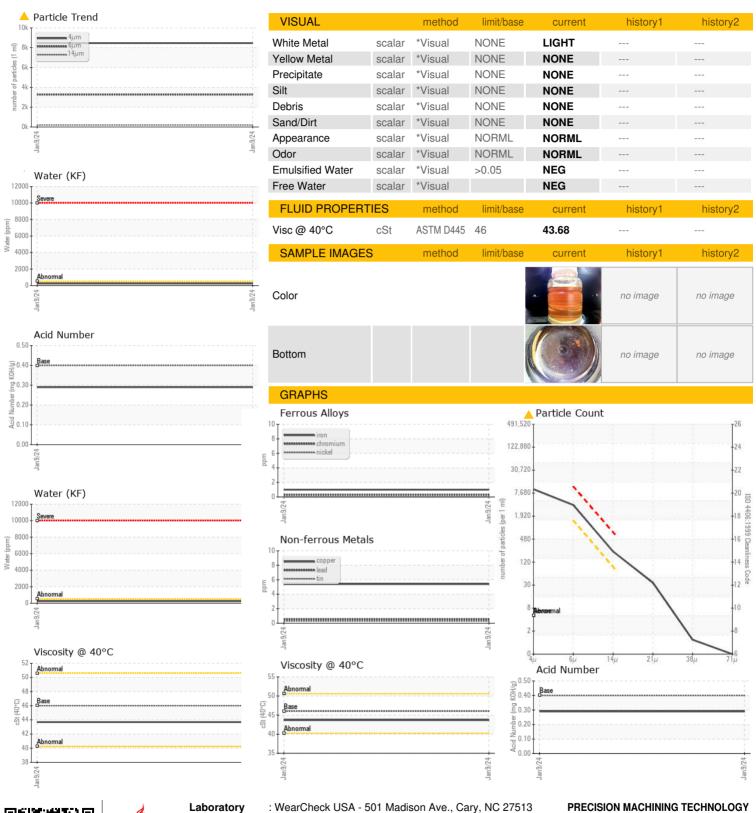





Laboratory Sample No. Lab Number **Unique Number** 

: 06074773

: KC06074773 : 10856864

: 30 Jan 2024 Recieved Diagnosed : 01 Feb 2024 Diagnostician

: Jonathan Hester

Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 4083 NW 79TH AVE MIAMI, FL US 33166

Contact: W. REIMANN wreimann@97pmt.com

T: F: