




# OIL ANALYSIS REPORT

Sample Rating Trend

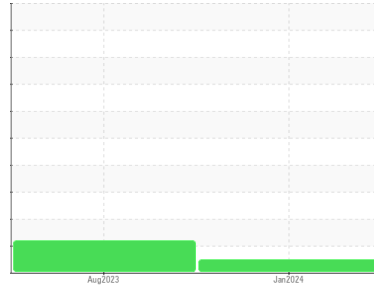

**NORMAL**



Machine Id  
**KAESER SK 15T 8622620 (S/N 1495)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC06074776</b>	KC05947263	---
Sample Date	Client Info		<b>05 Jan 2024</b>	21 Aug 2023	---
Machine Age	hrs	Client Info	<b>7752</b>	4626	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>NORMAL</b>	ATTENTION	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	<1	---
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>13</b>	18	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m 90	<b>15</b>	4	---
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	---
Zinc	ppm	ASTM D5185m	<b>16</b>	3	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>5</b>	3	---
Potassium	ppm	ASTM D5185m >20	<b>4</b>	3	---
Water	%	ASTM D6304 >0.05	<b>0.014</b>	0.007	---
ppm Water	ppm	ASTM D6304 >500	<b>143</b>	79.1	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2137</b>	3612	---
Particles >6µm	ASTM D7647 >1300		<b>519</b>	▲ 1777	---
Particles >14µm	ASTM D7647 >80		<b>19</b>	▲ 90	---
Particles >21µm	ASTM D7647 >20		<b>3</b>	11	---
Particles >38µm	ASTM D7647 >4		<b>0</b>	0	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>18/16/11</b>	▲ 19/18/14	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.25</b>	0.25	---


# OIL ANALYSIS REPORT

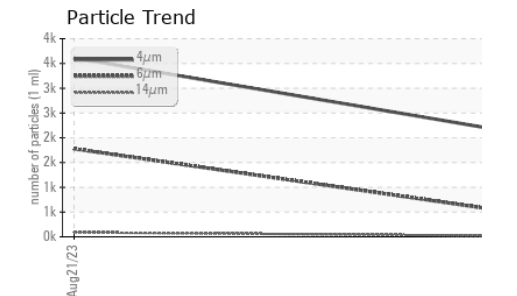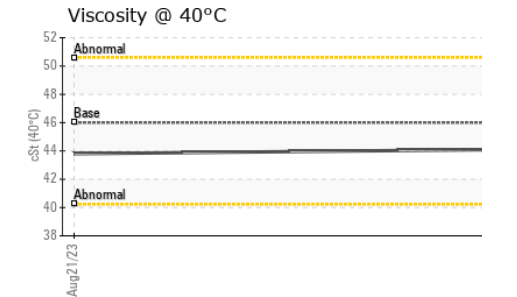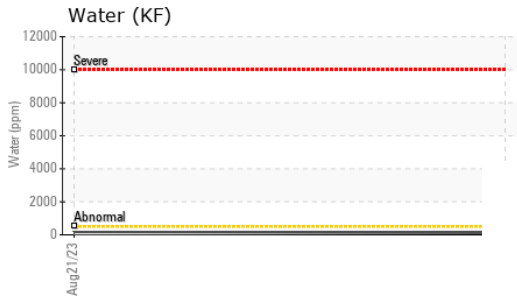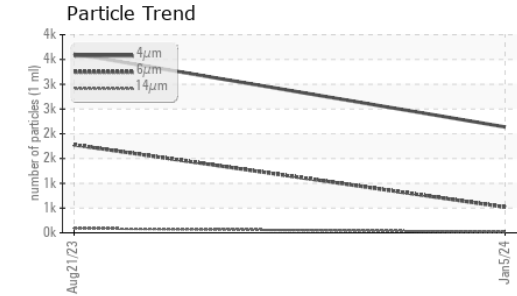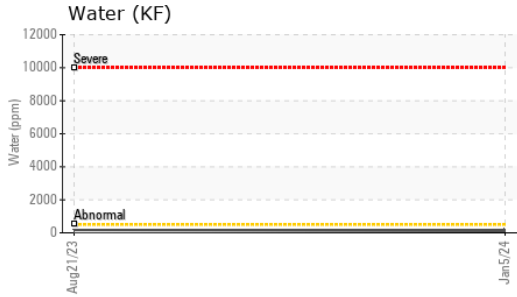






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>44.1</b>	43.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

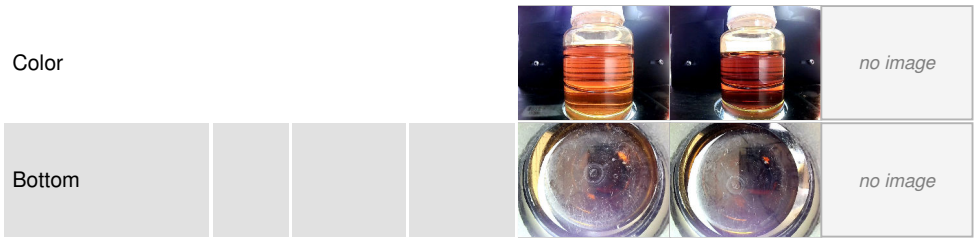

## GRAPHS

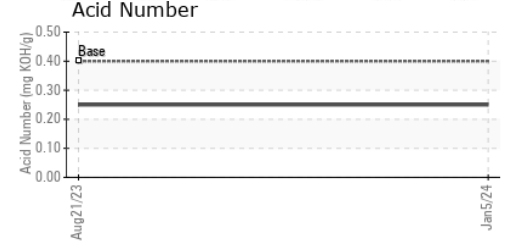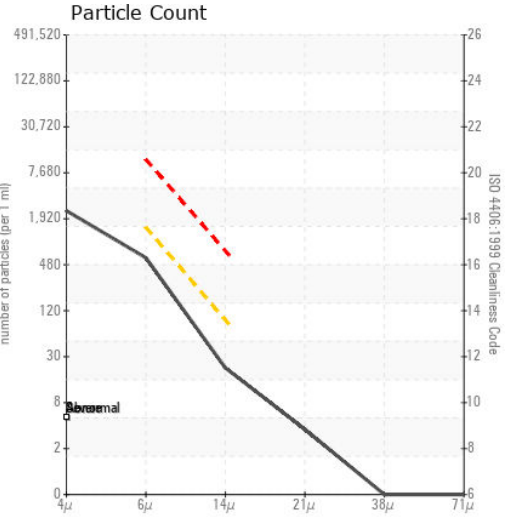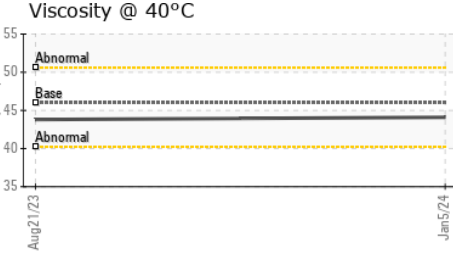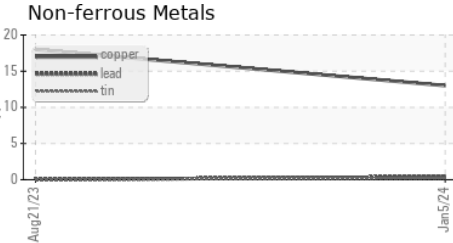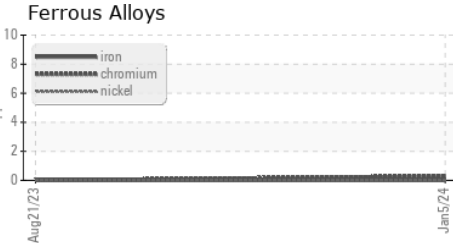

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06074776 **Received** : 30 Jan 2024  
**Lab Number** : 06074776 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10856867 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**FLORIDA COCA COLA BOTTLING CO.**  
 3350 PEMBROKE ROAD  
 HOLLYWOOD, FL  
 US 33021  
 Contact: C. CASAS  
 cccasas@cocacolaflorida.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)