


OIL ANALYSIS REPORT

ULTRA COOLANT Machine Id INGERSOLL RAND CBV183071 - EMJ

Component

Compressor



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06074864		
Sample Date		Client Info		23 Jan 2024		
Machine Age	hrs	Client Info		41907		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	7		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	5		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	556	510		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		4		
Calcium	ppm	ASTM D5185m	242	5		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	147		
Sulfur	ppm	ASTM D5185m	306	336		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		40		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.2	0.41		



OIL ANALYSIS REPORT

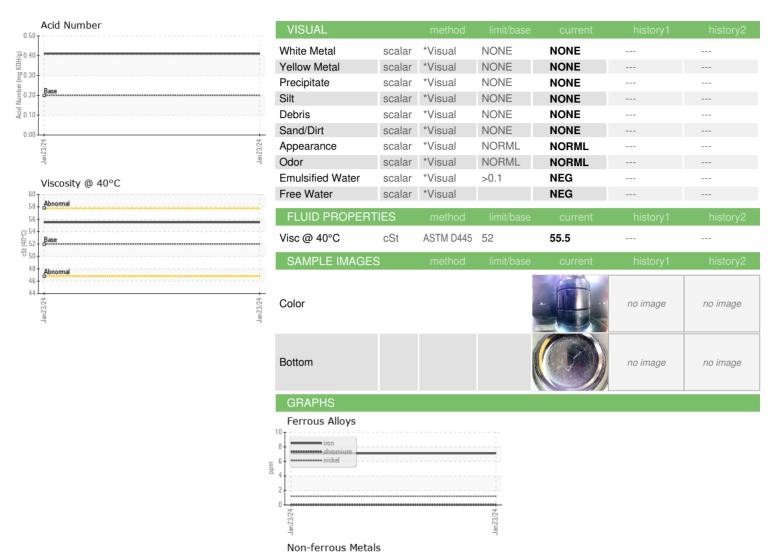









Certificate L2367

Laboratory Sample No. Lab Number Unique Number Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06074864 : 06074864 : 10856955

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Recieved Diagnosed

: 30 Jan 2024 : 01 Feb 2024 : Don Baldridge Diagnostician

JOHN HENRY FOSTER COMPANY

4700 LEBOURGET STREET SAINT LOUIS, MO US 63134

Contact: RACHEL VON HATTEN

rvonhatten@jhf.com T: (314)593-1267 F: (314)874-0965

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)