




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

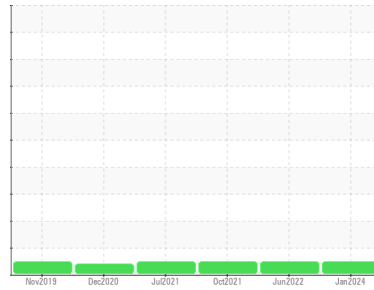

Area  
**SYNOIL 8K FG**  
 Machine Id  
**QUINCY QSI245 99896H - TNT CRUST**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCZ06074899</b>	UCZ05567652	UCZ05380200
Sample Date	Client Info			<b>23 Jan 2024</b>	02 Jun 2022	14 Oct 2021
Machine Age	hrs	Client Info		<b>140274</b>	134771	133425
Oil Age	hrs	Client Info		<b>1718</b>	3885	2539
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>65	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>65	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	2
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m	0.5	<b>&lt;1</b>	<1	2
Phosphorus	ppm	ASTM D5185m	536	<b>233</b>	305	218
Zinc	ppm	ASTM D5185m	0.2	<b>38</b>	29	21
Sulfur	ppm	ASTM D5185m	649	<b>980</b>	530	495

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<b>4</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>2</b>	2	2
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.337	<b>0.20</b>	0.38	0.381




# OIL ANALYSIS REPORT

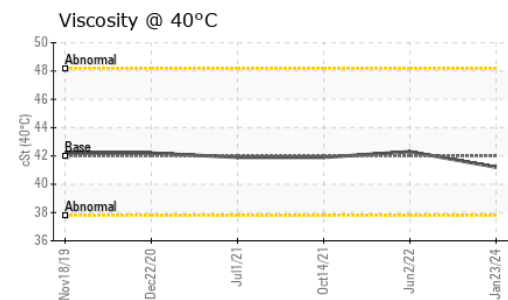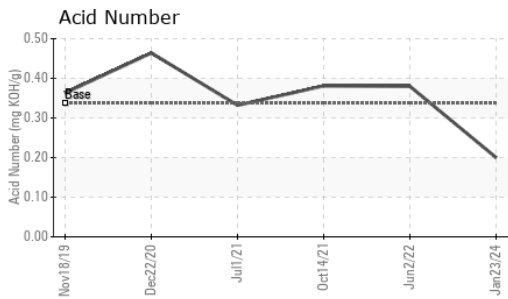





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	42.0	<b>41.2</b>	42.3	41.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

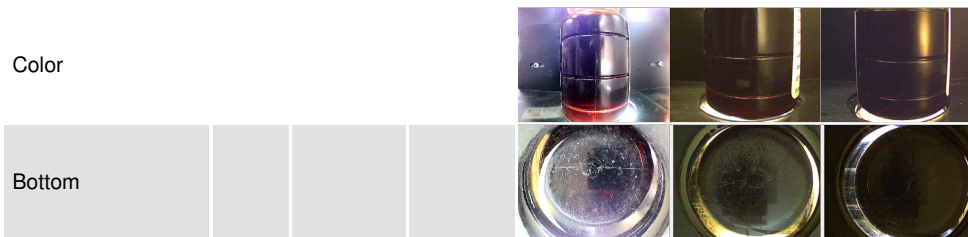

## GRAPHS

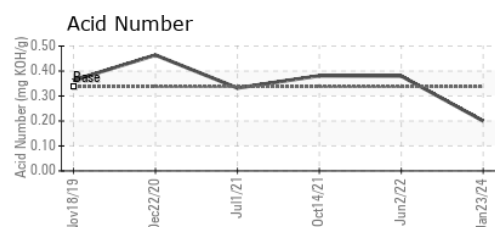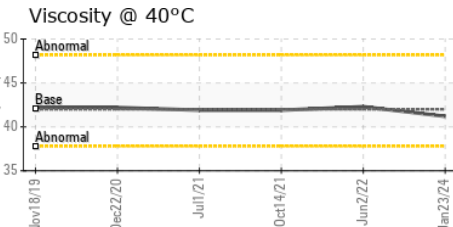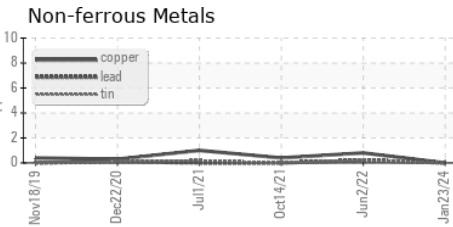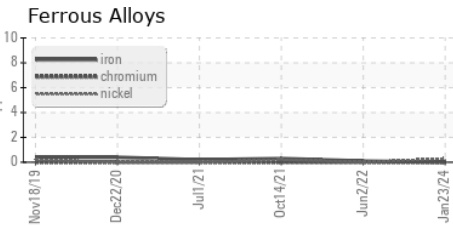

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ06074899 **Recieved** : 30 Jan 2024  
**Lab Number** : **06074899** **Diagnosed** : 01 Feb 2024  
**Unique Number** : 10856990 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ZORN COMP & EQUIPMENT CO (GB)**  
 733 POTTS AVE  
 GREEN BAY, WI  
 US 54304  
 Contact: DEAN SCHAD  
 dean.schad@zornair.com  
 T: (920)391-8121  
 F: (920)499-1168

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)