


# **OIL ANALYSIS REPORT**

Sample Rating Trend







# CS1709A-2

Component

**Roller Bearing** 

**ROYAL PURPLE SYNFILM 68 (--- GAL)** 

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0840356		
Sample Date		Client Info		16 Jan 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>2	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	<1		
Lead	ppm	ASTM D5185m	>20	2		
Copper	ppm	ASTM D5185m	>20	0		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	43		
Calcium	ppm	ASTM D5185m		3		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		12		
Sulfur	ppm	ASTM D5185m		18344		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		28		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	TION_	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	0.35		



## **OIL ANALYSIS REPORT**

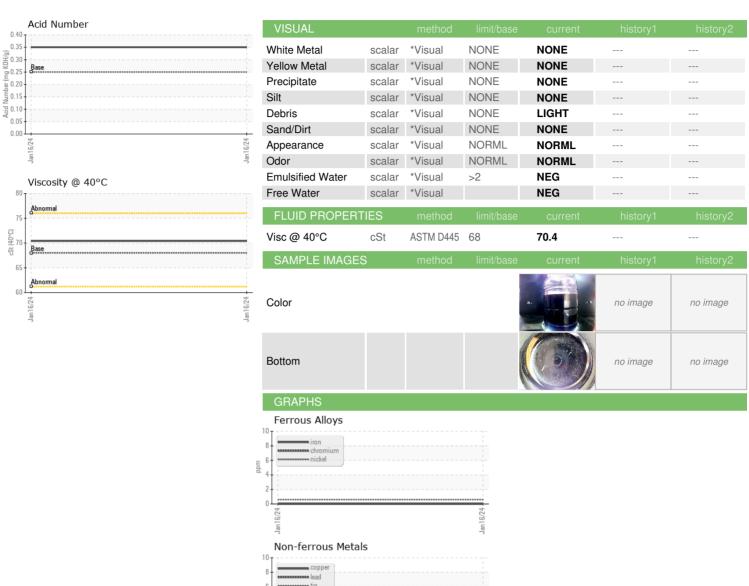





Certificate L2367

Laboratory Sample No. Lab Number Unique Number

Test Package : IND 2

: WC0840356 : 06074943 : 10857034

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Recieved Diagnosed

: 30 Jan 2024 : 01 Feb 2024 : Don Baldridge Diagnostician

TORAY CARBON FIBERS AMERICA INC

Acid Number

(mg KOH/g)

2202 MOORE DUNCAN HWY MOORE, SC US 29369

> Contact: Kirk Stilling Kirk.stiling@toraycma.com

T: F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Viscosity @ 40°C