




OIL ANALYSIS REPORT

Sample Rating Trend

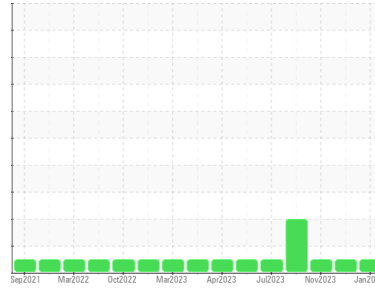

NORMAL



Area
[CONHER]
 Machine Id
PERKINS Pacifico Ind PISA1 Aux2
 Component
Auxiliary Engine
 Fluid
CHEVRON DELO 400 MULTIGRADE 15W40 (20 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KL0013464	KL0013445	KL0013385
Sample Date	Client Info		23 Jan 2024	21 Dec 2023	17 Nov 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	8	23	5
Chromium	ppm	ASTM D5185m >20	<1	<1	0
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m >2	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >20	2	2	3
Lead	ppm	ASTM D5185m >40	0	3	0
Copper	ppm	ASTM D5185m >330	8	17	7
Tin	ppm	ASTM D5185m >15	0	1	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 151	315	220	284
Barium	ppm	ASTM D5185m 0.4	1	0	0
Molybdenum	ppm	ASTM D5185m 250	133	128	117
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 0	689	668	644
Calcium	ppm	ASTM D5185m 2046	1479	1535	1570
Phosphorus	ppm	ASTM D5185m 1043	744	700	734
Zinc	ppm	ASTM D5185m 943	849	842	827
Sulfur	ppm	ASTM D5185m 5012	2649	2308	2400

CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	7	20	6
Sodium	ppm	ASTM D5185m	0	1	2
Potassium	ppm	ASTM D5185m >20	2	0	0

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.2	2.4	0.2
Nitration	Abs/cm	*ASTM D7624 >20	7.1	10.4	6.7
Sulfation	Abs/.1mm	*ASTM D7415 >30	22.9	28.6	23.1



OIL ANALYSIS REPORT

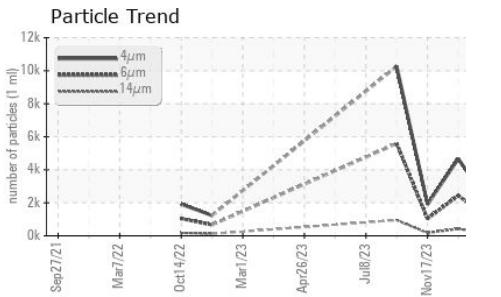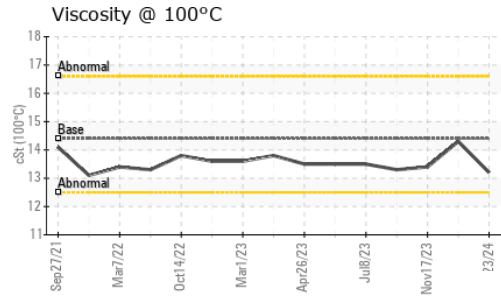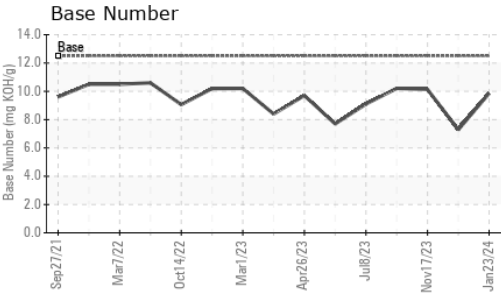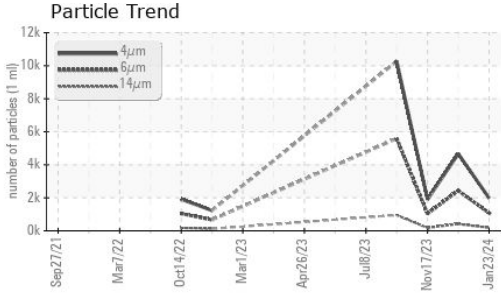






FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1984	4663	1905
Particles >6µm	ASTM D7647	>5000	1081	2431	1038
Particles >14µm	ASTM D7647	>640	184	414	177
Particles >21µm	ASTM D7647	>160	62	139	59
Particles >38µm	ASTM D7647	>40	10	22	9
Particles >71µm	ASTM D7647	>10	1	2	1
Oil Cleanliness	ISO 4406 (c)	>19/16	17/15	18/16	17/15

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	17.0	19.9	16.7
Base Number (BN)	mg KOH/g	ASTM D2896	12.5	9.85	7.29	10.13

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	13.2	14.3	13.4

GRAPHS

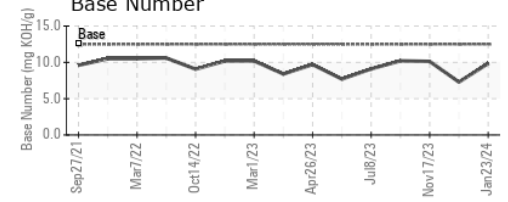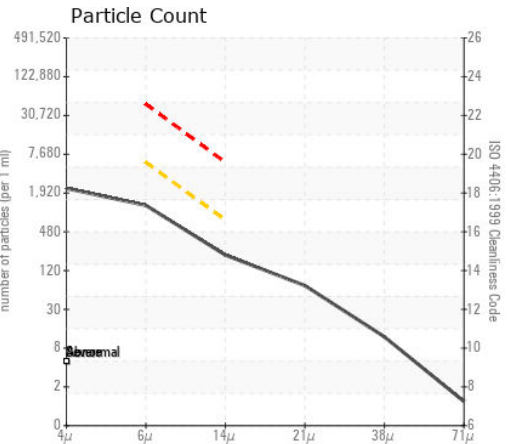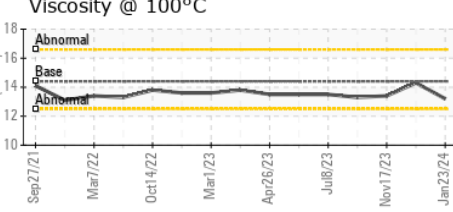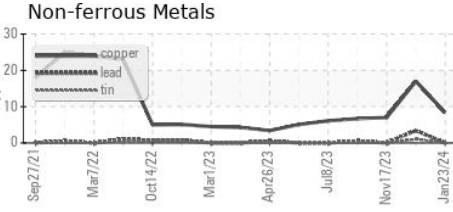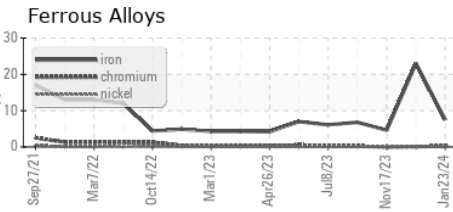

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KL0013464 **Received** : 30 Jan 2024
Lab Number : **06075004** **Diagnosed** : 02 Feb 2024
Unique Number : 10857095 **Diagnostician** : Jonathan Hester
Test Package : MOB 2 (Additional Tests: PrtCount)

CONOR
 JUAREZ 348
 HERMOSILLO,
 MX 83140
 Contact: EDUARDO GARCIA
 egarcia.comsa@gmail.com
 T: (526)622-1581 x:81
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)