




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

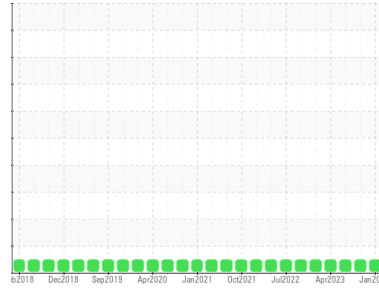

Area  
**Bulk Oil Storage**  
 Machine Id  
**RP 32 Storage**

Component  
**Reservoir Pump**  
 Fluid  
**ROYAL PURPLE SYNFILM 32 (60 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0886167</b>	WC0635868	WC0635840
Sample Date	Client Info			<b>24 Jan 2024</b>	30 Oct 2023	26 Jul 2023
Machine Age	mths	Client Info		<b>0</b>	0	0
Oil Age	mths	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>7	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>12	<b>0</b>	0	1
Copper	ppm	ASTM D5185m	>30	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m	>9	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>79</b>	85	64
Calcium	ppm	ASTM D5185m		<b>0</b>	1	<1
Phosphorus	ppm	ASTM D5185m		<b>9</b>	<1	11
Zinc	ppm	ASTM D5185m		<b>0</b>	0	5
Sulfur	ppm	ASTM D5185m		<b>16305</b>	17703	19580

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	1


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>174</b>	127	190
Particles >6µm		ASTM D7647	>1300	<b>54</b>	44	83
Particles >14µm		ASTM D7647	>160	<b>5</b>	4	11
Particles >21µm		ASTM D7647	>40	<b>0</b>	1	2
Particles >38µm		ASTM D7647	>10	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>15/13/10</b>	14/13/9	15/14/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.42</b>	0.37	0.32




# OIL ANALYSIS REPORT


**Particle Trend**

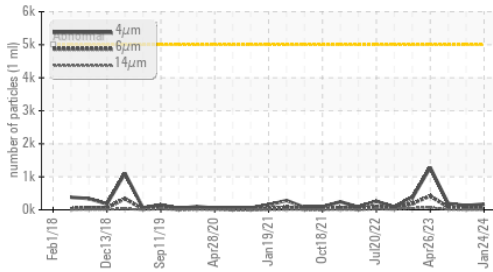


**Acid Number**

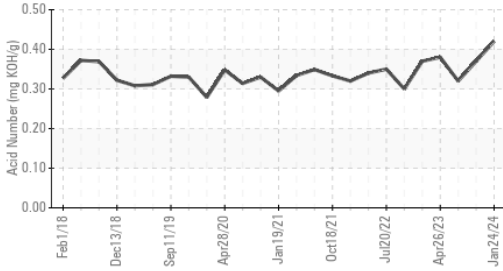

**Viscosity @ 40°C**

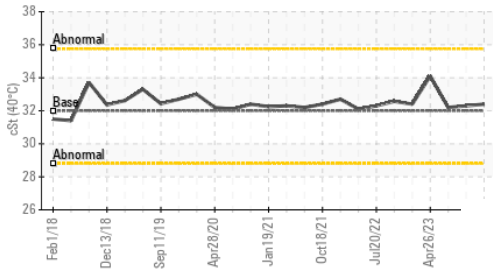


**Particle Trend**

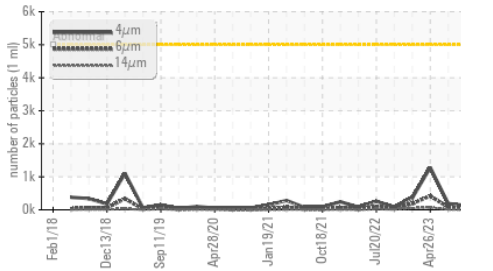

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 32	<b>32.4</b>	32.3	32.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

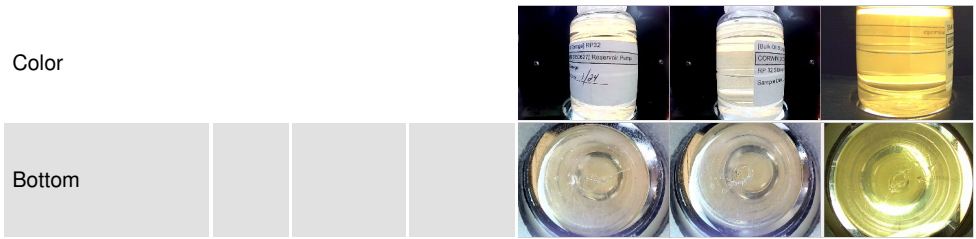


## GRAPHS


**Ferrous Alloys**

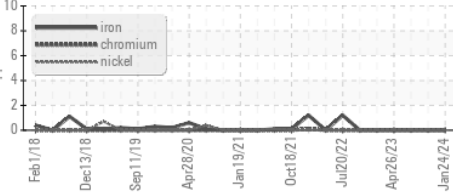


**Non-ferrous Metals**

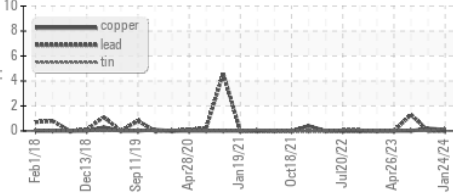


**Viscosity @ 40°C**

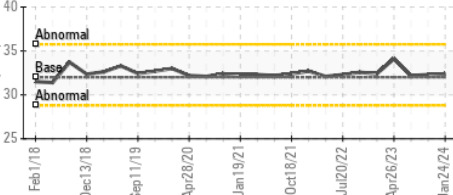

**Particle Count**

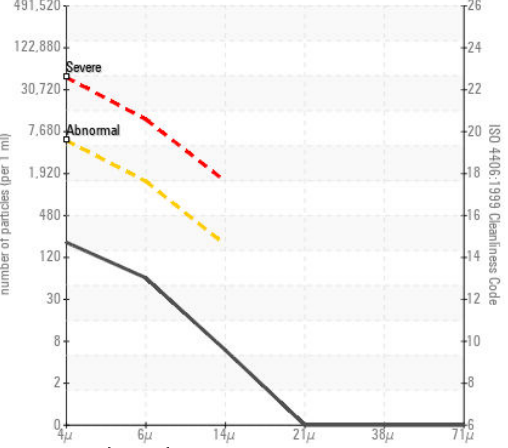

**Acid Number**

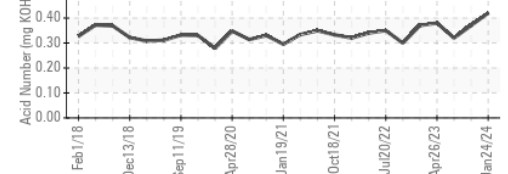

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0886167 **Received** : 31 Jan 2024  
**Lab Number** : 06075710 **Diagnosed** : 01 Feb 2024  
**Unique Number** : 10857801 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**INGREDION INC**  
 WINSTON SALEM PLANT, 4501 OVERDALE ROAD  
 WINSTON SALEM, NC  
 US 27107  
 Contact: MATTHEW KING  
 matthew.king@ingredion.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: (336)785-8809