

OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id

C-3-2 GO
Component
Hydraulic System
Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2024		
				Jan2UZ4		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		MHI026353		
Sample Date		Client Info		08 Jan 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6		
Chromium	ppm	ASTM D5185m	>20	<1		
Nickel	ppm	ASTM D5185m	>20	1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	0		
Lead	ppm	ASTM D5185m	>20	<1		
Copper	ppm	ASTM D5185m	>20	<1		
Tin	ppm	ASTM D5185m	>20	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		102		
Phosphorus	ppm	ASTM D5185m		388		
Zinc	ppm	ASTM D5185m		18		
Sulfur	ppm	ASTM D5185m		1333		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.1	0.020		
ppm Water	ppm	ASTM D6304	>1000	209		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	860		
Particles >6µm		ASTM D7647	>1300	273		
Particles >14μm		ASTM D7647	>160	17		
Particles >21µm		ASTM D7647	>40	4		
Particles >38μm		ASTM D7647	>10	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/15/11		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Asid Number (AN)	ma 1/011/-	ACTM DOGAE		0.10		


Acid Number (AN)

mg KOH/g ASTM D8045

0.13



OIL ANALYSIS REPORT

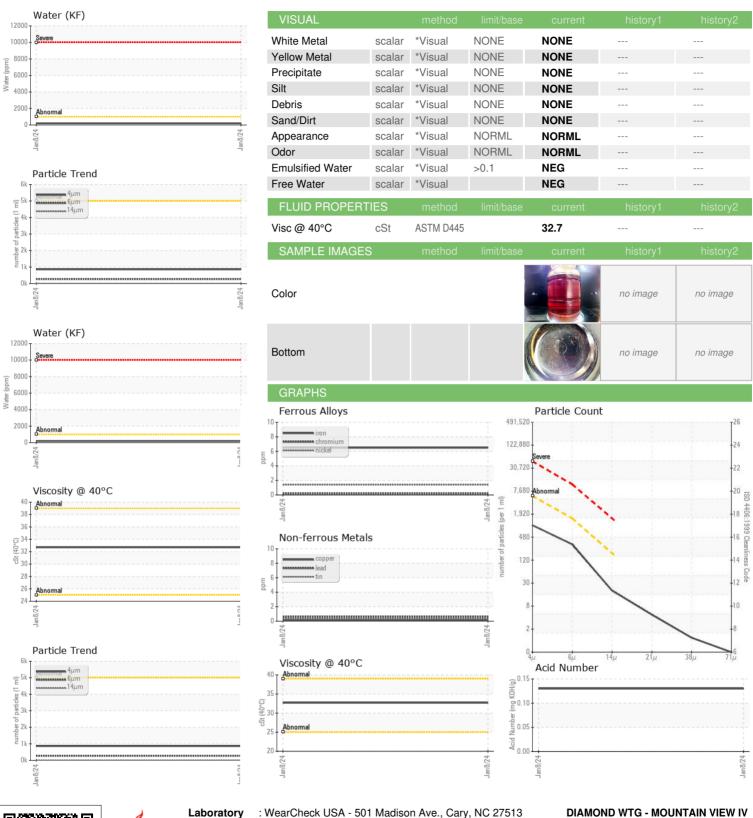





Certificate 12367

Sample No.

Lab Number

: MHI026353 : 06075773

Unique Number : 10857864

Received

: 31 Jan 2024 **Tested** : 01 Feb 2024 Diagnosed

: 01 Feb 2024 - Don Baldridge

P.O. BOX 880 DESERT HOT SPRINGS, CA US 92240

Contact: SERVICE MANAGER

Test Package : IND 2 (Additional Tests: KF, PQ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (760)329-7122 Contact/Location: SERVICE MANAGER - MITDES