




# OIL ANALYSIS REPORT

Sample Rating Trend

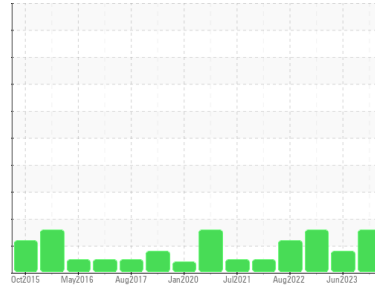

ISO



Machine Id  
**KAESER CSD 75 4284146 (S/N 1024)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA010217</b>	KCPA003200	KCP53123
Sample Date	Client Info		<b>22 Jan 2024</b>	15 Jun 2023	03 Jan 2023
Machine Age	hrs	Client Info	<b>103669</b>	98356	94500
Oil Age	hrs	Client Info	<b>0</b>	0	3614
Oil Changed	Client Info		<b>N/A</b>	N/A	Changed
Sample Status			<b>ATTENTION</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>12</b>	17	10
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 100	<b>0</b>	7	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>&lt;1</b>	4	24
Zinc	ppm	ASTM D5185m 0	<b>0</b>	4	2
Sulfur	ppm	ASTM D5185m 23500	<b>14681</b>	19216	19615

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	1	0
Water	%	ASTM D6304 >0.05	<b>0.013</b>	0.006	0.001
ppm Water	ppm	ASTM D6304 >500	<b>134</b>	66.5	13.4






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>6201</b>	3024	18176
Particles >6µm	ASTM D7647	>1300	<b>▲ 1906</b>	1189	▲ 3972
Particles >14µm	ASTM D7647	>80	<b>▲ 151</b>	▲ 117	▲ 153
Particles >21µm	ASTM D7647	>20	<b>▲ 34</b>	26	▲ 31
Particles >38µm	ASTM D7647	>4	<b>1</b>	0	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 20/18/14</b>	▲ 19/17/14	▲ 21/19/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.55</b>	0.48	0.48

# OIL ANALYSIS REPORT

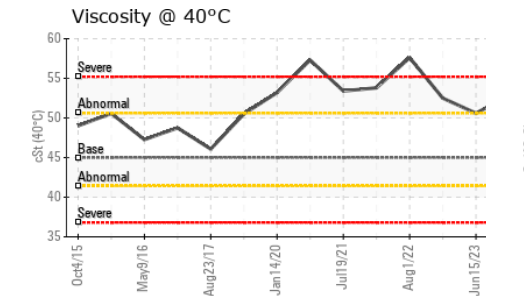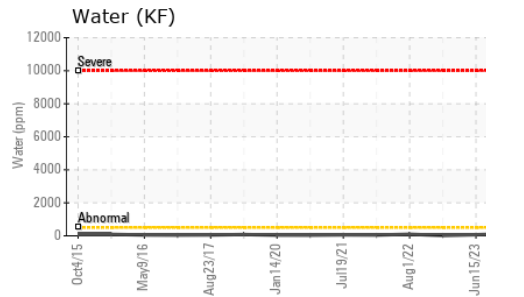
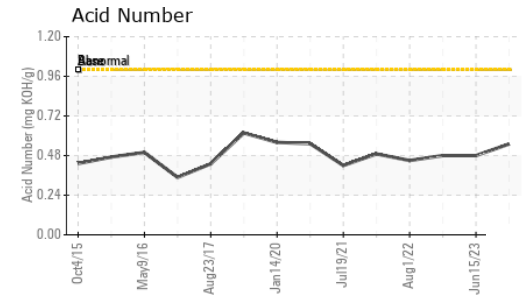
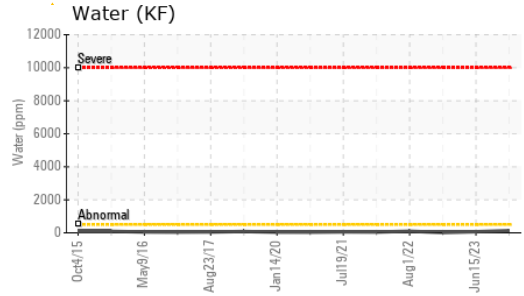
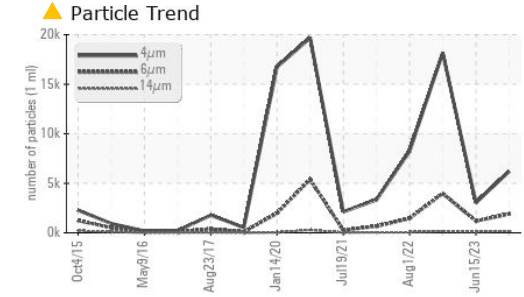


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	52.81	50.6	52.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

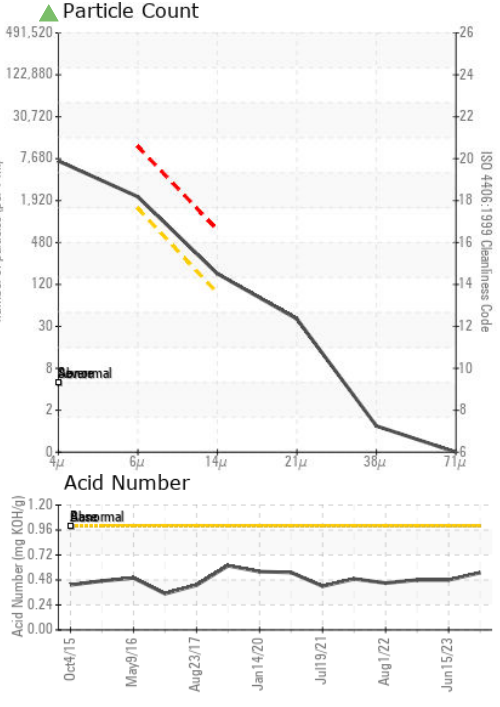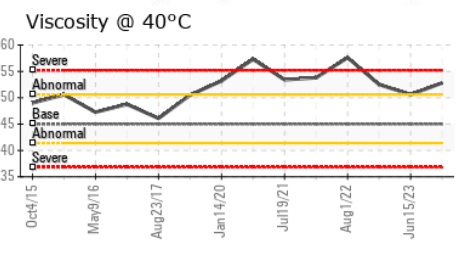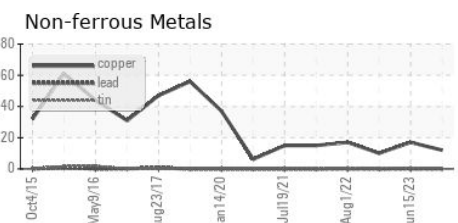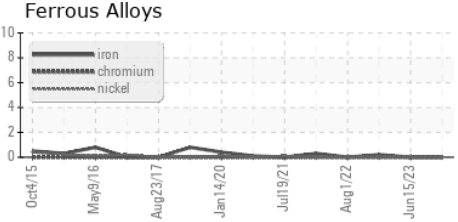

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA010217 **Received** : 31 Jan 2024  
**Lab Number** : 06075777 **Diagnosed** : 06 Feb 2024  
**Unique Number** : 10857868 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AZZ GALVANIZING CO**  
 4400 E 61ST AVE  
 COMMERCE CITY, CO  
 US 80022  
 Contact: TINA HERMAN  
 tinaherman@azz.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)