


# **OIL ANALYSIS REPORT**

# **DPO** [8323] **KAESER 1048 - COLORBIOTICS**

Compressor



### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06075948		
Sample Date		Client Info		22 Jan 2024		
Machine Age	hrs	Client Info		67938		
Oil Age	hrs	Client Info		10133		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m	710	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.1	0		
Barium	ppm	ASTM D5185m	0.8	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	0.9	<1		
Magnesium	ppm	ASTM D5185m	0	3		
Calcium	ppm	ASTM D5185m	0	1		
Phosphorus	ppm	ASTM D5185m	409	158		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	1290	2341		
CONTAMINANTS	}	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.537	0.37		



## **OIL ANALYSIS REPORT**

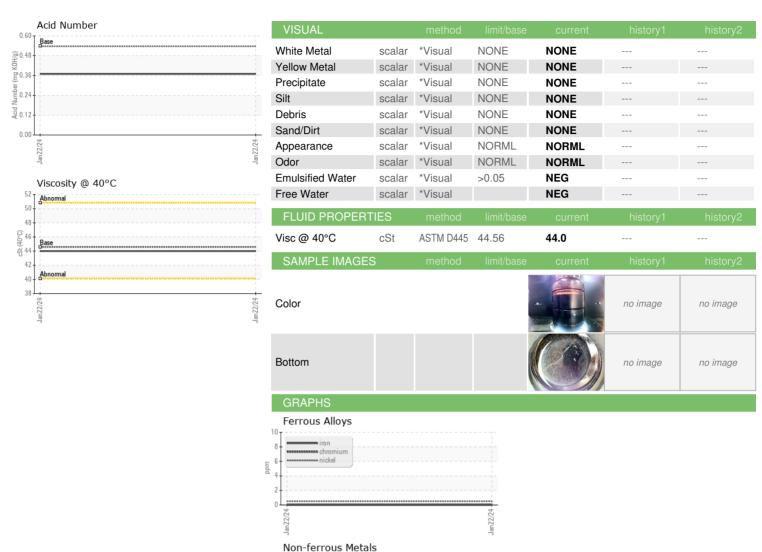





Certificate L2367

Laboratory Sample No. Lab Number

Unique Number Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06075948 : 06075948

: 10858039

Viscosity @ 40°C

Recieved Diagnosed Diagnostician

: 31 Jan 2024 : 02 Feb 2024 : Don Baldridge

Acid Number

0.60 0.48 0.48 E 0.36 은 0.24 0.12 0.00

> **DELTA INDUSTRIES - CEDAR RAPIDS** 6540 4TH ST SW CEDAR RAPIDS, IA US 52404

Contact: MICHAEL FERRIS wearcheck@deltaind.net

T: (319)862-2500 F: (319)862-2501

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCDELCED [WUSCAR] 06075948 (Generated: 02/02/2024 10:20:32) Rev: 1

Contact/Location: MICHAEL FERRIS - UCDELCED