




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

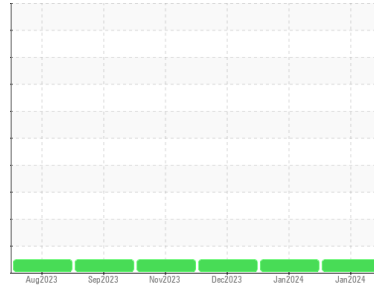

Area
UTILITIES
 Machine Id
Utilities-FUEL STATION ELEC BLDG 5500
 Component
Diesel Exhaust Fluid (DEF)
 Fluid
DEF (Diesel Exhaust Fluid) (805 GAL)

DIAGNOSIS

Recommendation

Fluid meets ISO 22241-2 requirements and is suitable for use.

Contamination

Appearance is acceptable. There is no indication of any contamination in the diesel exhaust fluid (def).

Fluid Condition

Urea content is normal.


SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			RP0039093	RP0039184	RP0034994
Sample Date	Client Info			29 Jan 2024	04 Jan 2024	05 Dec 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINANTS		method	limit/base	current	history1	history2
Hydrocarbon	scalar	*In-House		NONE	NONE	NONE


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	---	---	NONE
Yellow Metal	scalar	*Visual	NONE	---	---	NONE
Precipitate	scalar	*Visual	NONE	---	---	NONE
Silt	scalar	*Visual	NONE	---	---	NONE
Debris	scalar	*Visual	NONE	---	---	NONE
Sand/Dirt	scalar	*Visual	NONE	---	---	NONE
Appearance	scalar	*Visual	NORML	---	---	NORML
Odor	scalar	*Visual	NORML	---	---	NORML
Emulsified Water	scalar	*Visual		---	---	NEG
Free Water	scalar	*Visual		---	---	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Urea Content	%	ISO 22241	<31.8	32.7	32.8	32.7
Density @ 20°C	g/cm3	ISO 22241	>1.0930	1.0897	1.0892	1.0898
Refracting Index		ISO 22241	<1.3814	1.3827	1.3820	1.3828
Appearance	scalar	*Visual		Clear & Bright	Clear & Bright	Clear & Bright



SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

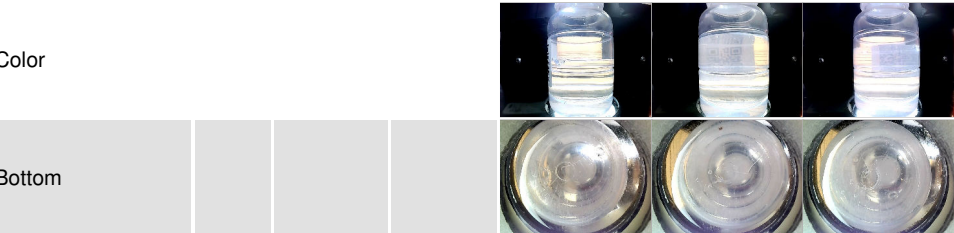

OIL ANALYSIS REPORT

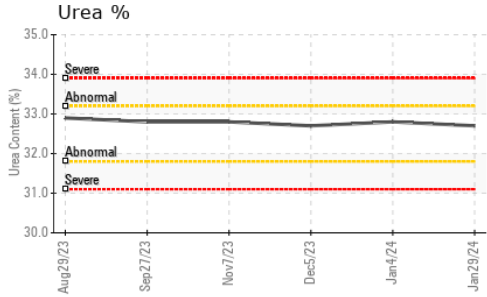

GRAPHS

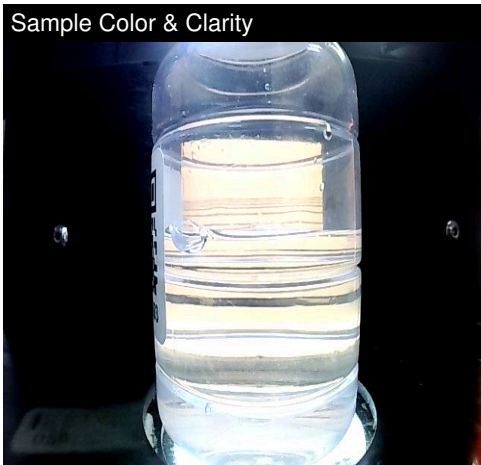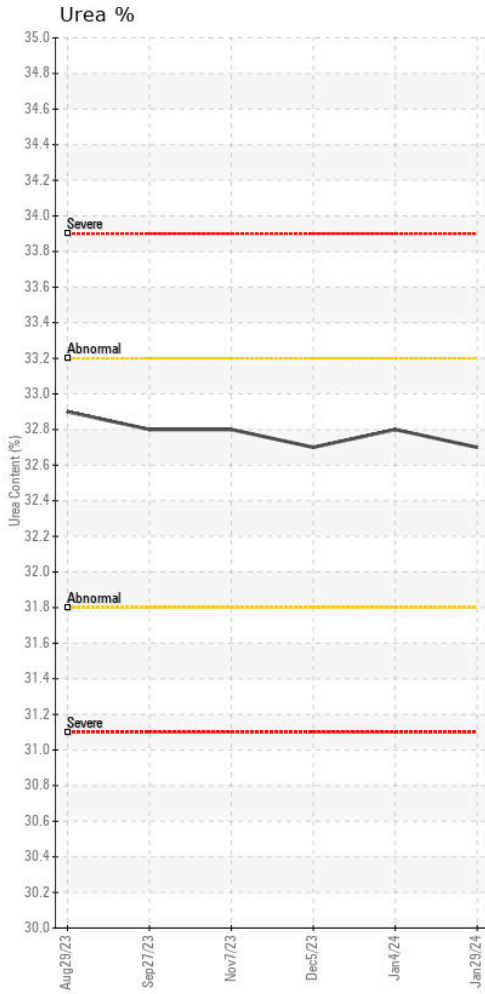

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0039093
Lab Number : 06076276
Unique Number : 10858367
Test Package : DEF 1 (Additional Tests: ICP, KF, KV40, SCREEN, TAN Man)

Received : 31 Jan 2024
Tested : 08 Feb 2024
Diagnosed : 08 Feb 2024 - Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

OUTOKUMPU STAINLESS USA
 HWY 43 N
 CALVERT, AL
 US 36513
 Contact: MARIO JOHNSON
 Mario.johnson@outokumpu.com
 T: (251)321-4105
 F: x: