




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

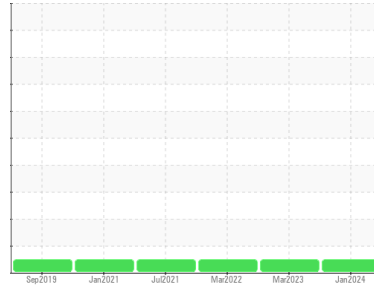

Area
[901928]
 Machine Id
MTS-10 CPU (S/N 353786)
 Component
Diesel Engine
 Fluid
PHILLIPS 66 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0865370	WC0687734	WC0533765
Sample Date	Client Info			26 Jan 2024	23 Mar 2023	29 Mar 2022
Machine Age	hrs	Client Info		4529	4320	4959
Oil Age	hrs	Client Info		35	4204	0
Oil Changed	Client Info			Not Chngd	Not Chngd	Not Chngd
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<1.0	<1.0	<1.0
Water	WC Method	>0.2		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	2	5	6
Chromium	ppm	ASTM D5185m	>20	<1	<1	<1
Nickel	ppm	ASTM D5185m	>4	0	<1	0
Titanium	ppm	ASTM D5185m		<1	<1	1
Silver	ppm	ASTM D5185m	>3	0	<1	3
Aluminum	ppm	ASTM D5185m	>20	3	3	2
Lead	ppm	ASTM D5185m	>40	<1	<1	0
Copper	ppm	ASTM D5185m	>330	0	1	<1
Tin	ppm	ASTM D5185m	>15	<1	<1	0
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		121	350	77
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		73	55	2
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		135	596	703
Calcium	ppm	ASTM D5185m		1970	1567	1535
Phosphorus	ppm	ASTM D5185m		1025	1103	1034
Zinc	ppm	ASTM D5185m		1168	1359	1116
Sulfur	ppm	ASTM D5185m		3431	4877	3153



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	8	10	8
Sodium	ppm	ASTM D5185m		1	2	2
Potassium	ppm	ASTM D5185m	>20	2	2	<1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	7.6	6.4	8.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	17.5	19.8	21.1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	13.1	13.1	13.9
Base Number (BN)	mg KOH/g	ASTM D2896		7.4	11.13	10.3











OIL ANALYSIS REPORT

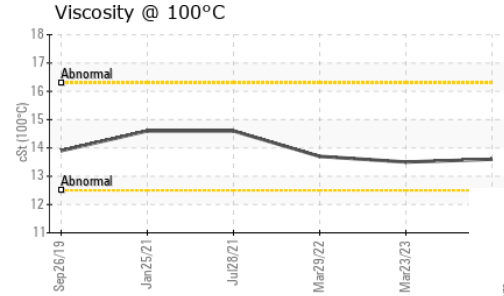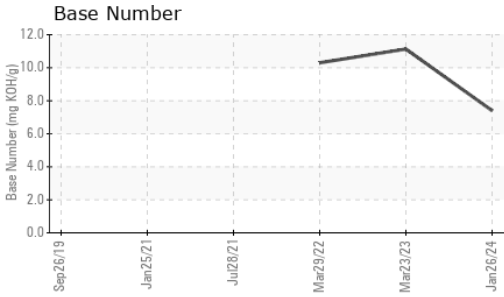

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.6	13.5	13.7

GRAPHS

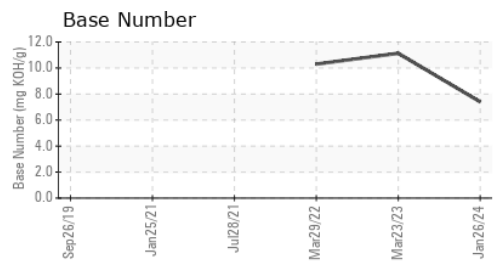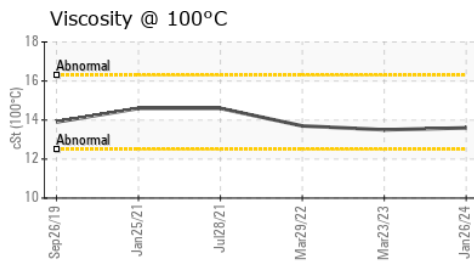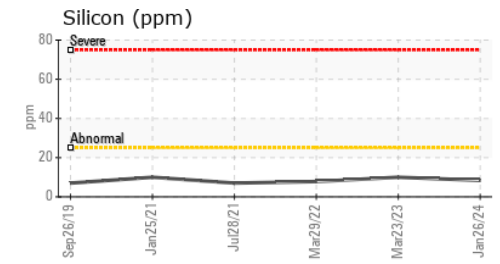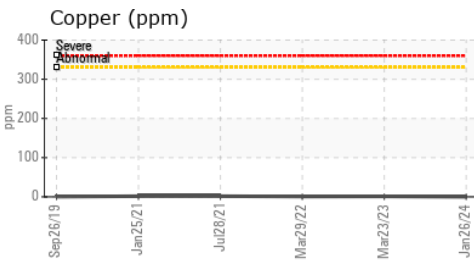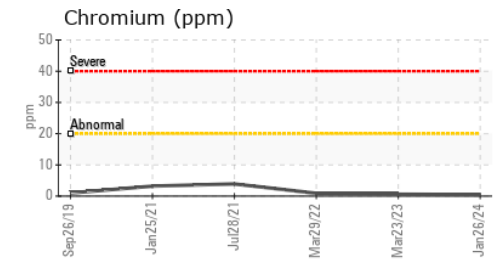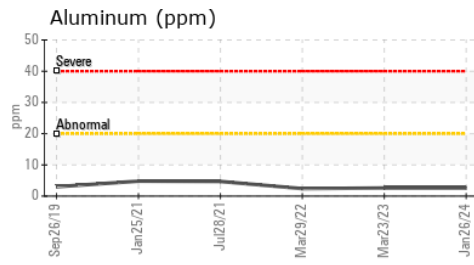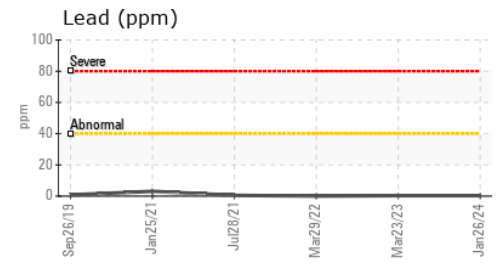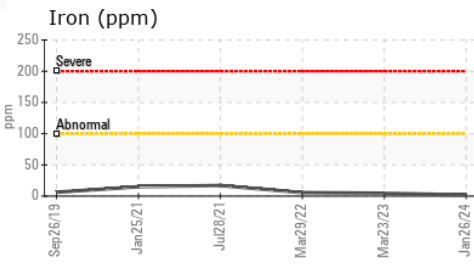

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0865370 **Received** : 31 Jan 2024
Lab Number : 06076300 **Diagnosed** : 01 Feb 2024
Unique Number : 10858391 **Diagnostician** : Wes Davis
Test Package : MOB 1 (Additional Tests: TBN)

AES USA - NORTH CHARLESTON
 5400 INTERNATIONAL BLVD, BLDG 88-20
 NORTH CHARLESTON, SC
 US 29418
 Contact: Maxime Banctel
 maxime.banctel@aes-gse.com

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)