

OIL ANALYSIS REPORT

8095108 (S/N 1147)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)





DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug ² 022 Jun ² 023 Jan ² 024				
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007036	KCPA001755	KCP40653
Sample Date		Client Info		26 Jan 2024	08 Jun 2023	02 Aug 2022
Machine Age	hrs	Client Info		9305	5905	2569
Oil Age	hrs	Client Info		0	0	2569
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m		0	2	2
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m		6	9	10
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	100	0	2	12
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	3	15
Zinc	ppm	ASTM D5185m	0	0	26	33
Sulfur	ppm	ASTM D5185m	23500	15818	22269	20815
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		<1	1	2
Potassium	ppm	ASTM D5185m		<1	<1	4
Water	%	ASTM D6304		0.009	0.009	0.019
ppm Water	ppm	ASTM D6304	>500	92	95.4	193.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		11026	12828	20909
Particles >6µm		ASTM D7647	>1300	4640	<u>4175</u>	4 015
Particles >14μm		ASTM D7647	>80	^ 793	<u>^</u> 201	160
Particles >21μm		ASTM D7647	>20	<u>^</u> 255	<u>^</u> 29	1 31
Particles >38μm		ASTM D7647	>4	<u>^</u> 5	1	2
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	<u>^</u> 21/19/15	<u>22/19/14</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.41	0.42	0.37



OIL ANALYSIS REPORT

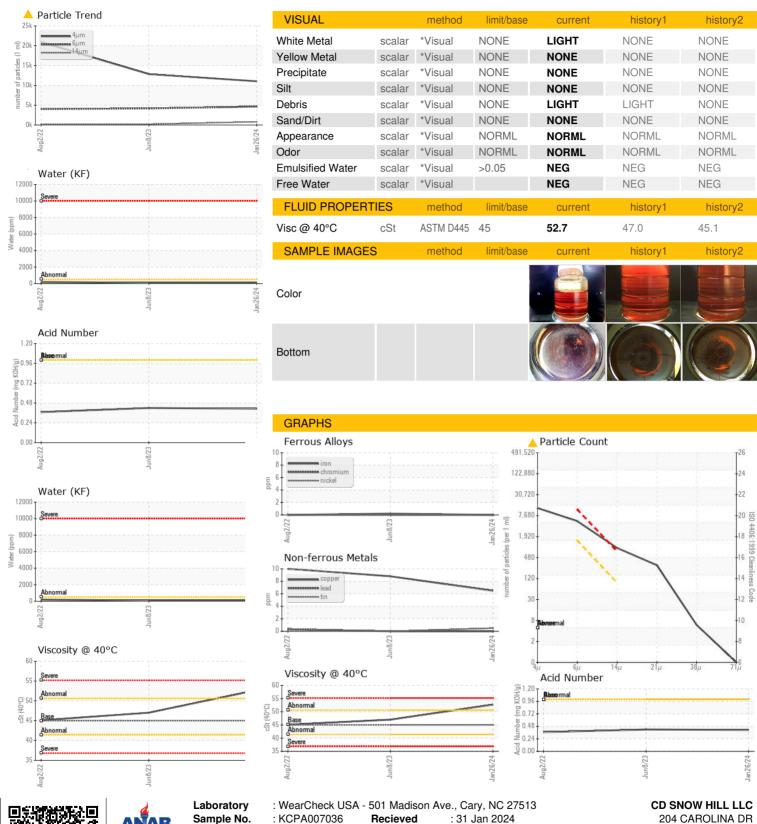





Certificate L2367

Sample No. Lab Number **Unique Number**

: KCPA007036 : 06076373

Diagnosed : 10858464 Diagnostician : Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 02 Feb 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

SNOW HILL, NC US 28580 Contact: B. BELL

bbell@cde.com

T: F: