

# **OIL ANALYSIS REPORT**

Sample Rating Trend



# KAESER 8953713

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2024		
SAMPLE INFORM	/ATION	method	limit/base	current	history1	history2
	717 (11014		III III Dasc			
Sample Number		Client Info		KCPA011993 23 Jan 2024		
Sample Date	hue	Client Info				
Machine Age	hrs	Client Info		2384		
Oil Age	hrs	Client Info		0 N/A		
Oil Changed		Client inio		ABNORMAL		
Sample Status				ADNORWAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	7		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	9		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	26		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		8		
Sulfur	ppm	ASTM D5185m		17064		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		7		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.010		
ppm Water	ppm	ASTM D6304	>500	108		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12989		
Particles >6µm		ASTM D7647	>1300	<b>^</b> 5934		
Particles >14µm		ASTM D7647	>80	<b>1130</b>		
Particles >21µm		ASTM D7647	>20	<b>4</b> 337		
Particles >38µm		ASTM D7647	>4	<u> 11</u>		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/20/17		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A : I N I (ANI)	1/011/	AOTH DOOLS	0.4	0.21		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.31



# **OIL ANALYSIS REPORT**

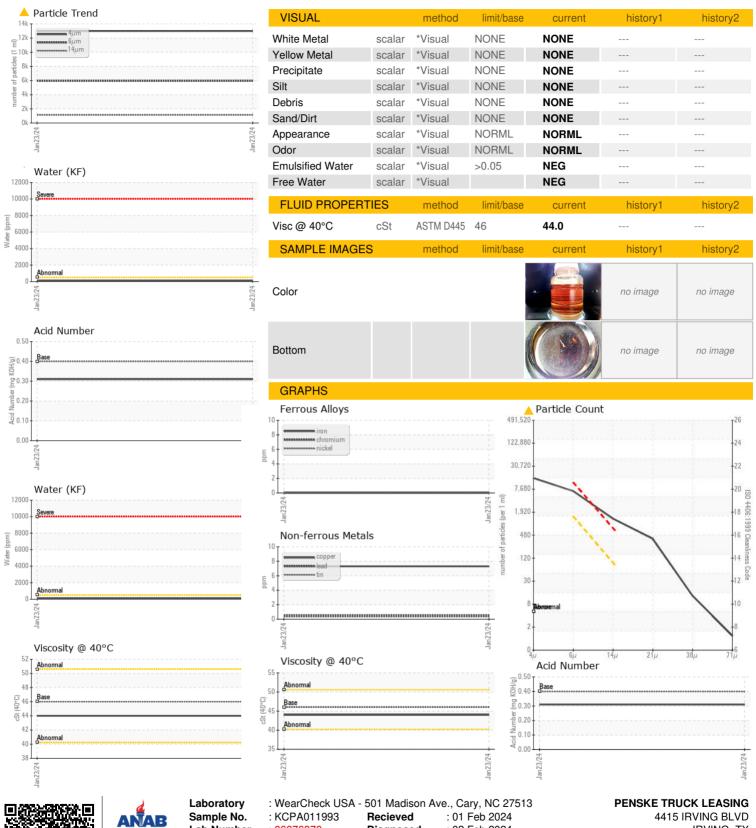





Lab Number **Unique Number** 

: 06076870

: 10858961

Diagnosed

: 02 Feb 2024 Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

IRVING, TX US 75247

Contact: Service Manager

T: F: