




# OIL ANALYSIS REPORT

Sample Rating Trend

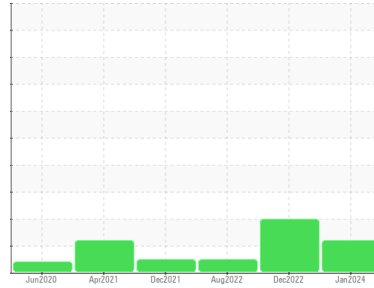

ISO



Machine Id  
**7087955 (S/N 1400)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA008956</b>	KCP46846D	KCP50231
Sample Date	Client Info		<b>23 Jan 2024</b>	28 Dec 2022	19 Aug 2022
Machine Age	hrs	Client Info	<b>18837</b>	14460	12925
Oil Age	hrs	Client Info	<b>0</b>	1535	2503
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>ABNORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	3	2
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	5	5
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	1	0
Copper	ppm	ASTM D5185m >50	<b>9</b>	9	9
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	6	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 500	<b>54</b>	414	351
Zinc	ppm	ASTM D5185m	<b>36</b>	236	299
Sulfur	ppm	ASTM D5185m	<b>1039</b>	1257	1515

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	2	0
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	3	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	9	0
Water	%	ASTM D6304 >0.05	<b>0.003</b>	0.007	0.003
ppm Water	ppm	ASTM D6304 >500	<b>30</b>	71.7	35.9






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>18984</b>	4387	3986
Particles >6µm	ASTM D7647	>1300	<b>▲ 5925</b>	▲ 1461	935
Particles >14µm	ASTM D7647	>80	<b>▲ 92</b>	▲ 106	43
Particles >21µm	ASTM D7647	>20	<b>13</b>	▲ 22	10
Particles >38µm	ASTM D7647	>4	<b>0</b>	1	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 21/20/14</b>	▲ 19/18/14	19/17/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.28</b>	1.49	0.46

# OIL ANALYSIS REPORT

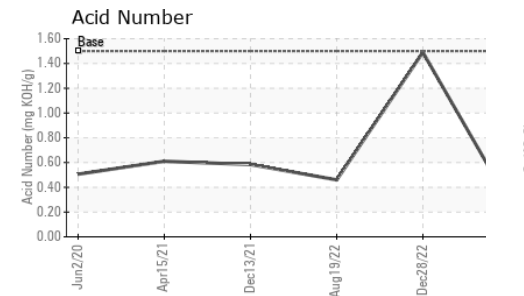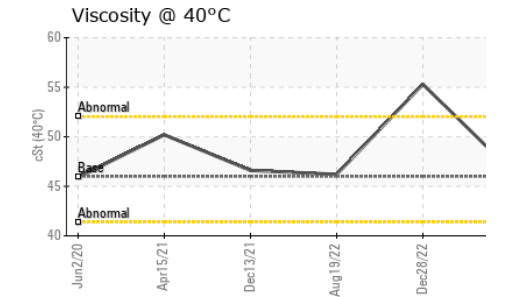
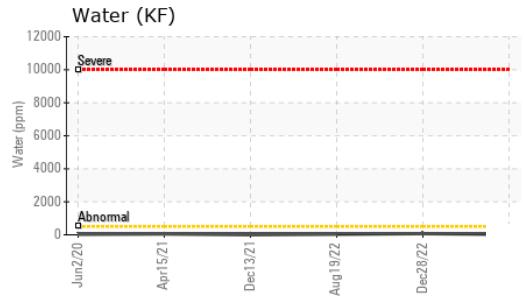
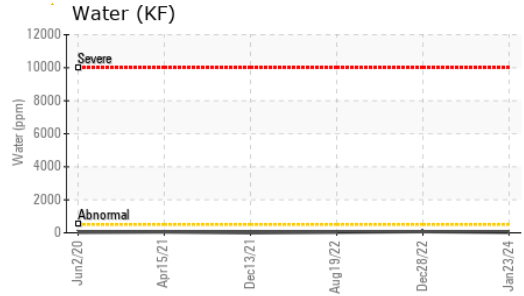
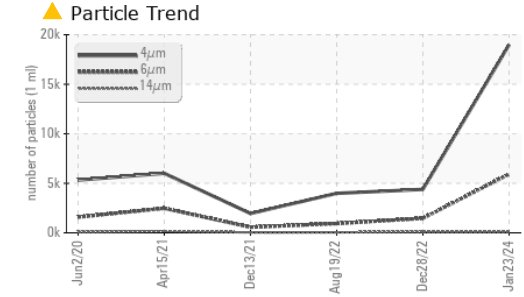


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>46.8</b>	▲ 55.3	46.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

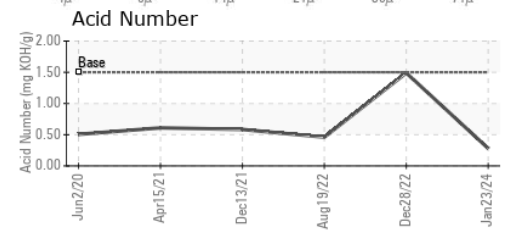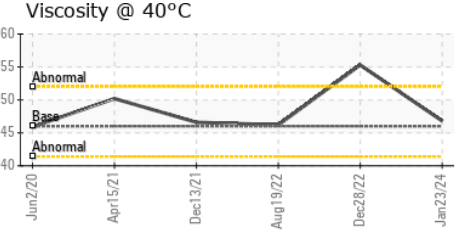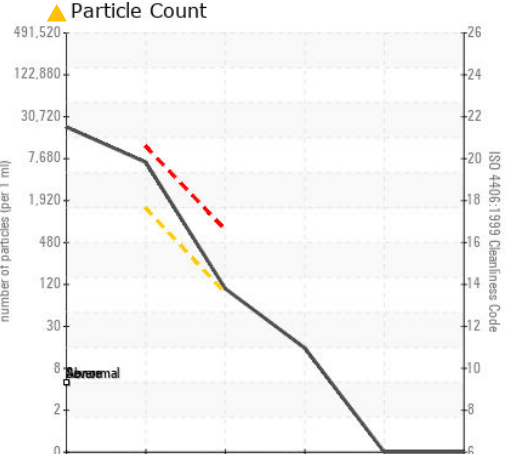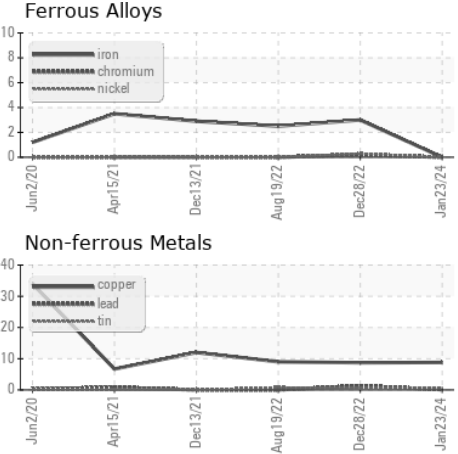

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA008956 **Recieved** : 01 Feb 2024  
**Lab Number** : 06076878 **Diagnosed** : 02 Feb 2024  
**Unique Number** : 10858969 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NPIC - NATIONAL POLYMER INTL CORP**  
 3601 E PLANO PKWY  
 PLANO, TX  
 US 75074  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: