


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

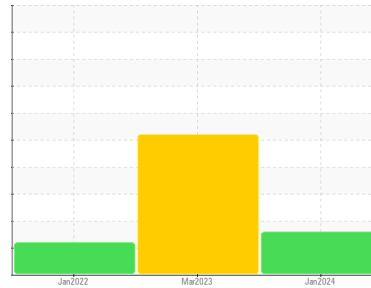

Machine Id  
**7204498 (S/N 1031)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is a high amount of particulates present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA008843</b>	KCP49132	KC95693
Sample Date	Client Info	<b>22 Jan 2024</b>	01 Mar 2023	19 Jan 2022
Machine Age	hrs	<b>5082</b>	3843	2495
Oil Age	hrs	<b>0</b>	1348	2496
Oil Changed	Client Info	<b>N/A</b>	N/A	Changed
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

**WEAR METALS**

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>9</b>	3	6
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 90	<b>17</b>	36	35
Calcium	ppm	ASTM D5185m 2	<b>0</b>	3	1
Phosphorus	ppm	ASTM D5185m	<b>0</b>	7	7
Zinc	ppm	ASTM D5185m	<b>17</b>	15	18
Sulfur	ppm	ASTM D5185m	<b>17173</b>	18055	16793

**CONTAMINANTS**

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>12</b>	8	15
Potassium	ppm	ASTM D5185m >20	<b>2</b>	1	8
Water	%	ASTM D6304 >0.05	<b>0.008</b>	▲ 0.438	0.011
ppm Water	ppm	ASTM D6304 >500	<b>80</b>	▲ 4380	113.4






**FLUID CLEANLINESS**

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>7615</b>	879	20367
Particles >6µm	ASTM D7647 >1300	▲ <b>3251</b>	479	▲ 8625
Particles >14µm	ASTM D7647 >80	▲ <b>282</b>	▲ 81	▲ 261
Particles >21µm	ASTM D7647 >20	▲ <b>75</b>	▲ 27	▲ 49
Particles >38µm	ASTM D7647 >4	<b>3</b>	4	2
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ <b>20/19/15</b>	▲ 17/16/14	▲ 20/15

**FLUID DEGRADATION**

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.23</b>	0.31	0.24


# OIL ANALYSIS REPORT

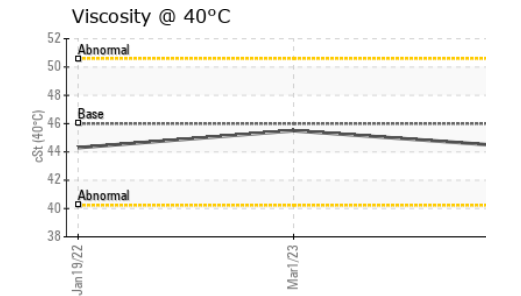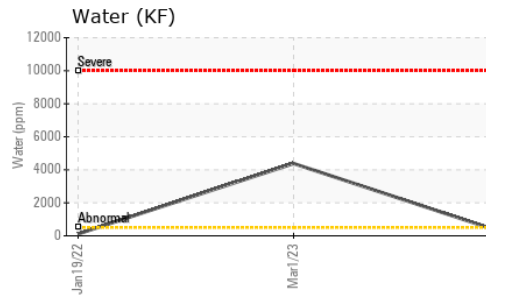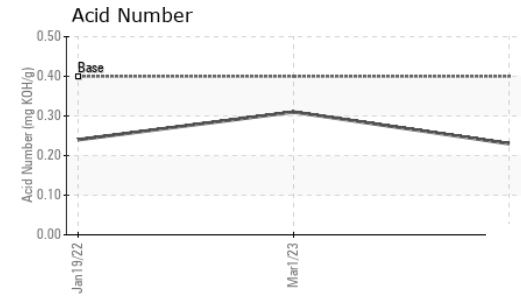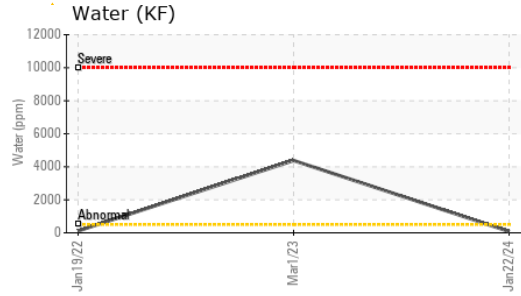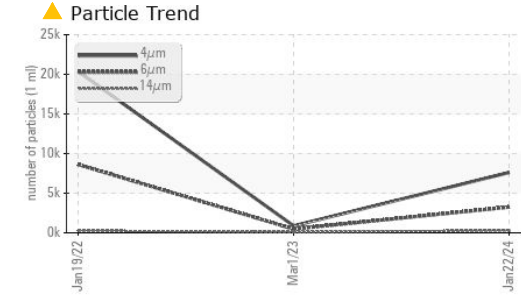





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.4	45.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

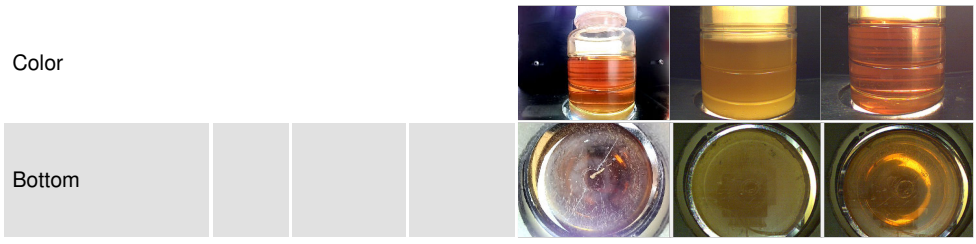

## GRAPHS

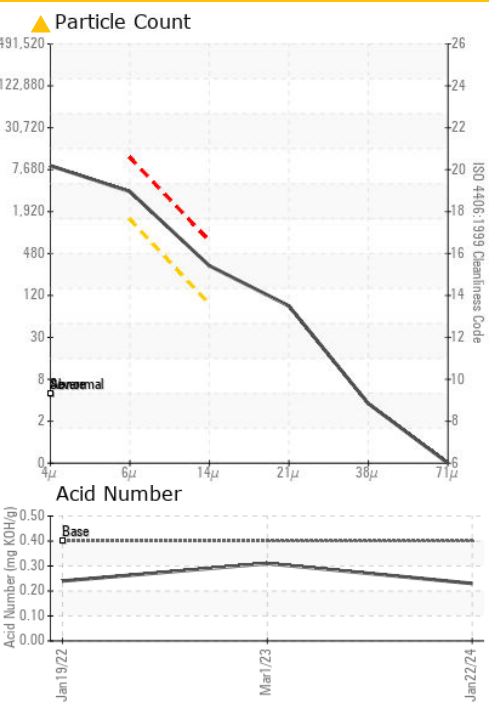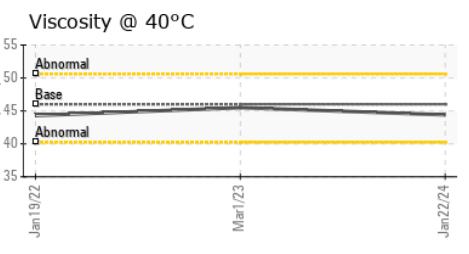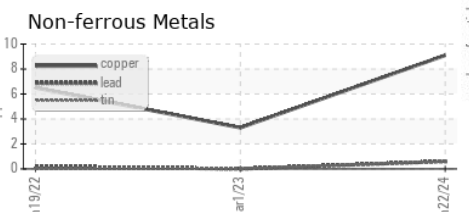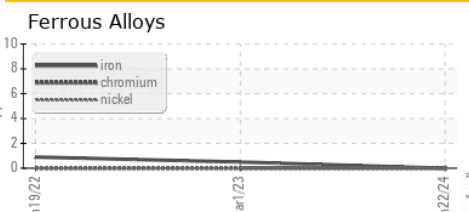

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA008843 **Received** : 01 Feb 2024  
**Lab Number** : 06076882 **Diagnosed** : 02 Feb 2024  
**Unique Number** : 10858973 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**BRINDLE TEXAS LLC**  
 904 OLD WISE RD  
 BOWIE, TX  
 US 76230  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)