

# **OIL ANALYSIS REPORT**



ISO

# KAESER 2220855

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2024		
SAMPLE INFORM	AATION	mathad			historyd	biotom/0
07 mm 22 mm 01 m	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA010068		
Sample Date		Client Info		03 Jan 2024		
Machine Age	hrs	Client Info		27854		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	le le	method	limit/base	current	history1	history2
					HISTORY	HISTOTYZ
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	29		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	21		
Sulfur	ppm	ASTM D5185m	23500	17838		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		11		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.022		
ppm Water	ppm	ASTM D6304	>500	228		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		64659		
Particles >6µm		ASTM D7647	>1300	<u>4</u> 34391		
Particles >14μm		ASTM D7647	>80	<b>△</b> 6724		
Particles >21µm		ASTM D7647	>20	<b>1670</b>		
Particles >38μm		ASTM D7647	>4	<u>▲</u> 58		
Particles >71μm		ASTM D7647	>3	2		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>23/22/20</b>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39		



## **OIL ANALYSIS REPORT**

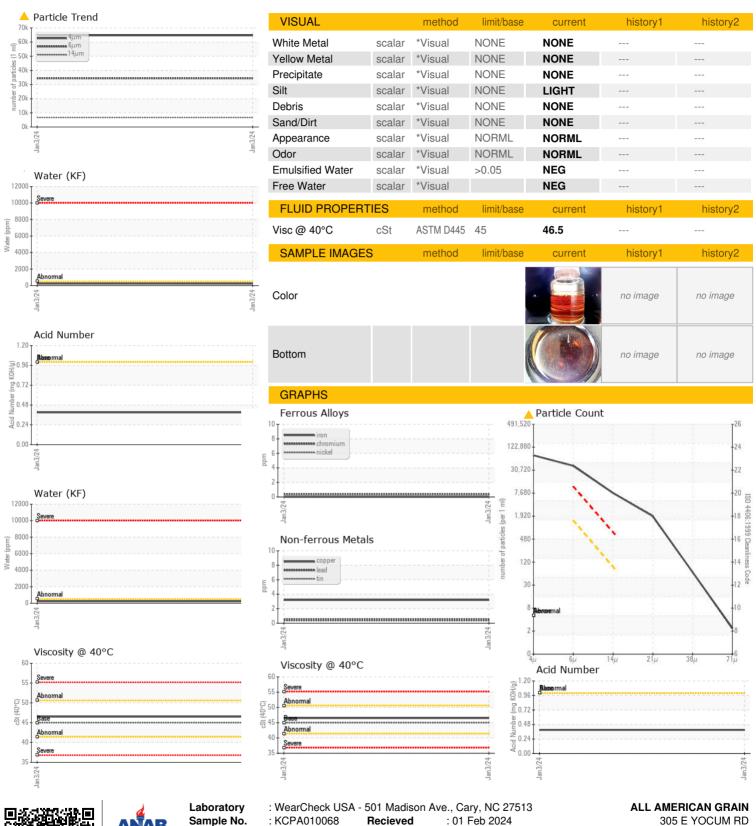





Certificate L2367

Sample No. Lab Number **Unique Number** 

: 06076889

: KCPA010068 : 10858980

Recieved Diagnosed

: 02 Feb 2024 Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 305 E YOCUM RD CALIPATRIA, CA

US 92233

Contact: Service Manager

T:

F: