

OIL ANALYSIS REPORT



ISO

8692427 (S/N 1024) Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Dec2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA011434		
Sample Date		Client Info		09 Dec 2023		
Machine Age	hrs	Client Info		3282		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	54		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	4		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	17021		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.023		
ppm Water	ppm	ASTM D6304	>500	239		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		11482		
Particles >6µm		ASTM D7647	>1300	1800		
Particles >14μm		ASTM D7647	>80	105		
Particles >21µm		ASTM D7647	>20	14		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	2 1/18/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A si al Niversala au (ANI)	I/OII/-	ACTM DOGAE	1.0	0.20		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.39



OIL ANALYSIS REPORT

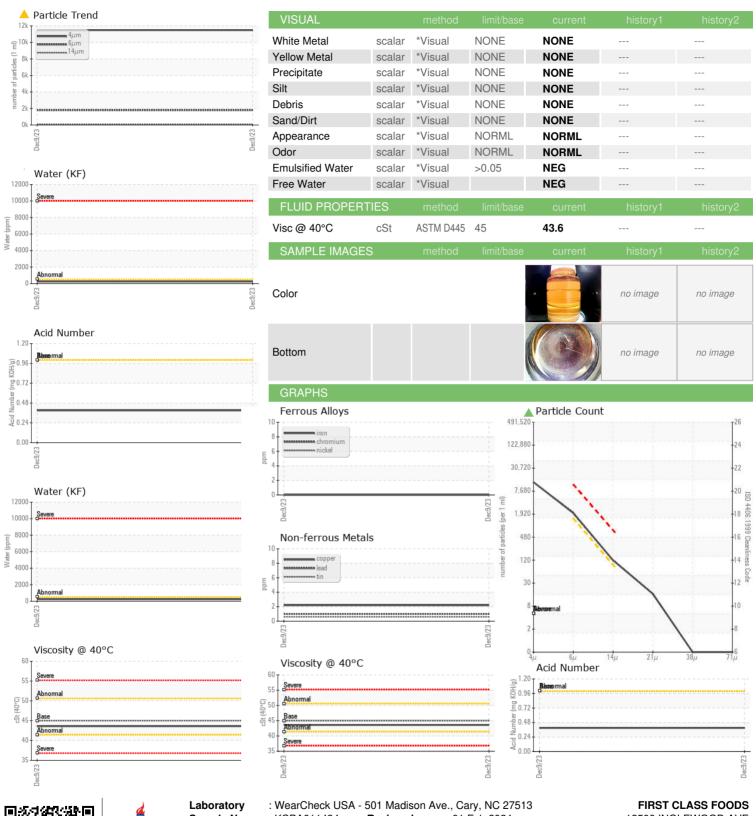





Certificate L2367

Sample No. Lab Number **Unique Number**

: 06076890

: KCPA011434 : 10858981

Recieved : 01 Feb 2024 Diagnosed

: 02 Feb 2024 Diagnostician : Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 12500 INGLEWOOD AVE HAWTHORNE, CA US 90250

Contact: Service Manager

T: F: