

# **OIL ANALYSIS REPORT**

Machine Id **4020898 (S/N 2103)** 

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

# Sample Rating Trend **NORMAL**

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA009955		
Sample Date		Client Info		27 Dec 2023		
Machine Age	hrs	Client Info		33268		
Oil Age	hrs	Client Info		0		
Oil Changed	1110	Client Info		N/A		
Sample Status		Oliotic iiiio		NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	26		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	23		
Sulfur	ppm	ASTM D5185m	23500	18385		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		5		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.014		
ppm Water	ppm	ASTM D6304	>500	149		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4803		
Particles >6µm		ASTM D7647	>1300	849		
Particles >14µm		ASTM D7647	>80	52		
Particles >21µm		ASTM D7647	>20	12		
Particles >38µm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	ATION -	method	limit/base	current	history1	history2
- LOID DEGINADA	THON	ACTM DOOAS	- imiliobase	O 44	- Instory i	Tilstoryz


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.41



## **OIL ANALYSIS REPORT**

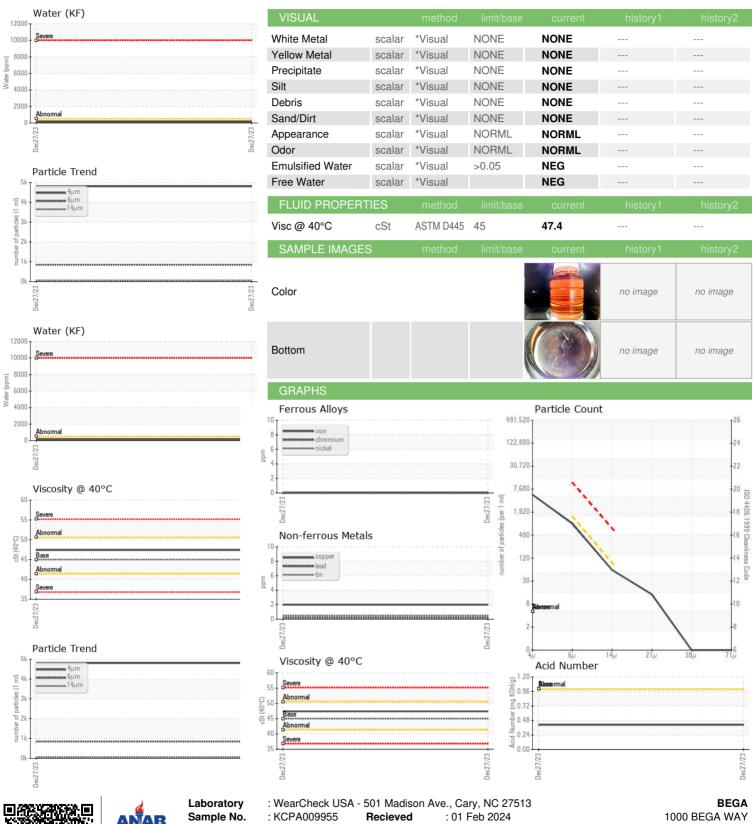



Certificate L2367

Lab Number **Unique Number** 

: 06076891

Diagnosed Diagnostician : Don Baldridge Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 02 Feb 2024

CARPENTERIA, CA US 93013 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: 10858982

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: