


OIL ANALYSIS REPORT



ISO

Machine Id **4887023 (S/N 1105)**

Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		·		Jan 2024		
SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA010240		
Sample Date		Client Info		24 Jan 2024		
Machine Age	hrs	Client Info		26470		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	23		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	15		
Sulfur	ppm	ASTM D5185m	23500	18473		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	183		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9155		
Particles >6µm		ASTM D7647	>1300	1990		
Particles >14µm		ASTM D7647	>80	102		
Particles >21µm		ASTM D7647	>20	22		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/18/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A sial Nivershaw (ANI)	I/OLI/-	A CTM D00.45	1.0	0.27		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.37



OIL ANALYSIS REPORT

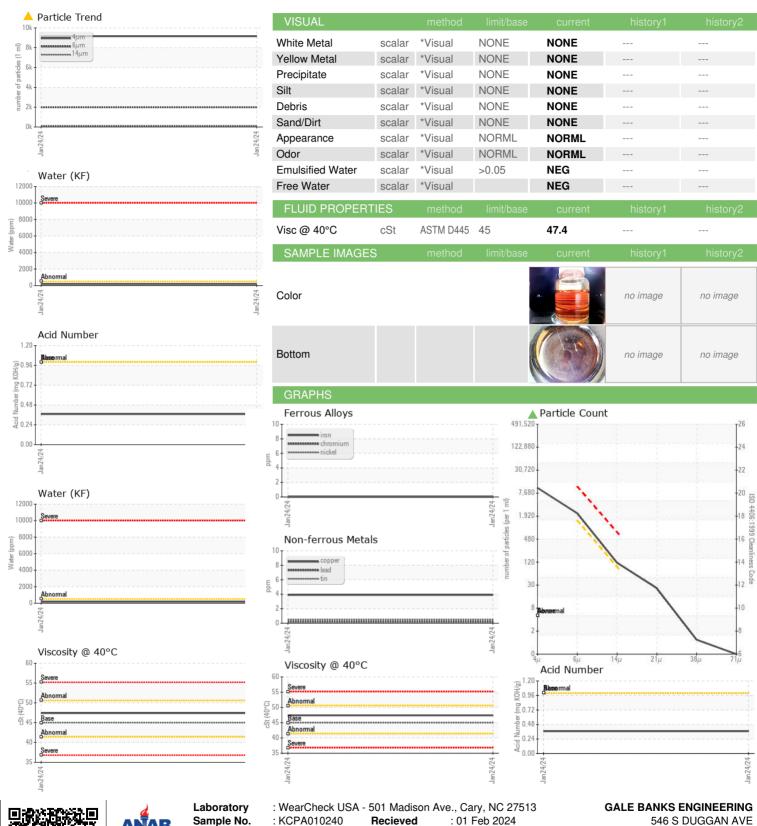





Sample No. Lab Number **Unique Number**

: KCPA010240

: 06076901 : 10858992

Recieved Diagnosed

: 02 Feb 2024

Diagnostician : Doug Bogart

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 546 S DUGGAN AVE AZUSA, CA

US 91702

Contact: Service Manager

T:

F: