


OIL ANALYSIS REPORT

[ORD001240] KAESER BSD 60T 101591.0 - 1070

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)



	NORMAL
Jan ² 024	

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0872542		
Sample Date		Client Info		17 Jan 2024		
Machine Age	hrs	Client Info		45233		
Oil Age	hrs	Client Info		2144		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	5		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	8		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		315		
Zinc	ppm	ASTM D5185m		251		
Sulfur	ppm	ASTM D5185m		5262		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	3		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.46		



OIL ANALYSIS REPORT

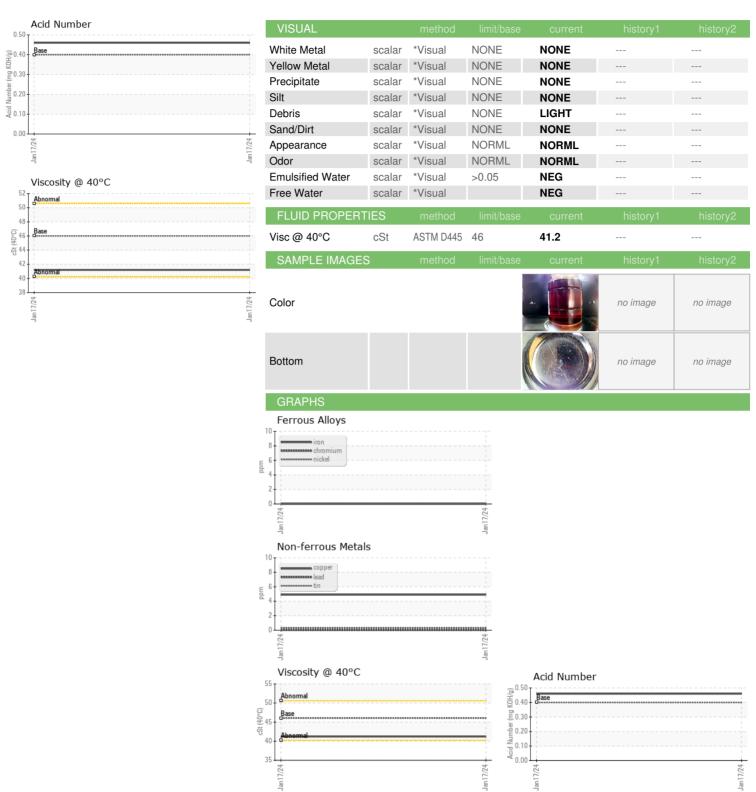





Certificate L2367

Laboratory Sample No. Lab Number Unique Number

: WC0872542 : 06076979 : 10859070 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 01 Feb 2024 Recieved Diagnosed : 02 Feb 2024

Diagnostician

: Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact: ROBIN PRICHARD r.prichard@compressed air technologies.comT: (513)539-5155

ELEVATED INDUSTRIAL SOLUTIONS

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ROBIN PRICHARD - COMMONOH

120 LAWTON AVE.

MONROE, OH

US 45050

F: