

OIL ANALYSIS REPORT

SULLAIR 10-25 40267DGH

Component

Compressor

SULLAIR SRF 1/4000 (3 GAL)

Sample Rating Trend

NORMAL

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0854627		
Sample Date		Client Info		09 Jan 2024		
Machine Age	hrs	Client Info		21694		
Oil Age	hrs	Client Info		2000		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	٧	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	0	<1		
Calcium	ppm	ASTM D5185m		1		
Phosphorus	ppm	ASTM D5185m	328	239		
Zinc	ppm	ASTM D5185m	5	4		
Sulfur	ppm	ASTM D5185m	1400	2014		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.06	0.093		



OIL ANALYSIS REPORT

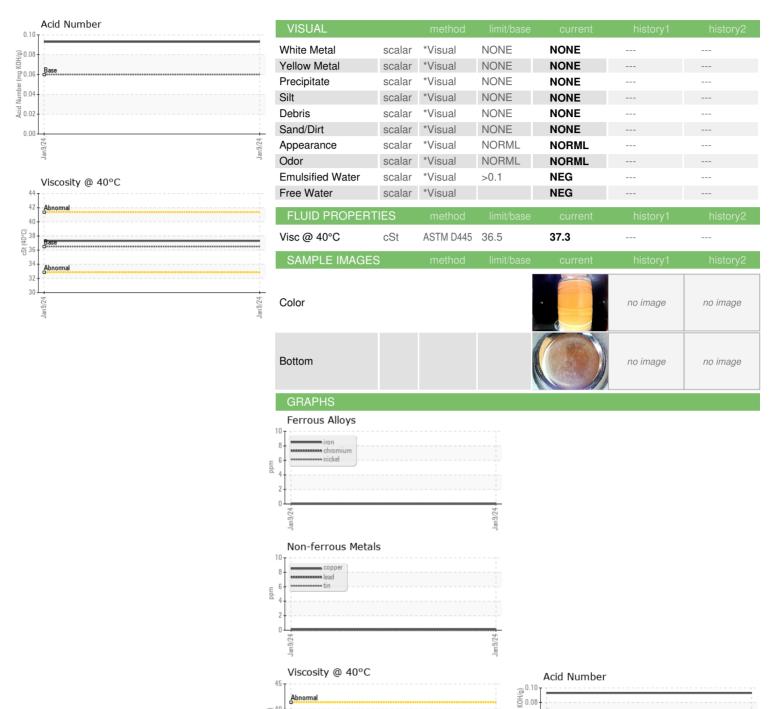





Laboratory Sample No. Lab Number Unique Number

: 06076981 Test Package : IND 2

₹ 35

30

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0854627 : 01 Feb 2024 Recieved : 02 Feb 2024

€0.06

은 0.04 0.02

0.00

Diagnosed : Don Baldridge : 10859072 Diagnostician

Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ELEVATED INDUSTRIAL SOLUTIONS

120 LAWTON AVE. MONROE, OH US 45050

Contact: ROBIN PRICHARD

r.prichard@compressedairtechnologies.com T: (513)539-5155

F:

Contact/Location: ROBIN PRICHARD - COMMONOH