

# **OIL ANALYSIS REPORT**

Sample Rating Trend



KAESER AS 25 101920.0 - 1024 - ROLLED ALLOYS

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		·		Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0893733		
Sample Date		Client Info		24 Jan 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	٧	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	5		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	18		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		1		
Zinc	ppm	ASTM D5185m		34		
Sulfur	ppm	ASTM D5185m		16087		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		14		
Potassium	ppm	ASTM D5185m	>20	3		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.42



## **OIL ANALYSIS REPORT**

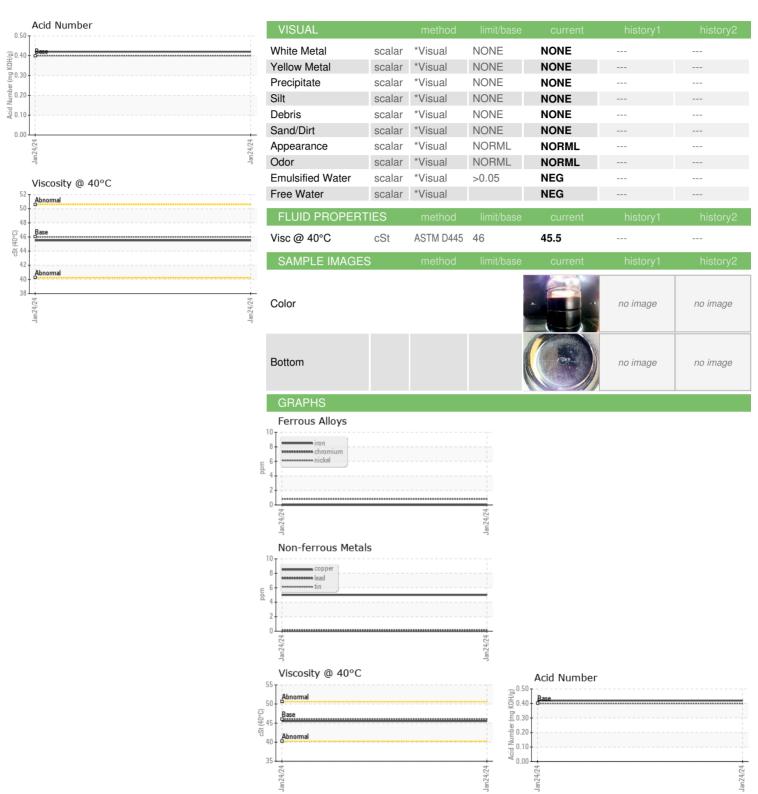





Certificate L2367

Laboratory Sample No. Lab Number Unique Number Test Package : IND 2

: WC0893733 : 06076982 : 10859073

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

: 01 Feb 2024 Recieved Diagnosed : 02 Feb 2024 : Don Baldridge Diagnostician

**ELEVATED INDUSTRIAL SOLUTIONS** 

120 LAWTON AVE. MONROE, OH US 45050

Contact: ROBIN PRICHARD

r.prichard@compressed air technologies.comT: (513)539-5155

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: COMMONOH [WUSCAR] 06076982 (Generated: 02/02/2024 18:14:08) Rev: 1

Contact/Location: ROBIN PRICHARD - COMMONOH

F: