


# **OIL ANALYSIS REPORT**

Area **S-460** [8257] KAESER 4353262 - MORGAN OHARE INC (S/N 1102)







## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jul202	1 Jan2023	Jul2023 Ja	n2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06077010	UCH05902393	UCH05762200
Sample Date		Client Info		25 Jan 2024	07 Jul 2023	28 Jan 2023
Machine Age	hrs	Client Info		78773	75432	35458
Oil Age	hrs	Client Info		3315	3000	3400
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION	N	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	2
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	23	12	32
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	90	8	<1	9
Calcium	ppm	ASTM D5185m	2	1	0	0
Phosphorus	ppm	ASTM D5185m		<1	0	5
Zinc	ppm	ASTM D5185m		80	27	112
Sulfur	ppm	ASTM D5185m		15692	17821	15839
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		3	3	5
Potassium	ppm	ASTM D5185m	>20	2	0	3
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
A atal Nicosala au (ANI)		4 OTA 1 DOC 45	0.4	0.40	0.40	0.47

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.40

0.43


0.47



# **OIL ANALYSIS REPORT**

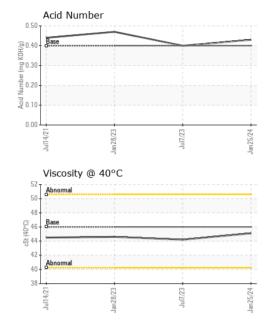

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID DDODEDT	IEC	and the section of	12		for the control	la la tama O
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.1	44.2	44.6
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						

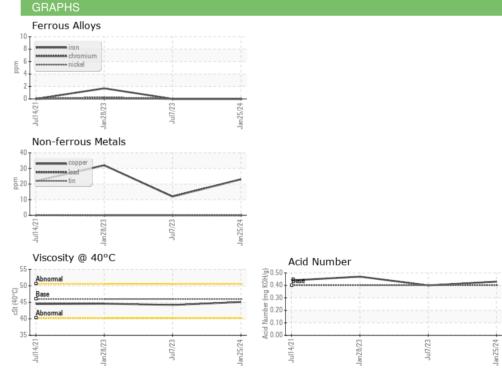





Certificate L2367

Laboratory Sample No.

Test Package : IND 2

: UCH06077010 Lab Number : 06077010 Unique Number : 10859101

**Bottom** 

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received :01 Feb 2024

**Tested** : 02 Feb 2024 Diagnosed : 02 Feb 2024 - Don Baldridge

**DELTA INDUSTRIES - DOWNERS GROVE** 

2201 CURTISS STREET DOWNERS GROVE, IL

US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931