




# OIL ANALYSIS REPORT

Sample Rating Trend

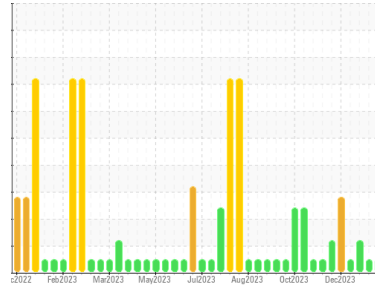

**NORMAL**



Machine Id  
**Grand Blanc CAT 5 GBLM05BE**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: 400 hr Oil Sample )

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>WC0870053</b>   | WC0870116   | WC0870119   |
| Sample Date   | Client Info |             | <b>30 Jan 2024</b> | 16 Jan 2024 | 02 Jan 2024 |
| Machine Age   | hrs         | Client Info | <b>58168</b>       | 57838       | 57606       |
| Oil Age       | hrs         | Client Info | <b>444</b>         | 629         | 423         |
| Oil Changed   | Client Info |             | <b>Not Chngd</b>   | Not Chngd   | Not Chngd   |
| Sample Status |             |             | <b>NORMAL</b>      | NORMAL      | ABNORMAL    |

## CONTAMINATION

|        | method    | limit/base | current        | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel   | WC Method | >4.0       | <b>&lt;1.0</b> | <1.0     | <1.0     |
| Water  | WC Method | >0.1       | <b>NEG</b>     | NEG      | NEG      |
| Glycol | WC Method |            | <b>NEG</b>     | NEG      | NEG      |

## WEAR METALS

|          | method | limit/base      | current      | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron     | ppm    | ASTM D5185m >15 | <b>3</b>     | 3        | 4        |
| Chromium | ppm    | ASTM D5185m >4  | <b>0</b>     | <1       | <1       |
| Nickel   | ppm    | ASTM D5185m >2  | <b>0</b>     | 0        | <1       |
| Titanium | ppm    | ASTM D5185m     | <b>&lt;1</b> | <1       | <1       |
| Silver   | ppm    | ASTM D5185m >5  | <b>0</b>     | 0        | 0        |
| Aluminum | ppm    | ASTM D5185m >6  | <b>2</b>     | 2        | 2        |
| Lead     | ppm    | ASTM D5185m >9  | <b>3</b>     | <1       | 2        |
| Copper   | ppm    | ASTM D5185m >14 | <b>&lt;1</b> | <1       | <1       |
| Tin      | ppm    | ASTM D5185m >4  | <b>2</b>     | 1        | 2        |
| Vanadium | ppm    | ASTM D5185m     | <b>0</b>     | <1       | 0        |
| Cadmium  | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |

## ADDITIVES

|            | method | limit/base  | current      | history1 | history2 |
|------------|--------|-------------|--------------|----------|----------|
| Boron      | ppm    | ASTM D5185m | <b>5</b>     | 7        | 6        |
| Barium     | ppm    | ASTM D5185m | <b>&lt;1</b> | 0        | 0        |
| Molybdenum | ppm    | ASTM D5185m | <b>3</b>     | 3        | 5        |
| Manganese  | ppm    | ASTM D5185m | <b>&lt;1</b> | <1       | <1       |
| Magnesium  | ppm    | ASTM D5185m | <b>24</b>    | 26       | 40       |
| Calcium    | ppm    | ASTM D5185m | <b>1835</b>  | 1842     | 1970     |
| Phosphorus | ppm    | ASTM D5185m | <b>282</b>   | 293      | 346      |
| Zinc       | ppm    | ASTM D5185m | <b>355</b>   | 353      | 407      |
| Sulfur     | ppm    | ASTM D5185m | <b>2711</b>  | 2467     | 3498     |

## CONTAMINANTS

|           | method | limit/base       | current      | history1 | history2 |
|-----------|--------|------------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185m >181 | <b>115</b>   | 64       | 118      |
| Sodium    | ppm    | ASTM D5185m      | <b>&lt;1</b> | 0        | <1       |
| Potassium | ppm    | ASTM D5185m >20  | <b>&lt;1</b> | 0        | <1       |

## INFRA-RED




|           | method   | limit/base      | current     | history1 | history2 |
|-----------|----------|-----------------|-------------|----------|----------|
| Soot %    | %        | *ASTM D7844     | <b>0.1</b>  | 0        | 0.1      |
| Nitration | Abs/cm   | *ASTM D7624 >20 | <b>6.1</b>  | 5.8      | 6.5      |
| Sulfation | Abs/.1mm | *ASTM D7415 >30 | <b>24.3</b> | 19.2     | 26.1     |

## FLUID DEGRADATION

|                  | method   | limit/base      | current     | history1 | history2 |
|------------------|----------|-----------------|-------------|----------|----------|
| Oxidation        | Abs/.1mm | *ASTM D7414 >25 | <b>15.6</b> | 10.8     | 18.0     |
| Acid Number (AN) | mg KOH/g | ASTM D8045 1.1  | <b>1.97</b> | 0.82     | ▲ 2.34   |
| Base Number (BN) | mg KOH/g | ASTM D2896 5.4  | <b>2.74</b> | 4.01     | 2.27     |











# OIL ANALYSIS REPORT

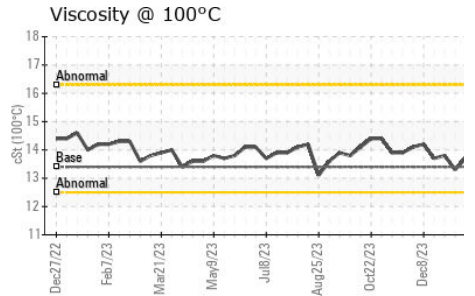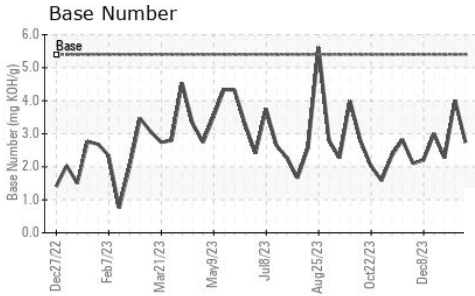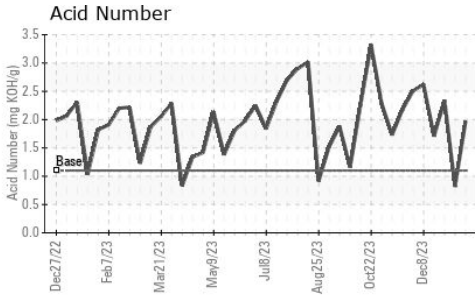

| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1    | history2 |      |
|------------------|--------|------------|---------|-------------|----------|------|
| Visc @ 100°C     | cSt    | ASTM D445  | 13.4    | <b>13.7</b> | 13.3     | 13.8 |

## GRAPHS

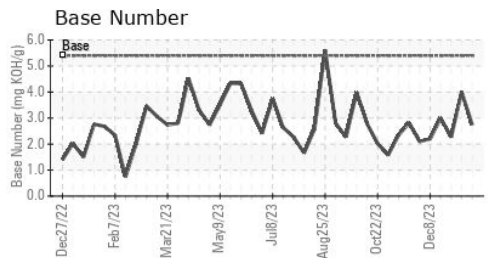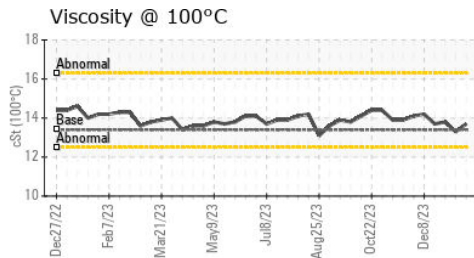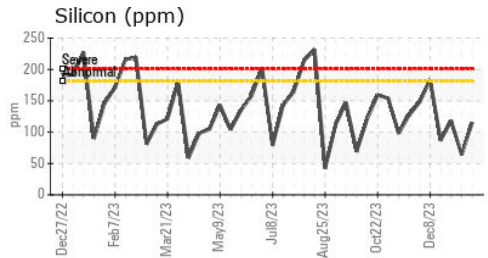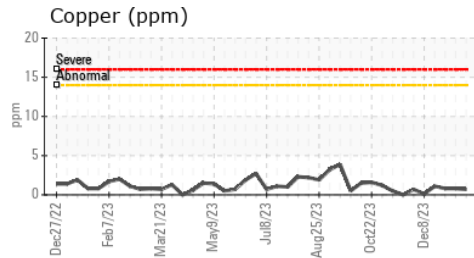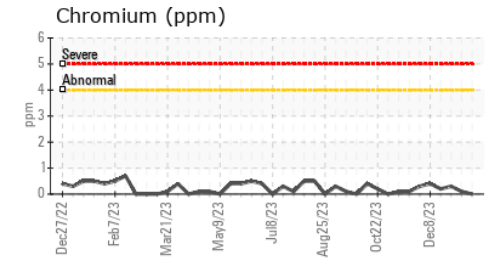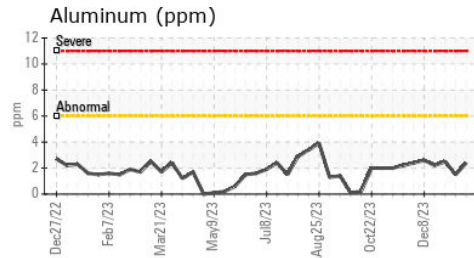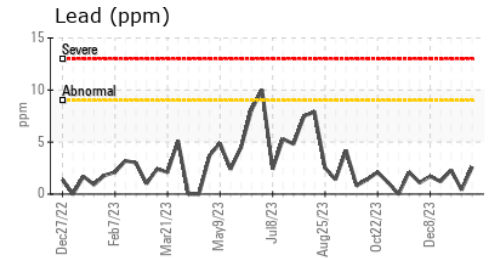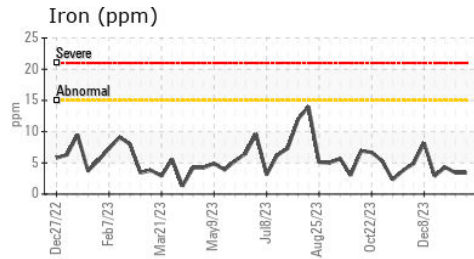

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0870053  
**Lab Number** : 06077050  
**Unique Number** : 10859141  
**Test Package** : MOB 2

**Received** : 01 Feb 2024  
**Tested** : 02 Feb 2024  
**Diagnosed** : 02 Feb 2024 - Sean Felton

**EDL NA Recips-Grand Blanc**  
 Grand Blanc Powerstation, 2361 West Grand Blanc Road  
 Grand Blanc, MI  
 US 48439

Contact: Tony Saint Marie  
 tony.saintmarie@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: