OIL ANALYSIS REPORT

Sample Rating Trend

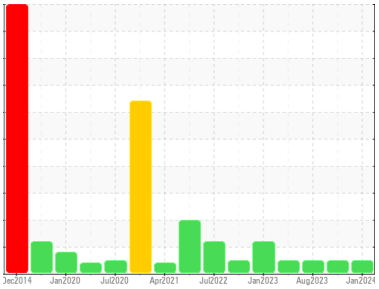

NORMAL

Machine Id
BT-FOR-A6 (S/N TANK FT6 AGITATOR)
Component
Gearbox
Fluid
SHELL OMALA S2 GX 220 (--- GAL)

DIAGNOSIS

Recommendation
No corrective actions at this time.

Wear
Wear rate is low and steady.

Contamination
Contaminant levele are typical for new oil from the drum

Fluid Condition
Fluid health properties suggest oil is acceptable for continued use.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**PLS0000719**	PLS0000783	PLS0000565
Sample Date		Client Info		**31 Jan 2024**	25 Oct 2023	09 Aug 2023
Machine Age	mths	Client Info		**3**	0	0
Oil Age	mths	Client Info		**0**	1	0
Oil Changed		Client Info		**N/A**	Changed	N/A
Sample Status				**NORMAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.2	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		**18**	16	13
Iron	ppm	ASTM D5185m	>200	**20**	26	25
Chromium	ppm	ASTM D5185m	>15	**0**	0	0
Nickel	ppm	ASTM D5185m	>15	**0**	0	0
Titanium	ppm	ASTM D5185m		**<1**	<1	<1
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>25	**0**	0	0
Lead	ppm	ASTM D5185m	>100	**0**	0	0
Copper	ppm	ASTM D5185m	>200	**0**	0	2
Tin	ppm	ASTM D5185m	>25	**0**	0	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	6.2	**0**	1	2
Barium	ppm	ASTM D5185m	0.0	**<1**	0	<1
Molybdenum	ppm	ASTM D5185m	0	**0**	<1	<1
Manganese	ppm	ASTM D5185m		**<1**	<1	<1
Magnesium	ppm	ASTM D5185m	0	**2**	0	2
Calcium	ppm	ASTM D5185m	0.0	**5**	0	5
Phosphorus	ppm	ASTM D5185m	290	**287**	208	266
Zinc	ppm	ASTM D5185m	3.8	**19**	6	26
Sulfur	ppm	ASTM D5185m	8167	**9853**	8827	10411

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	**2**	<1	2
Sodium	ppm	ASTM D5185m		**0**	1	0
Potassium	ppm	ASTM D5185m	>20	**0**	0	<1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0**	0	0
Nitration	Abs/cm	*ASTM D7624		**3.0**	3.0	2.9
Sulfation	Abs/.1mm	*ASTM D7415		**12.1**	12.4	12.0

OIL ANALYSIS REPORT

Particle Count

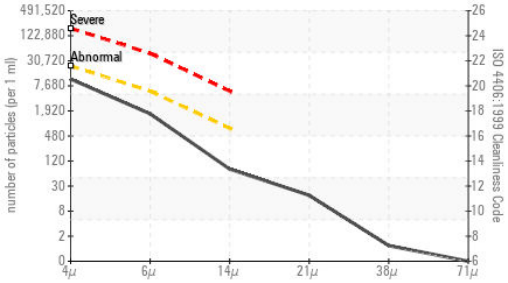

Acid Number

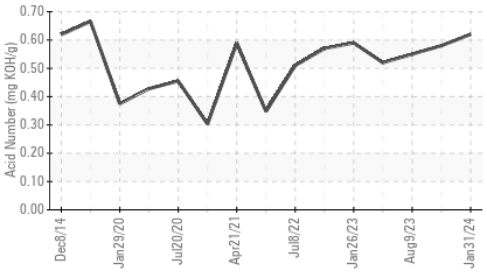

Viscosity @ 40°C

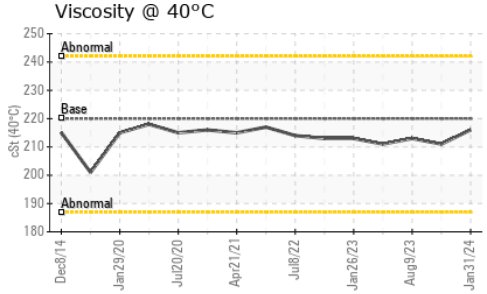

PQ

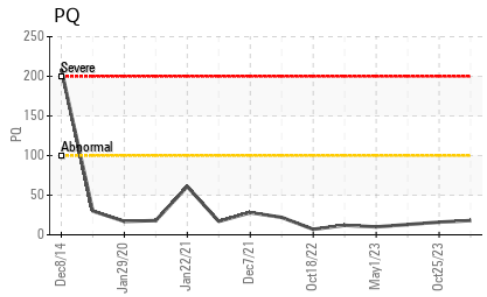

Particle Trend

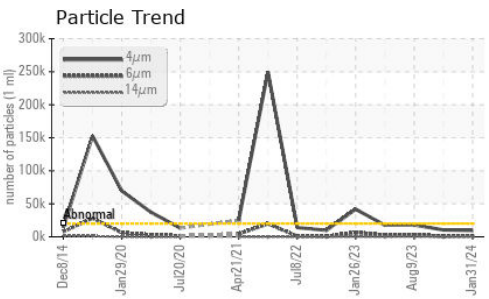

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	**9690**	10418	17959
Particles >6µm		ASTM D7647	>5000	**1432**	690	3174
Particles >14µm		ASTM D7647	>640	**68**	26	283
Particles >21µm		ASTM D7647	>160	**16**	6	88
Particles >38µm		ASTM D7647	>40	**1**	0	4
Particles >71µm		ASTM D7647	>10	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	**20/18/13**	21/17/12	21/19/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		**2.8**	3.2	3.1
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.62**	0.58	0.55

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	**216**	211	213

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom			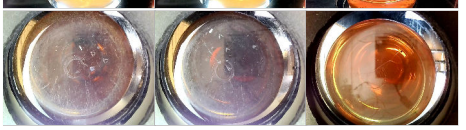		

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PLS0000719 **Received** : 01 Feb 2024
Lab Number : 06077606 **Tested** : 02 Feb 2024
Unique Number : 10859697 **Diagnosed** : 09 Feb 2024 - Mike Johnson
Test Package : IND 2 (Additional Tests: FT-IR, PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HEXION - BAYTOWN PLANT
8450 WEST BAY RD
BAYTOWN, TX
US 77520
Contact: BILL MINER
bill.miner@momentive.com
T:
F: