


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

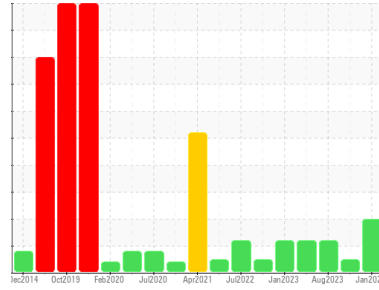

Machine Id  
**BT-F0R-A11 (S/N A11 TANK WT2 AGITATOR)**

Component  
**Gearbox**  
Fluid

**SHELL OMALA S2 GX 220 (--- GAL)**

## DIAGNOSIS

### Recommendation

Filter oil if possible using B6=75 media or better. Resample at next normal interval.

### Wear

Wear particles are low and acceptable.

### Contamination

Particle contamination is elevated. Filtration can help to extend machine life.

### Fluid Condition

Fluid health indicators are acceptable for continued use.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PLS0000717</b>	PLS0000785	PLS0000473
Sample Date	Client Info		<b>31 Jan 2024</b>	25 Oct 2023	09 Aug 2023
Machine Age	mths	Client Info	<b>3</b>	0	0
Oil Age	mths	Client Info	<b>0</b>	1	0
Oil Changed	Client Info		<b>N/A</b>	Changed	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>15</b>	11	9
Iron	ppm	ASTM D5185m >200	<b>24</b>	27	31
Chromium	ppm	ASTM D5185m >15	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >200	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >25	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 6.2	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.0	<b>&lt;1</b>	0	<1
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 0	<b>1</b>	0	3
Calcium	ppm	ASTM D5185m 0.0	<b>8</b>	0	6
Phosphorus	ppm	ASTM D5185m 290	<b>292</b>	182	245
Zinc	ppm	ASTM D5185m 3.8	<b>20</b>	0	11
Sulfur	ppm	ASTM D5185m 8167	<b>9786</b>	8599	10464






## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>2</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	<1

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	<b>3.0</b>	2.9	2.9
Sulfation	Abs.1mm	*ASTM D7415	<b>12.1</b>	12.2	12.0

# OIL ANALYSIS REPORT

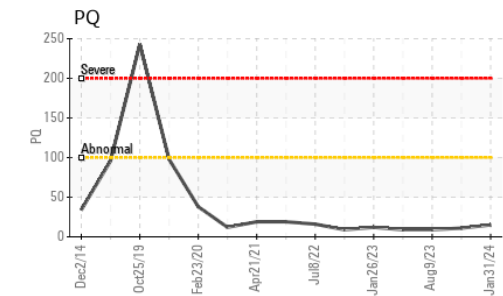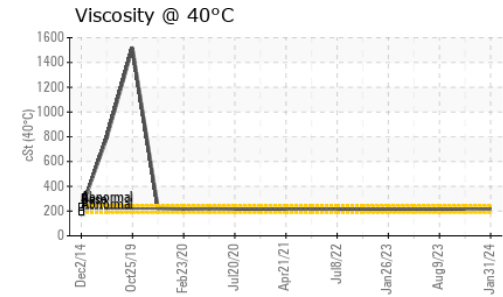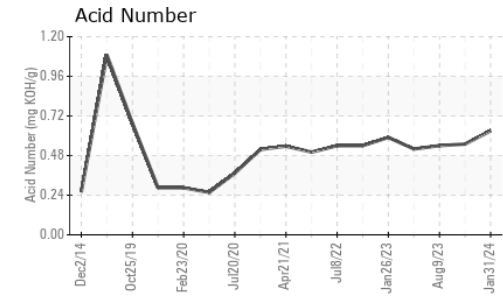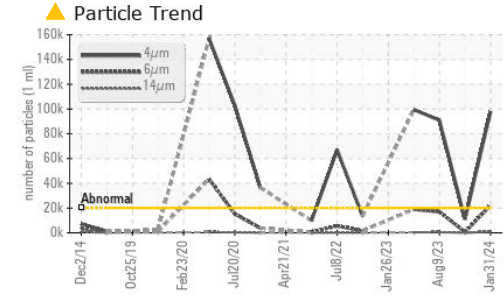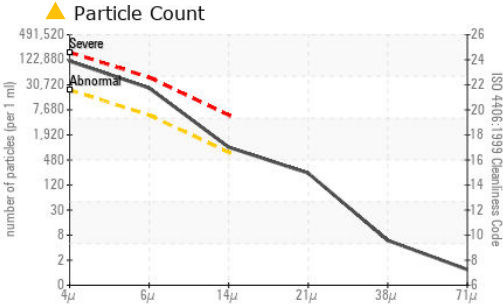


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 97881	10956	▲ 90873
Particles >6µm	ASTM D7647	>5000	▲ 22318	702	▲ 16946
Particles >14µm	ASTM D7647	>640	▲ 853	21	510
Particles >21µm	ASTM D7647	>160	▲ 204	5	127
Particles >38µm	ASTM D7647	>40	5	0	4
Particles >71µm	ASTM D7647	>10	1	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 24/22/17	21/17/12	▲ 24/21/16

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm *ASTM D7414		2.8	3.0	2.9
Acid Number (AN)	mg KOH/g ASTM D8045		0.63	0.55	0.54

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>0.2	NEG	NEG	NEG
Free Water	scalar *Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	220	217	213	211

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

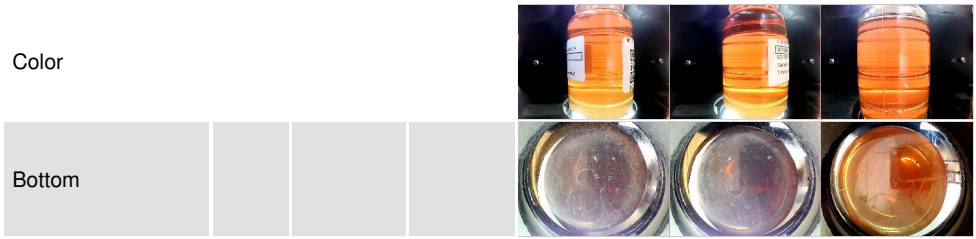

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PLS0000717 **Received** : 01 Feb 2024  
**Lab Number** : 06077614 **Tested** : 02 Feb 2024  
**Unique Number** : 10859705 **Diagnosed** : 09 Feb 2024 - Mike Johnson  
**Test Package** : IND 2 ( Additional Tests: FT-IR, PQ, PrtCount )

**HEXION - BAYTOWN PLANT**  
 8450 WEST BAY RD  
 BAYTOWN, TX  
 US 77520  
 Contact: PAT BELL  
 pat.bell@momentive.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)